


0
5 Centimetres
10
15
20
25
30

AS SEEN FROM REAR

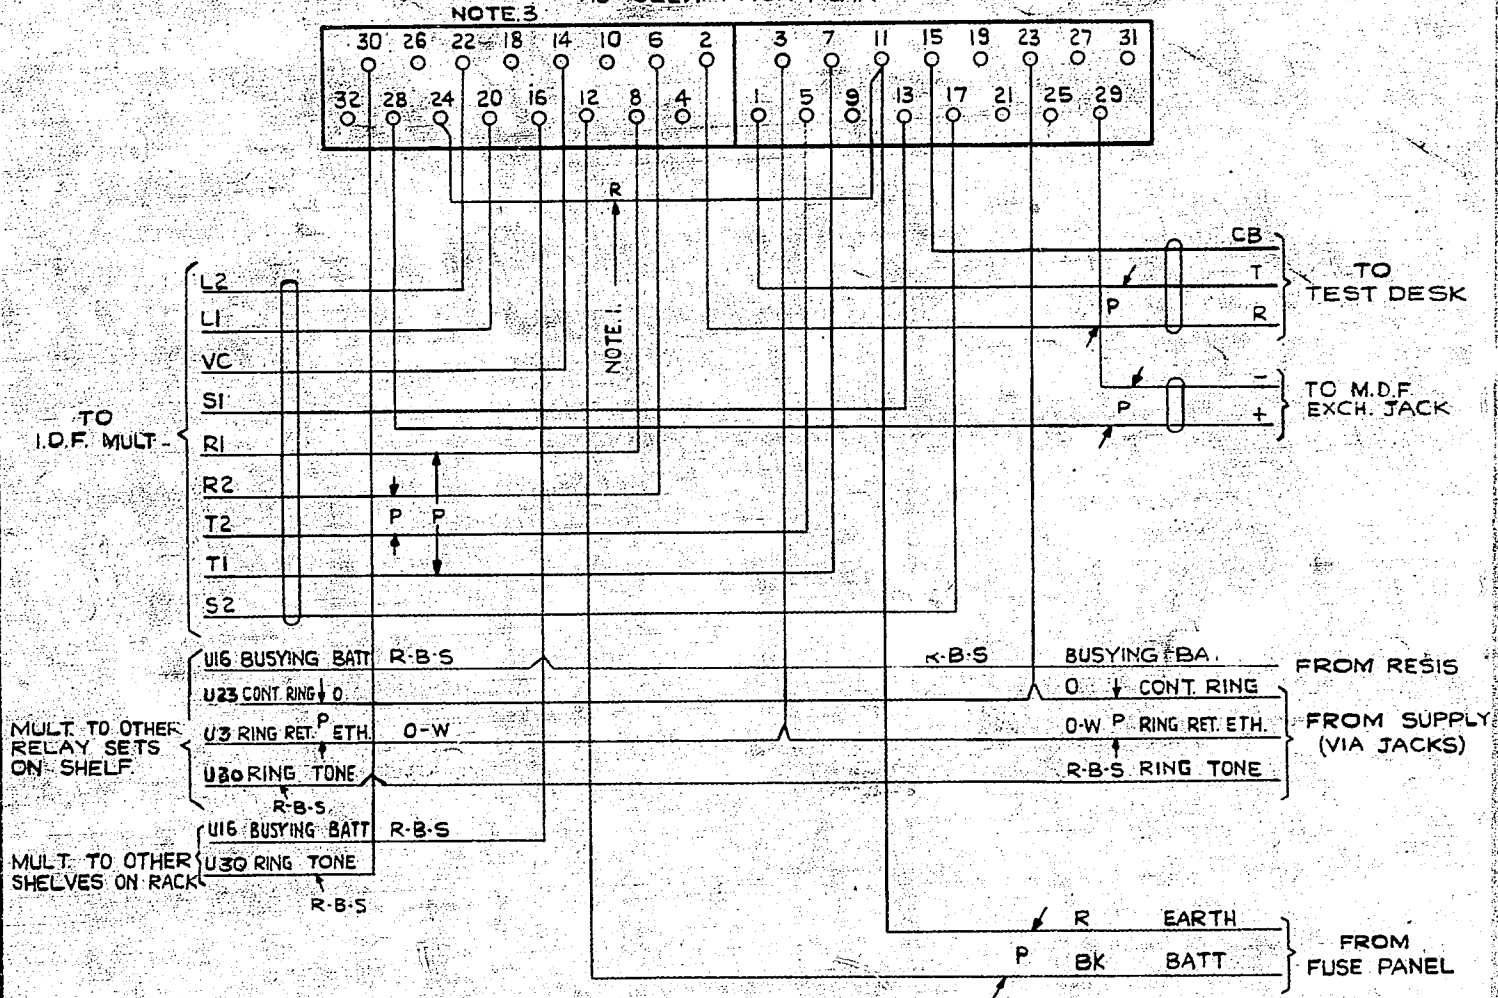

NOTES.

1. INSERT STRAP BETWEEN U24 AND U11.
2. ALL WIRING NOT OTHERWISE SPECIFIED TO BE 20 S.W.G.
3. U14 & U16 TO MAKE CONTACT WHEN RELAY SET IS REMOVED.

NO LONGER IN USE

CANCELLED (2229)				3	7-11-72	B5H	HOSPITAL CIRCUIT FOR RURAL AUTOMATIC LINES 2000 TYPE HAMILTON EXCHANGE
				M'LEAD FROM U24 TO I.D.F. DELETED. (65697)			
AMENDMENT PARTICULARS				ISSUE DATE	APPD.	REF. :-	50V S
N.Z.P.O.				DRAWN C.P.S.	CHECKED E.J.O.	WIRING D.	CIRCUIT R.

GBU 10550