
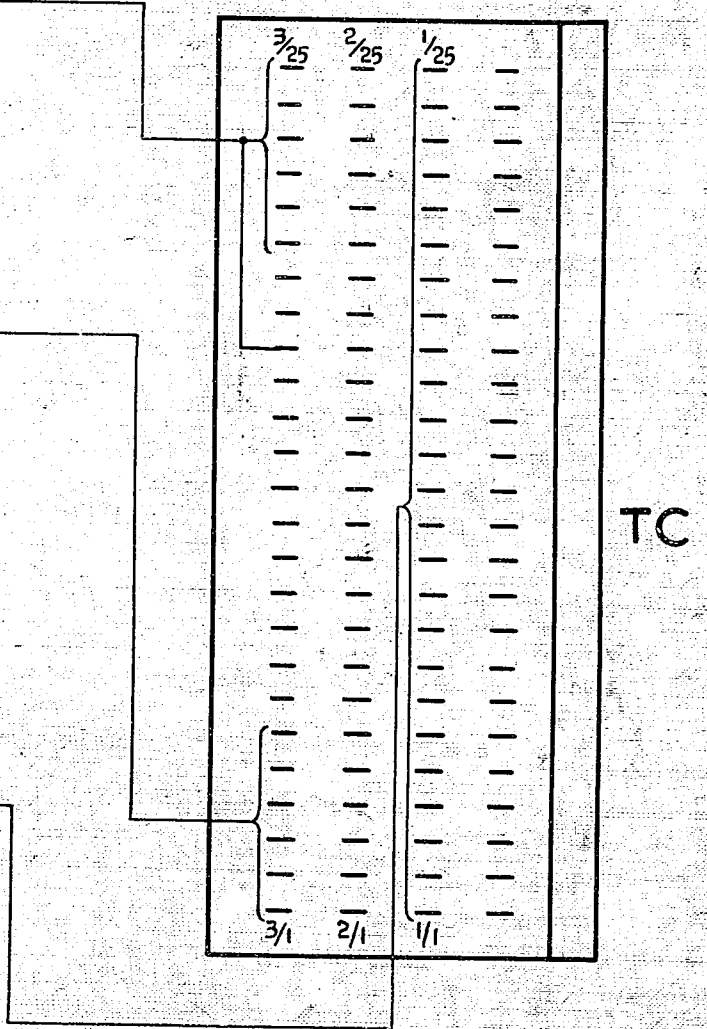
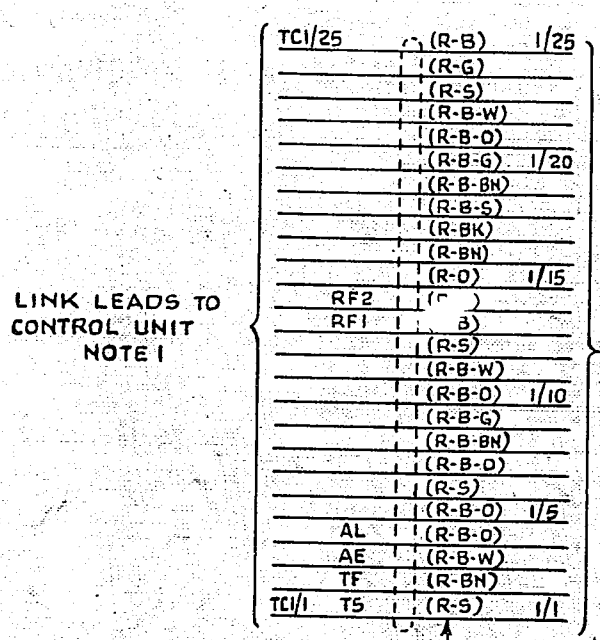
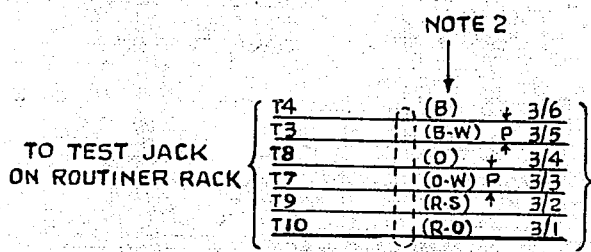
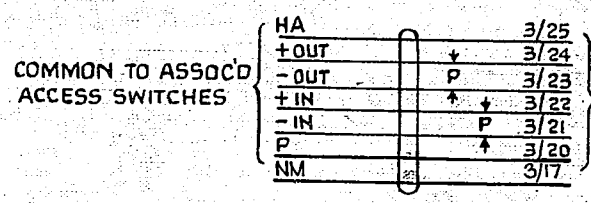


SUPY LEADS VIA RACK MISC. STRIP CONN. SEE GBW 11560 OR EQUIV.

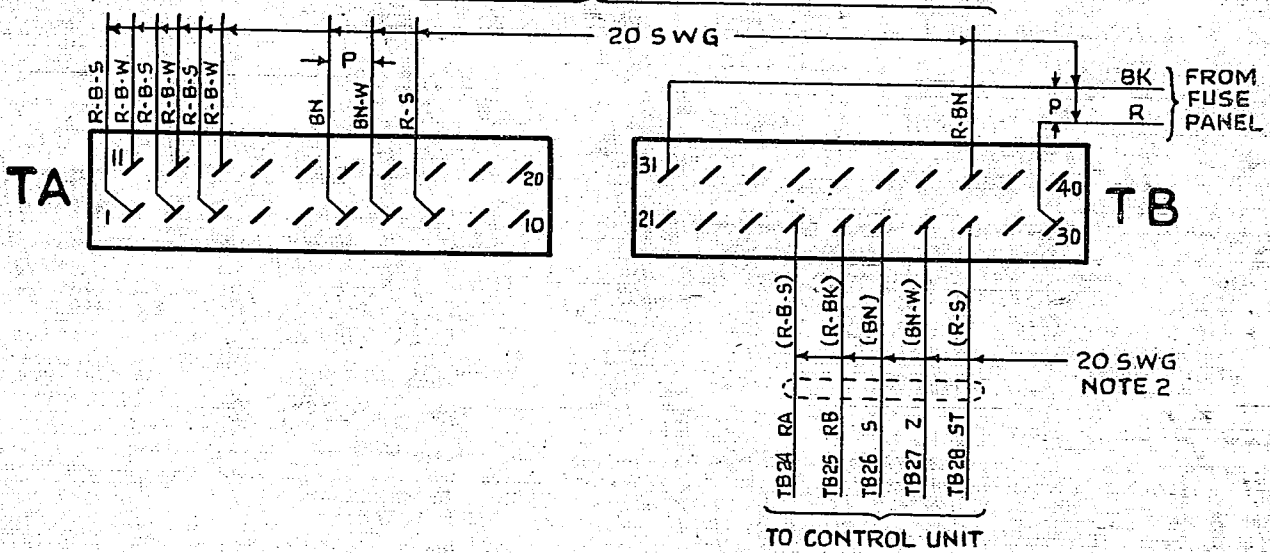

NOTES
 1 ALL LEADS WIRED TO CONTROL UNIT. THOSE ACTUALLY IN SERVICE ARE INDICATED BY DESIGNATION ON THE GBW DIAGRAM OF THE RELEVANT TEST UNIT.
 2 COLOUR CODE SHOWN IN BRACKETS, USED ONLY WITH FORMED CABLE (23 SWG UNLESS OTHERWISE SPECIFIED)

CONNECTION TO TC3/17 ADDED. (G5893)					2	9.11.55	CMT.	ROUTINER TEST UNIT FOR AUTO-AUTO RELAY SETS	
AMENDMENT PARTICULARS					ISSUE	DATE	APPD	50V	E
N.Z. P.O.					DRAWN	CHECKED	WIRED	ENGINEER	GBU 11540