
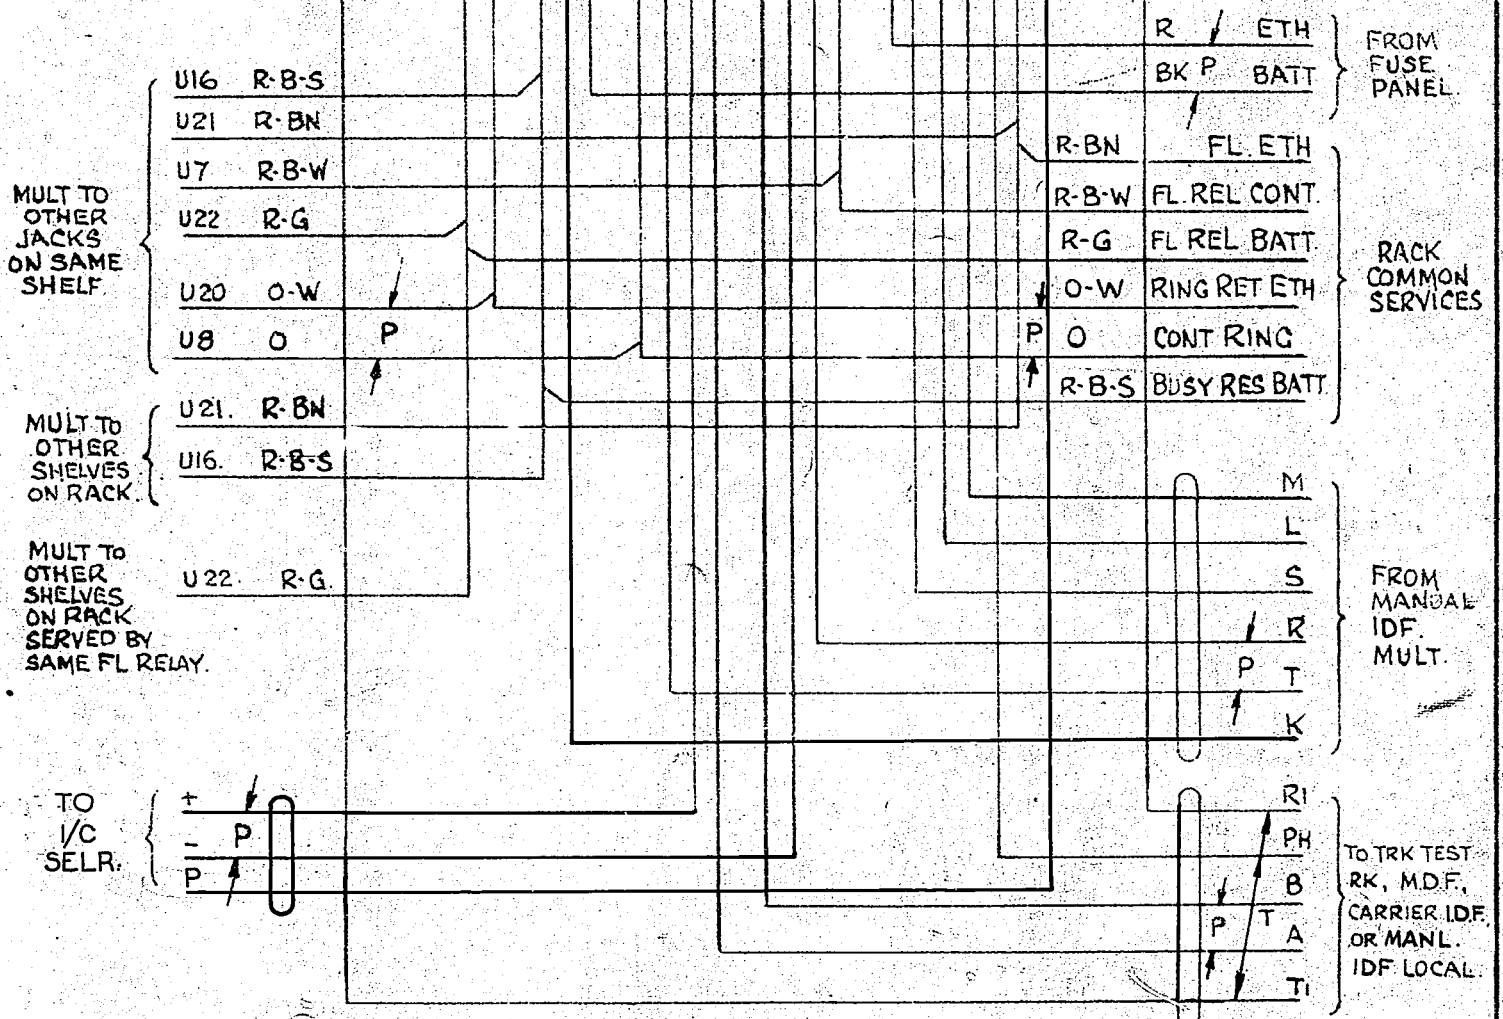


AS SEEN FROM REAR

NOTE 3

NOTE 4

NOTE 3

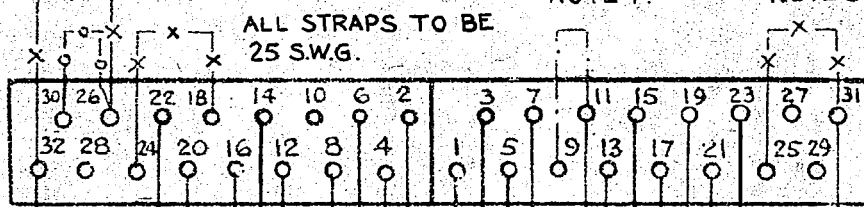

MULT TO OTHER JACKS ON SAME SHELF

MULT TO OTHER SHELVES ON RACK

MULT TO OTHER SHELVES ON RACK SERVED BY SAME FL RELAY.

TO I/C SELR.

FROM FUSE PANEL

RACK COMMON SERVICES

FROM MANUAL IDF. MULT.

TO TRK TEST RK, MDF, CARRIER IDF, OR MANL. IDF LOCAL.

- NOTES
1. SHELF JACK J POINTS 9 & 11, 14 & 16, MAKE CONTACT WHEN RELAY SET IS REMOVED.
 2. ALL WIRING TO BE 22 SWG UNLESS OTHERWISE SPECIFIED.
 3. WHEN THIS CIRCUIT IS USED ON NON-SUPERPOSED LINES OR AS A PHANTOM CIRCUIT ON SUPERPOSED LINES DISCONNECT STRAP U26-30 SHOWN AND CONNECT STRAPS U18-24, U25-31 & U26-32 SHOWN . WHEN THIS CIRCUIT IS USED ON SUPERPOSED LINES AS SIDE CIRCUIT DISCONNECT STRAPS SHOWN & CONNECT STRAP SHOWN .
 4. WHEN THIS CIRCUIT IS ASSOCIATED WITH AN UNDER 3db UNREPEATERED LINE STRAP U9 & U11 SHOWN .

RD
192

S.C.S.
BOTHWAY TRUNK GENERATOR
SIGNALLING AND D.C. DIALLING
PAD CONTROL. 2000 TYPE

(39552)	A	7-7-71	B.S.H.
AMENDMENT PARTICULARS	ISSUE	DATE	APPO
N.Z.P.O.	DRAWN R.P.C.	CHECKED E.L.P.	WIRING CIRCUIT K.E.W.

REF G53-21-3-4-5 SIZE F 50V W
GBU 13030 MOD C

5 Centimetres

10

15

20

25

30