



Centimetres

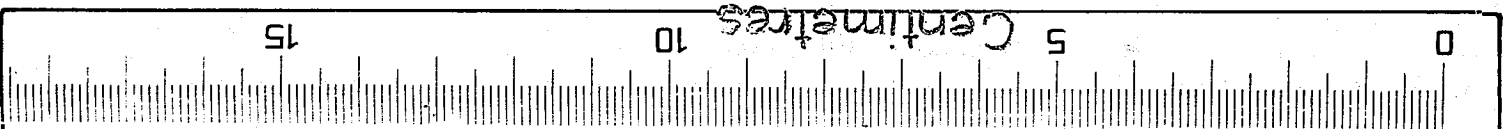

AS SEEN FROM REAR

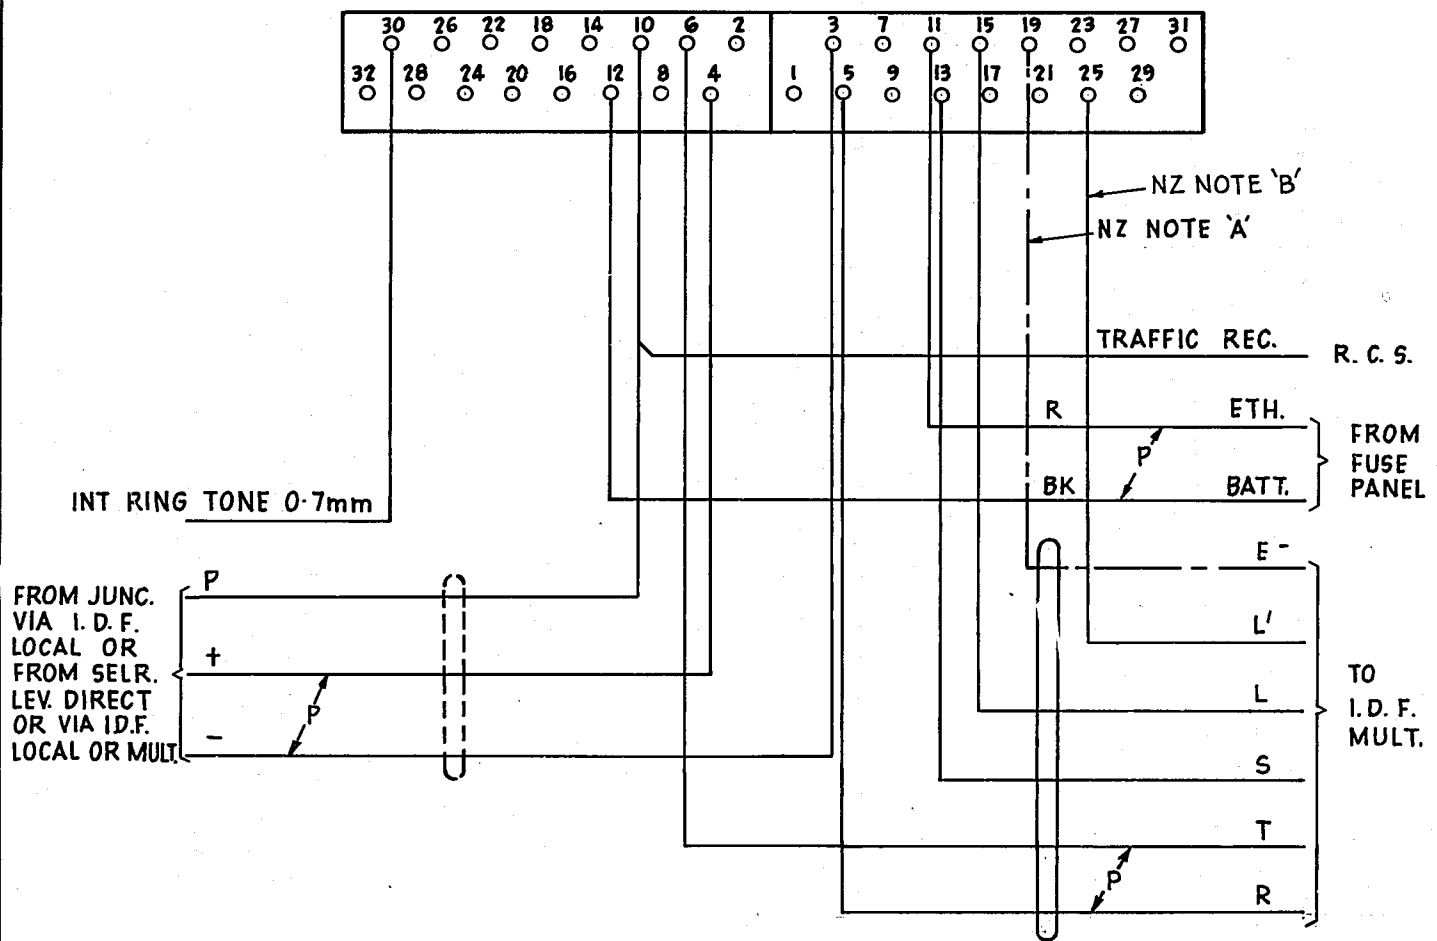

**NZPO NOTES**

A. AT P.M. ADD CONNECTION SHOWN THUS. \_\_\_\_\_  
 AT SOME INSTALLATIONS U25 CABLED TO IDF

**NOTES:-**

1. ALL WIRING UNLESS OTHERWISE SPECIFIED TO BE 0.5mm
2. TR LEAD REQUIRED ONLY WHEN JUNCTION IS UNIDIRECTIONAL.

					JUNCTION RELAY SET INCOMING JUNCTION FROM NEC CROSSBAR LX FOR WE Co BC SWBD 2000 TYPE				
					(122543)	A	30-8-74	B.S.H	
AMENDMENT PARTICULARS					ISSUE	DATE	APPD	REF: GBW 13820 155 7A	50 V W
					<b>13820 MOD A</b>				
NZPO			DRAWN	CHECKED	WIRING	CIRCUIT	<b>GBU</b>		