



07 00 01 02 03 04 05 06 07 08 09 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 00

0 SUPPLY LEADS VIA RACK MISC STRIP CONN SEE GBW 15190 OR EQUIV.

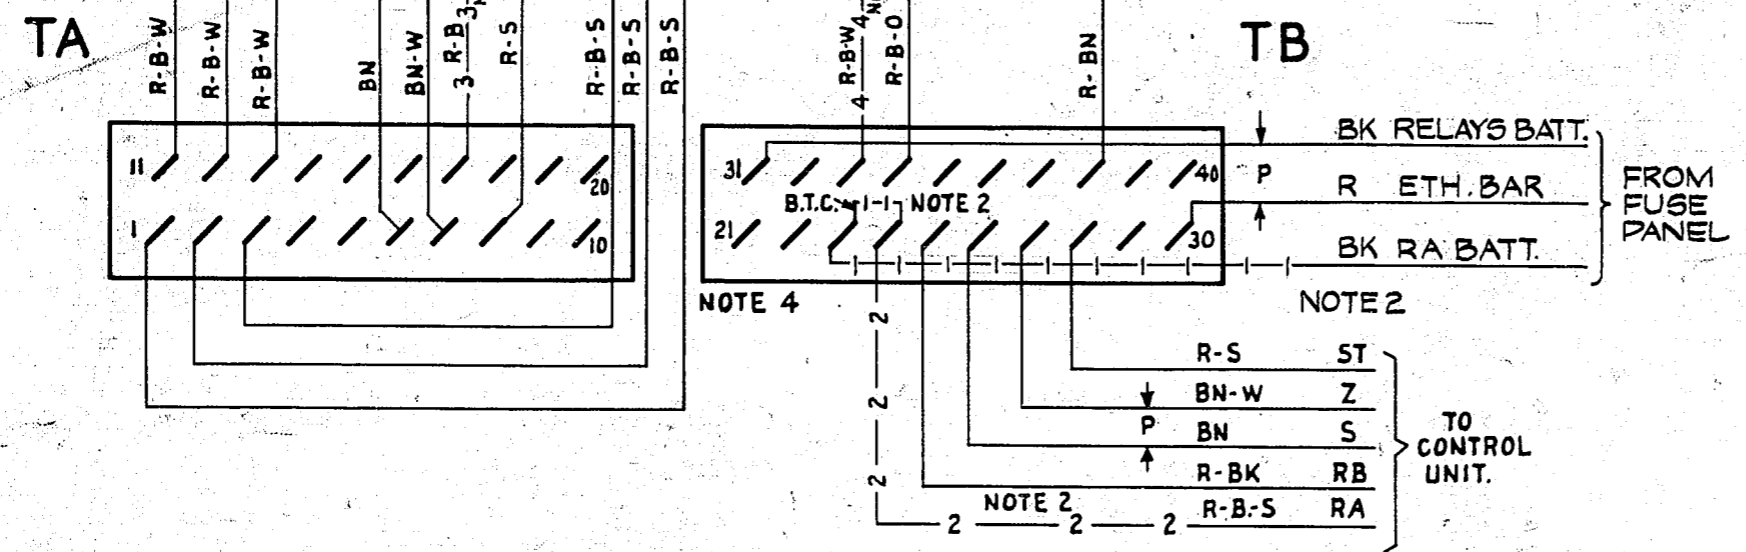

- NOTES:
1. ALL WIRING TO BE 22 SWG UNLESS OTHERWISE SPECIFIED.
 2. WHEN TEST UNIT IS USED IN CONJUNCTION WITH:
 - (a) UNISELECTOR ACCESS EQUIPMENT (GBW 16320 OR EQUIV.), ADD WIRING SHOWN — 1 — 1 —, AND — 5 — 5 — AND OMIT WIRING SHOWN — 2 — 2 —.
 - (b) TWO MOTION ACCESS EQUIPMENT (GBW 11230 OR EQUIV.), ADD WIRING SHOWN — 2 — 2 —, AND — 5 — 5 — AND OMIT WIRING SHOWN — 1 — 1 —. THE LEADS IN USE ARE INDICATED ON GBW 15190 OR EQUIV.
 3. WHEN POSITIVE BATTERY IS REQUIRED ADD WIRING SHOWN — 3 — 3 — AND DELETE WIRING SHOWN — 4 — 4 — WHEN POSITIVE POTENTIAL GENERATOR START IS REQUIRED ADD WIRING SHOWN — 3 — 3 — AND WIRING SHOWN — 4 — 4 —.
 4. TERMINALS ON TERMINAL STRIPS TA & TB ARE AS SEEN FROM FRONT OF RACK.

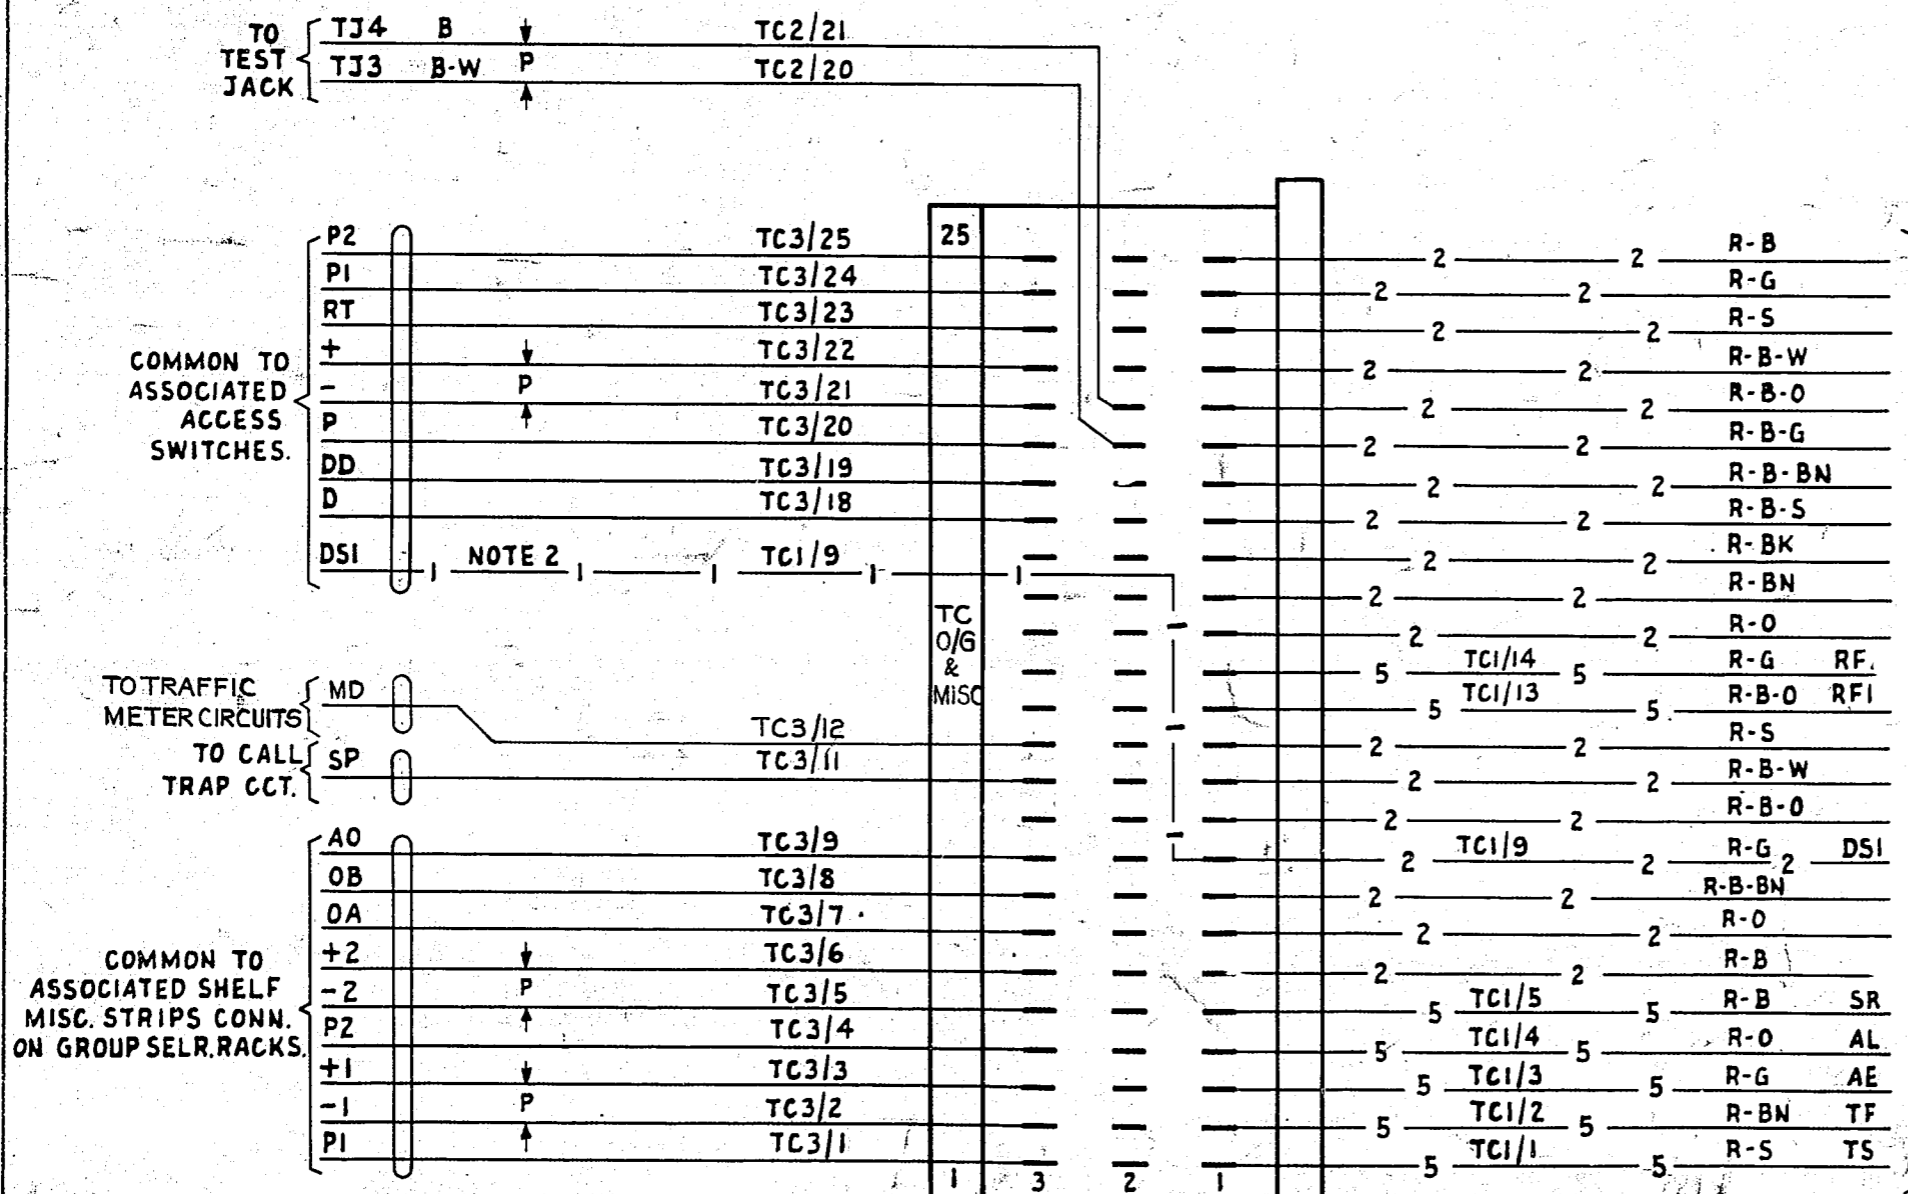

LINK LEADS TO CONTROL UNIT 25 SWG NOTE 2.

MD LEAD ADDED TO TERM STRIP TC	(122322)	4 A	25-974	B 5 H
NOTE 3 CORRECTED.	(46505)	4	10-4-67	4/B
	(46497)	3	24-8-66	4/B
DESIGNATION OF LEADS FROM FUSE PAN. AMENDED		2	6-3-64	4/B
REDRAWN NOTES 1, 2 & 3 CHANGED. NOTE 4 AND GBW 15191 ADDED	(72398)			
AMENDMENT PARTICULARS.				
N.Z.P.O.		DRAWN	CHECKED	WIRING CIRCUIT
		H.B.B.		

ROUTINER FOR GROUP SELRS. WITHOUT BUSY FLASH TEST UNIT 2000 TYPE

REF: 50V S
GBU 15190
15191