

FIG. 2. & FIG. 4. BUSYING RELAY SET.

DIALLING EQUIP.
RELAY SET.


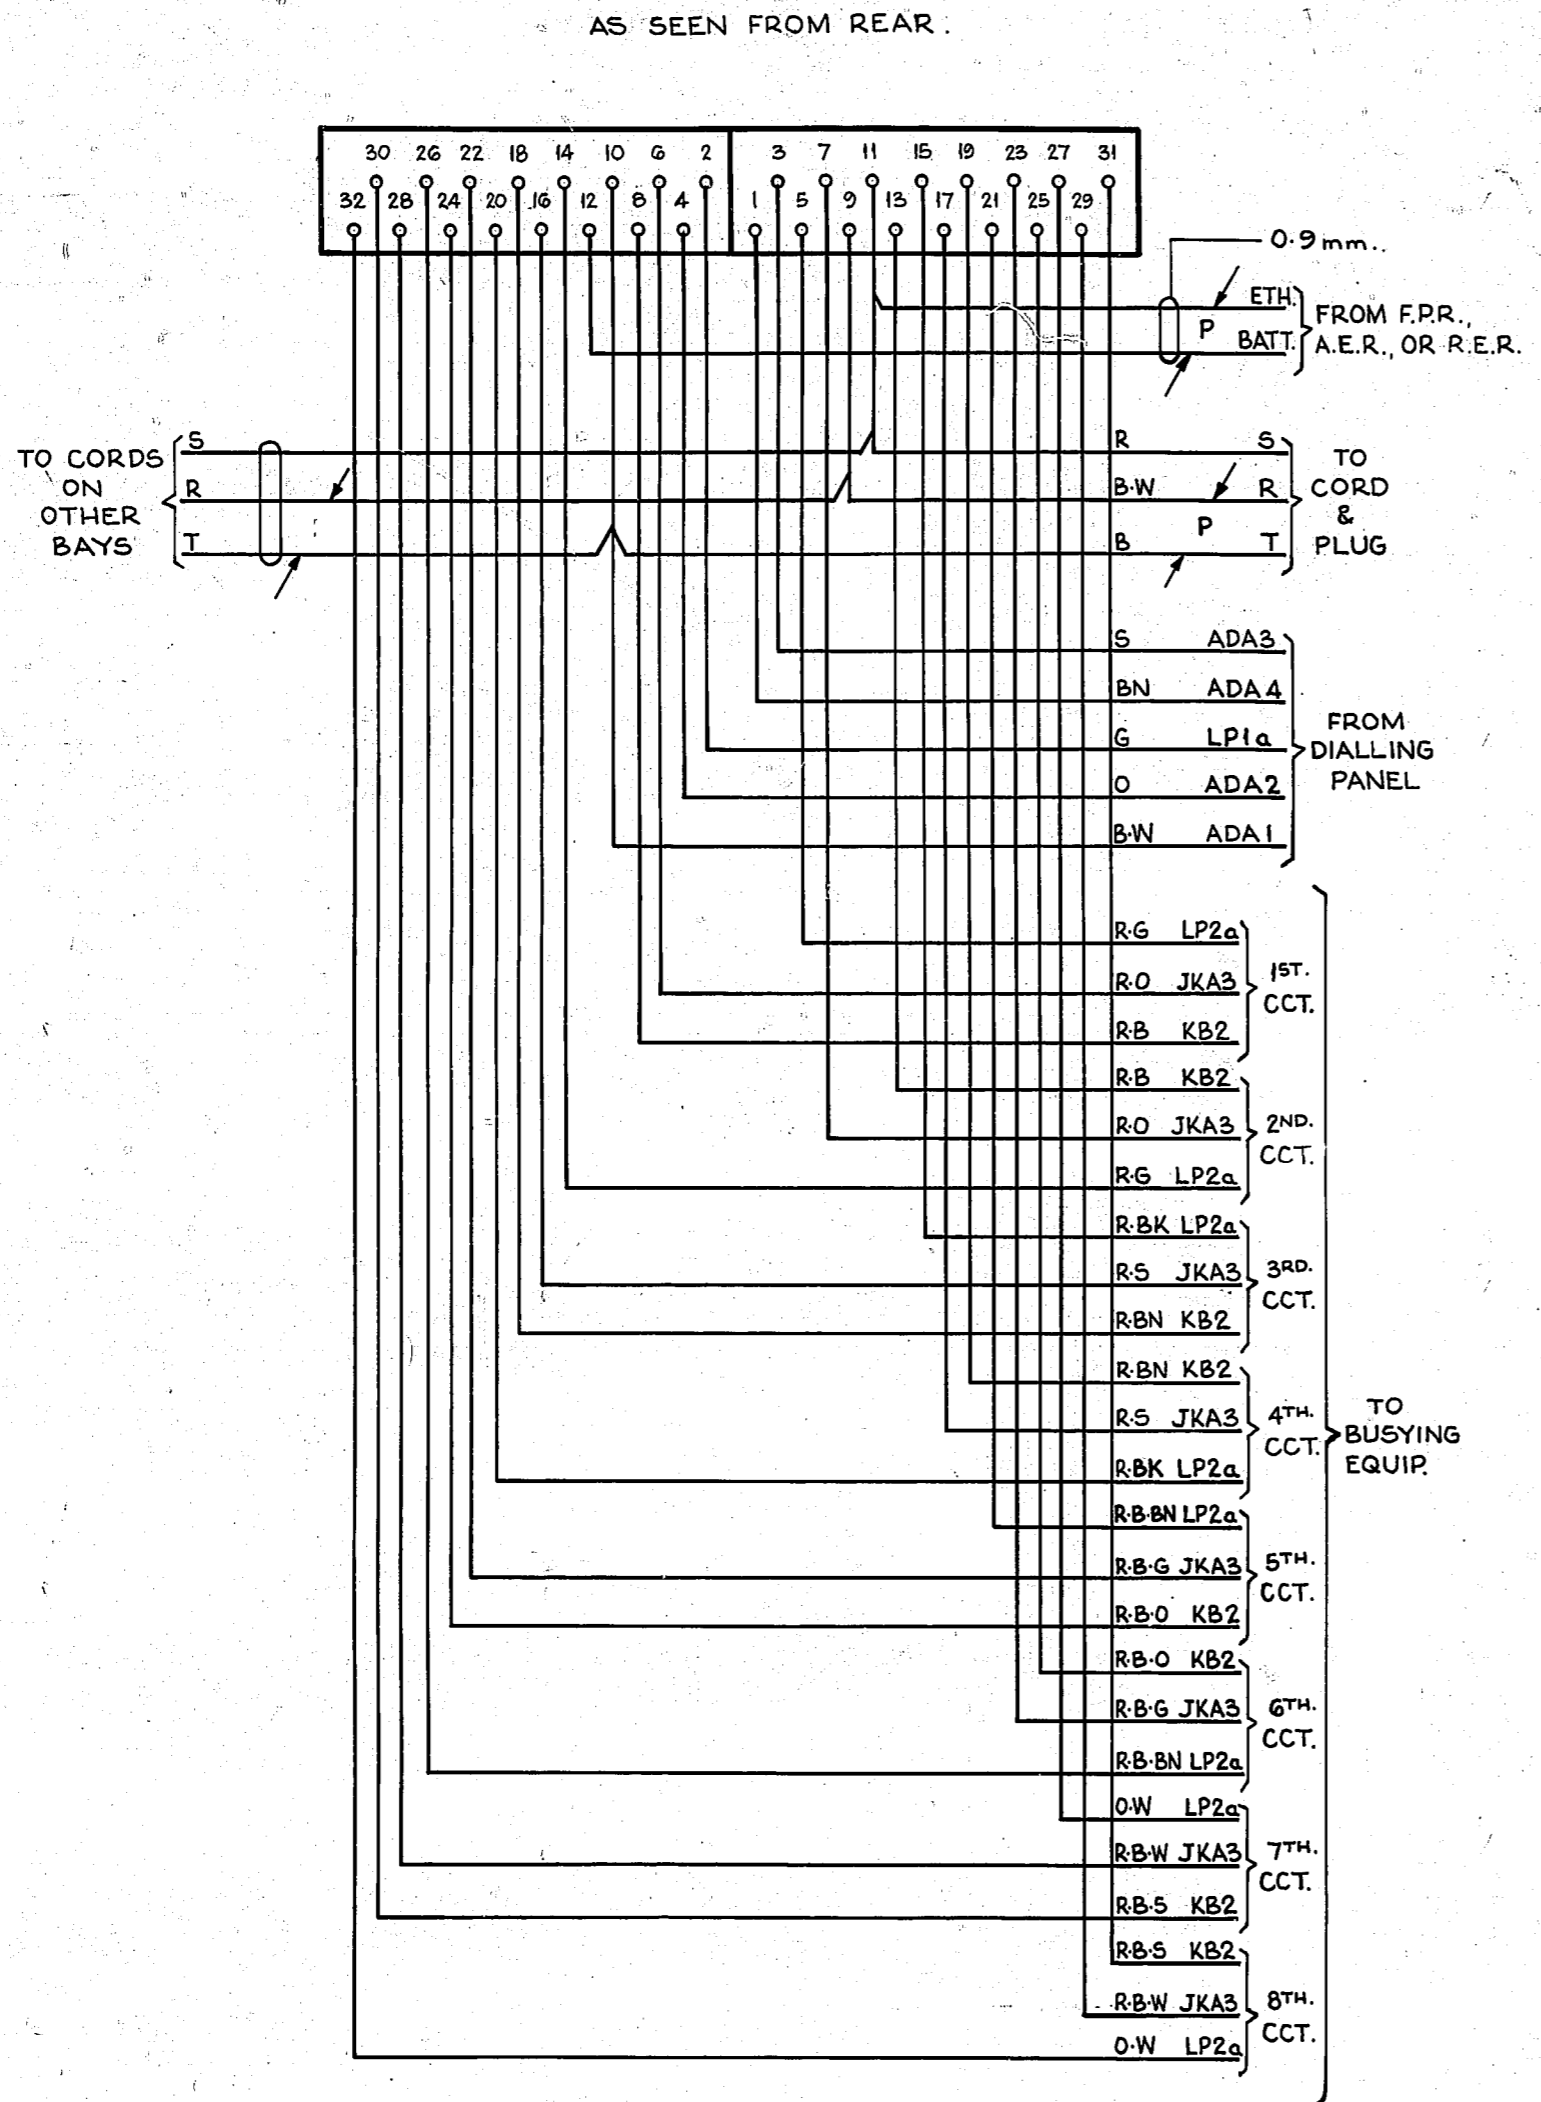


FIG. 4.

BUSYING RELAY SET.

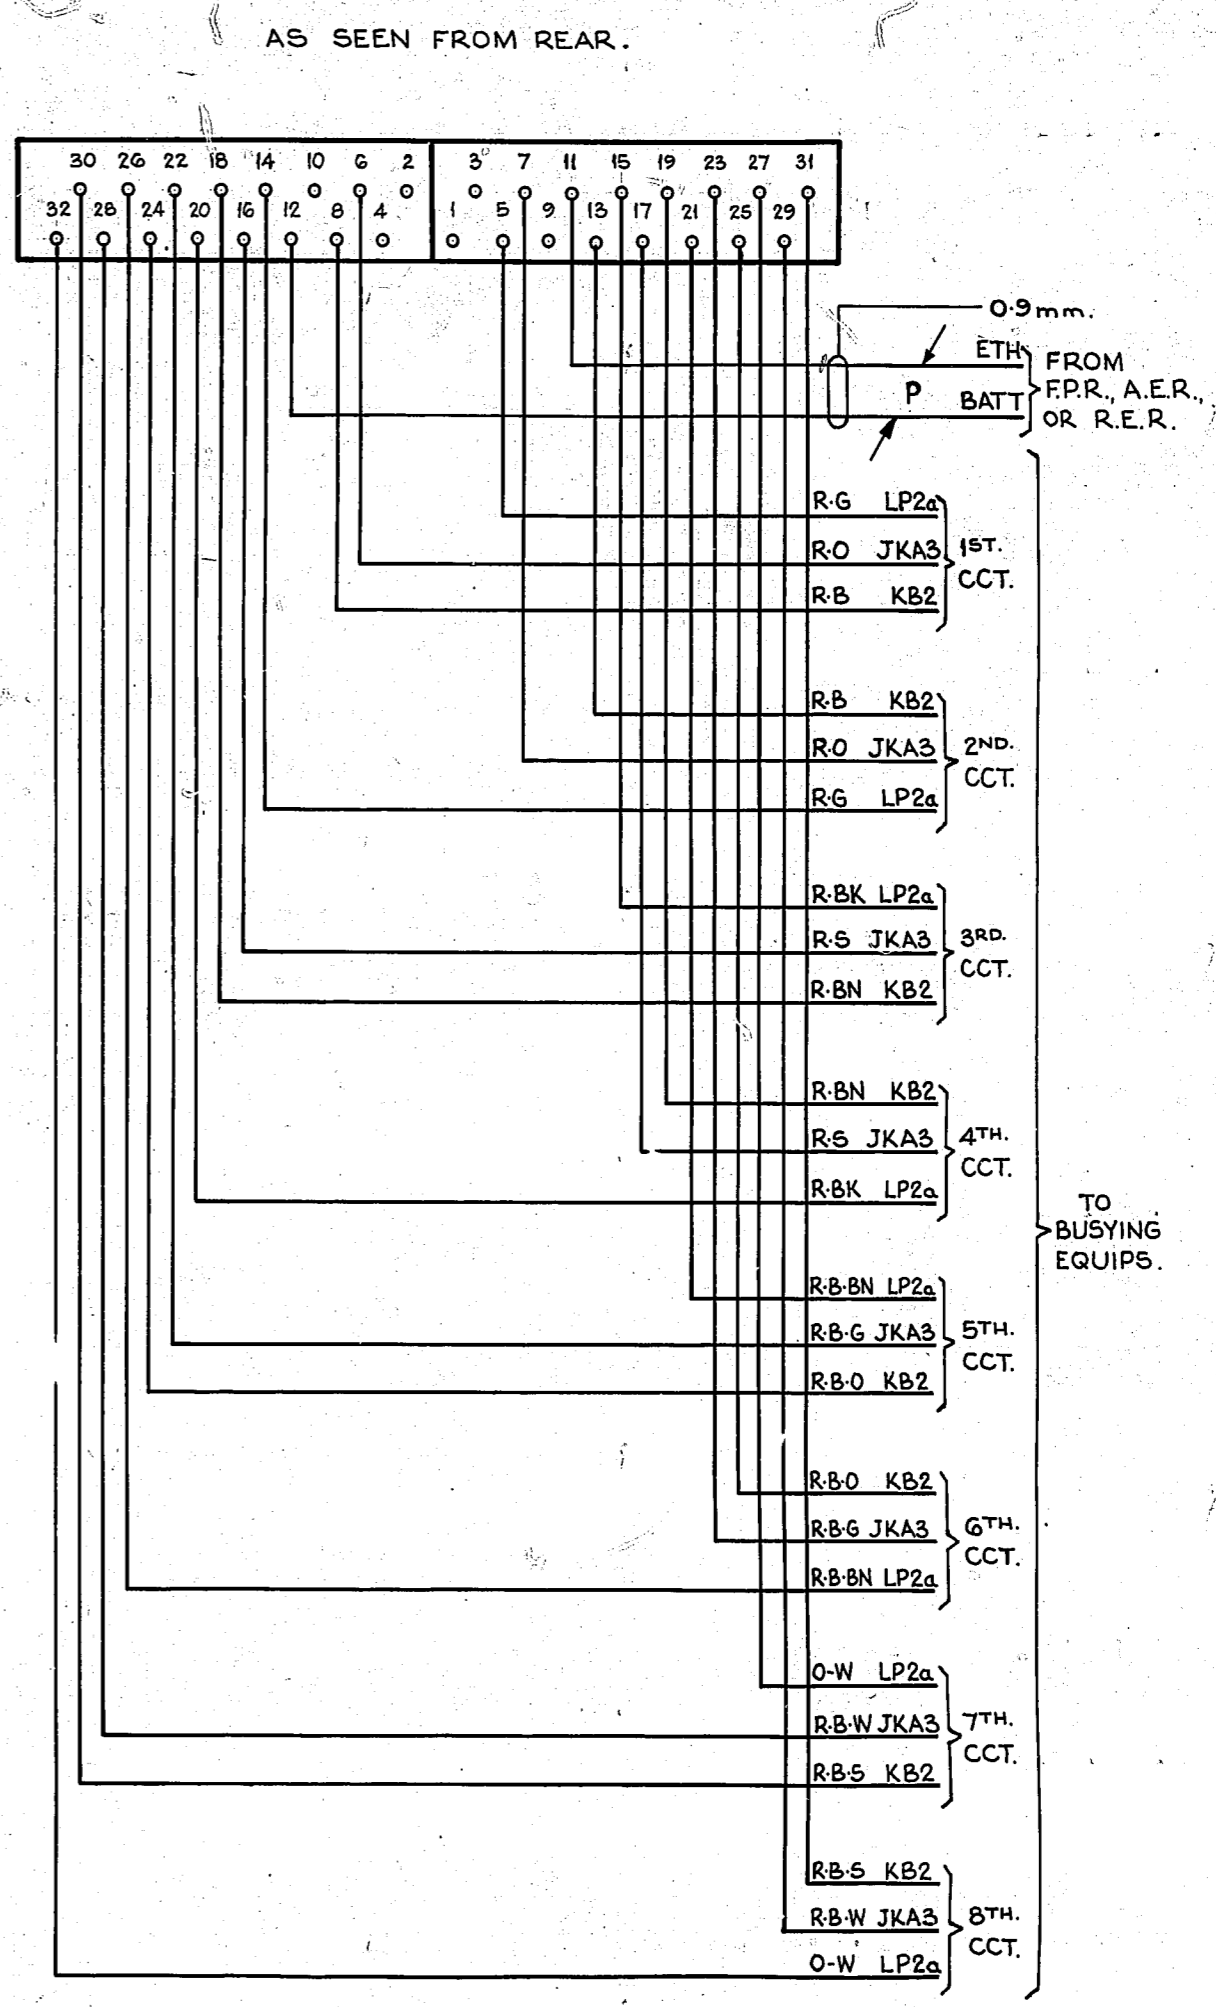

NOTES:-
1. ALL WIRING TO BE 0.5mm. UNLESS OTHERWISE SPECIFIED.

REDRAWN & METRICATED (157655)				2A	12.6.78	R&D	OUTGOING JUNCTION BUSYING CIRCUIT T.J.F OR TEST RACK AND T.J.F DIALLING PANEL.	
(69204)				1	20.9.63	DBH		
AMENDMENT PARTICULARS				ISS.	DATE	APP.	REF.	50% H.
N.Z.P.O.	SIZE	A2	40	DRAWN	CHECKED	WIRING	CIRCUIT	GBU 50 15740
				W.J.C.	K.B.	K.B.		55

