
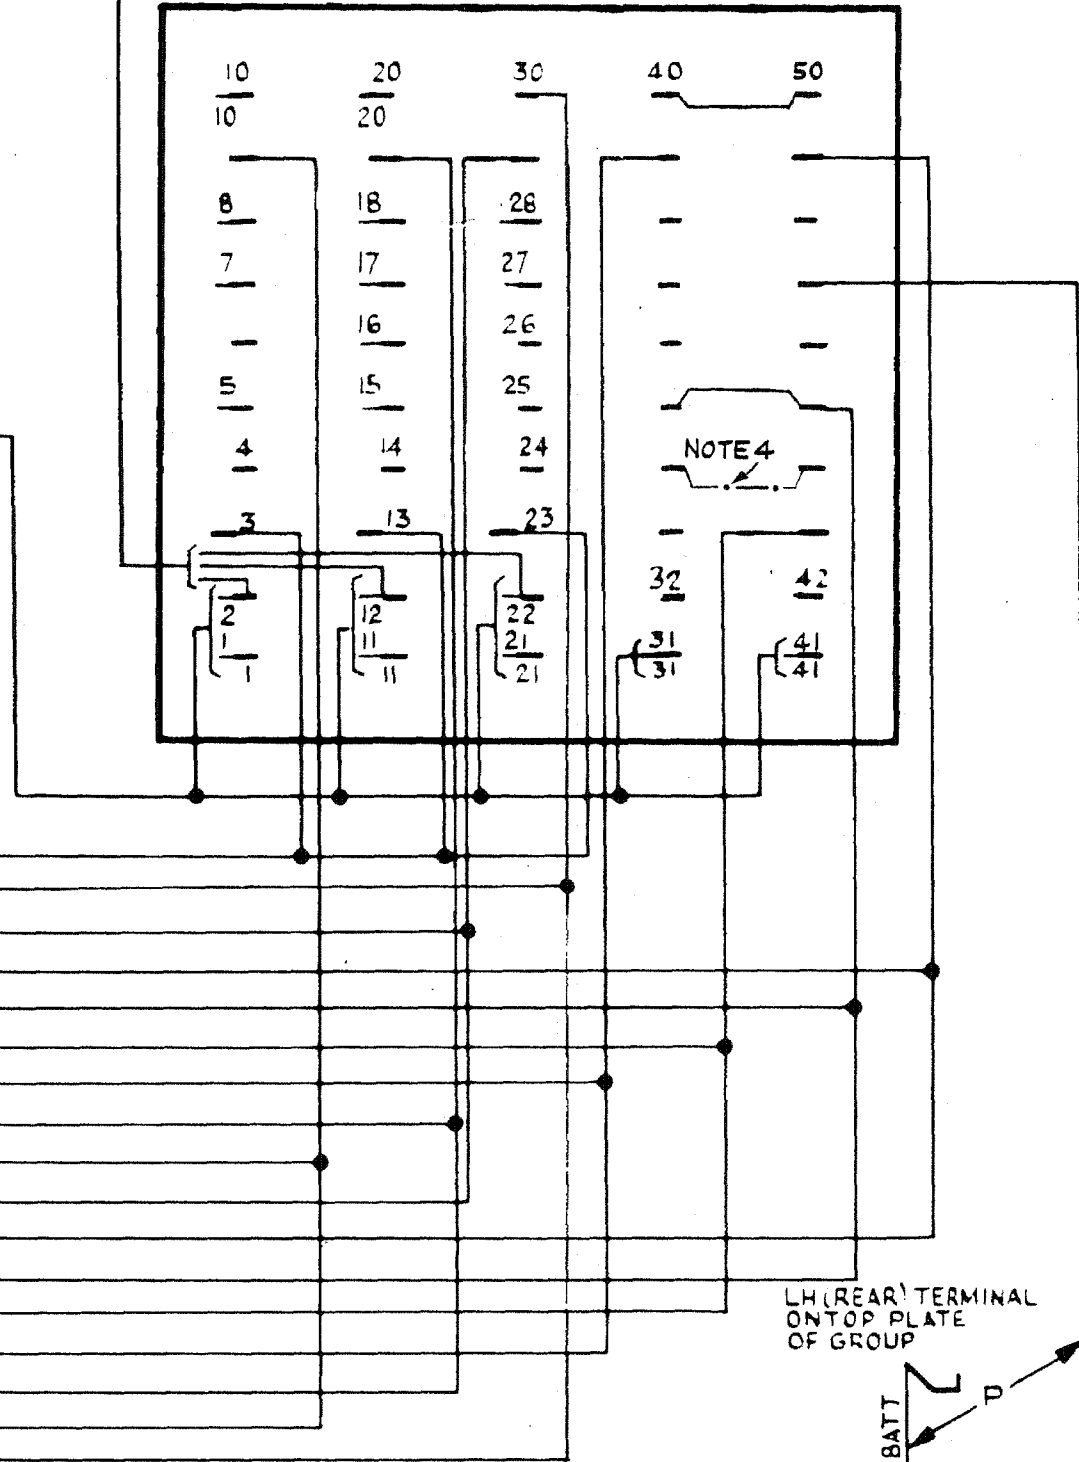
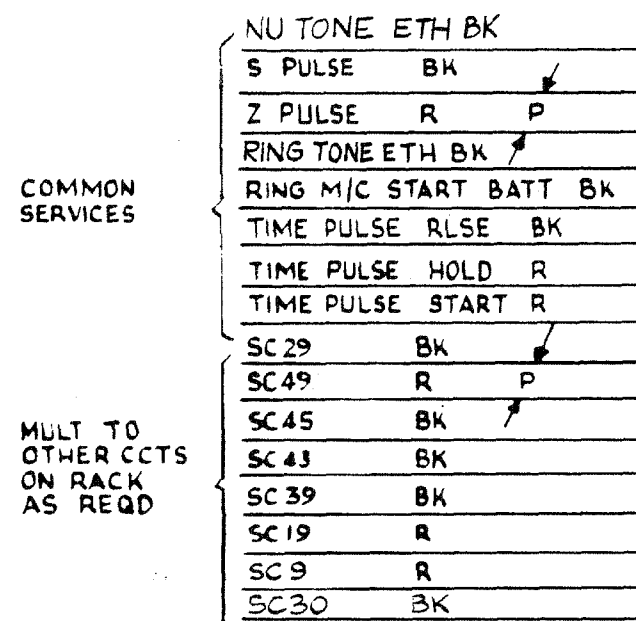
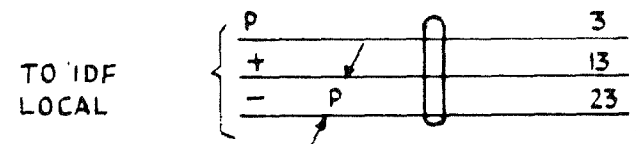
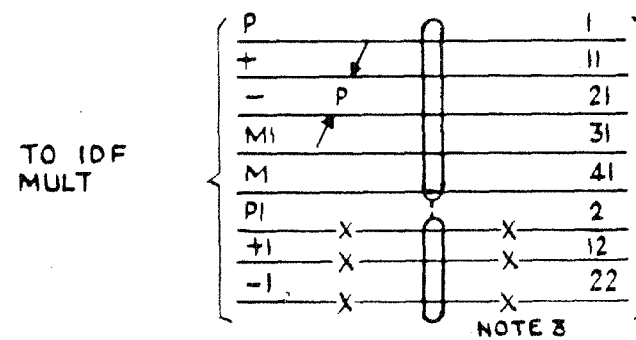


NOTES:-

1. ALL WIRING TO BE 22 SWG UNLESS OTHERWISE SPECIFIED
- 2.
3. WHEN GBW 15510 IS PROVIDED USE CABLING SHOWN THUS WHEN GBW 13980 IS PROVIDED USE CABLING SHOWN THUS X X
4. WHEN JUNCTION RESISTANCE EXCEEDS 200 OHMS STRAP SC34 & SC44 SHOWN THUS • • •
5. SC38 & SC48 ARE NOT SPARE AS THEY ARE USED FOR BARRETTER ACCESS
6. SC37 IS NOT SPARE AS IT IS USED FOR MH RELAY

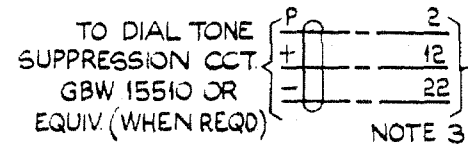

MOD A GIVES DETAILS OF INTERIM MODIFICATIONS (NZ.PD). PENDING FINALISATION WITH THE BCC OF GBW 16671

				U.A.X. N°NZ13			
				OUTGOING JUNCTION			
				TERMINAL U.A.X.			
				TO PARENT EXCHANGE			
				A	7.1.69	SC	
AMENDMENT PARTICULARS				ISSUE	DATE	APPD	REF:- GBW 13930 MOD
GPO APPROVED AS STANDARD							50' H
				DRAWN	CHECKED	WIRING	CIRCUIT
				AH	US	15	
							GBU 16671 MOD A