


AS SEEN FROM REAR

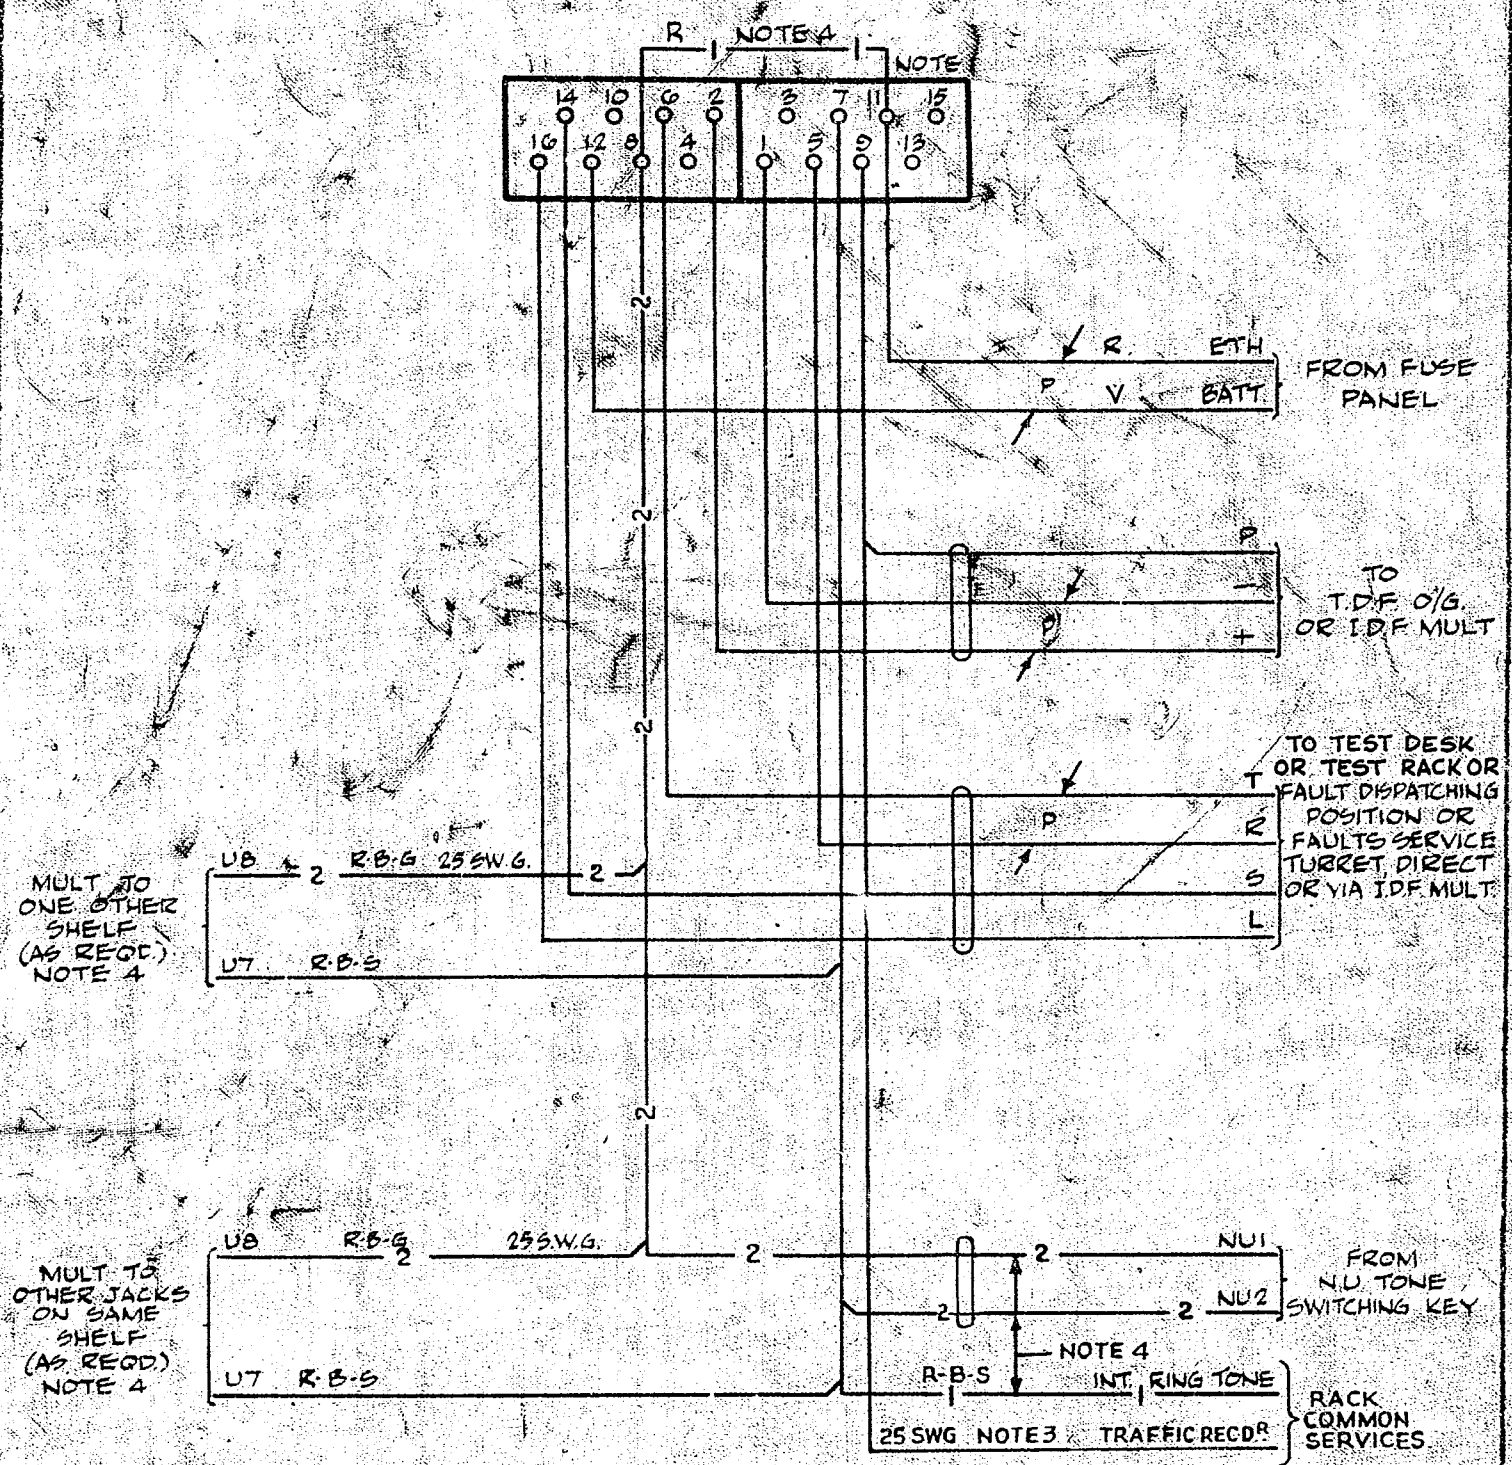

NOTE'S-

1. SHELF JACKPOINTS 9 & 11 TO MAKE CONTACT WHEN RELAY SET IS REMOVED.
2. ALL WIRING NOT OTHERWISE SPECIFIED TO BE 22 SW.G.
3. COLOURS ARE-
SHELVES A&B R.O SHELVES C&D R.G
E&F R.B.N G&H R.S
J&K R.B.W
4. WHEN NUTONE SWITCHING FACILITY IS NOT REQUIRED, OMIT CONNECTIONS SHOWN — 2 — 2 — AND PROVIDE THOSE SHOWN — 1 — 1 —
5. ON SOME EARLY EQUIPMENT BATTERY WIRING IS BK

FAULTSMENS LINES
 TERMINATING ON TEST DESK OR RACK
 OR FAULT DISPATCHING POSITION OR
 EQUIV WITH TONE SWITCHING KEY
 (GEO-THERMAL AREAS)

NOTE 5 & REFS TO TEST RACK ADDED (8002)	2	19.3.71	B.S.H
(58282)	1	10.2.67	R/B.
AMENDMENT PARTICULARS	ISSUE	DATE	APPD

N.Z.P.O. DRAWN CHECKED WIRING CIRCUIT

GBU 19030

5 Centimetres 10

15

20

25

30