


NOTES:-

1. ALL WIRING TO BE 22 SWG UNLESS OTHERWISE SPECIFIED.
2. WHEN DIAL-TONE SUPPRESSION BY MEANS OF GBW 15510 IS PROVIDED, USE CABLING SHOWN -3-3+, OTHERWISE USE CABLING SHOWN -2-2- IF CIRCUIT IS BOTHWAY WORKING.
3. SC38 & SC48 ARE NOT SPARE AS THEY ARE USED FOR BARRETTTER ACCESS.

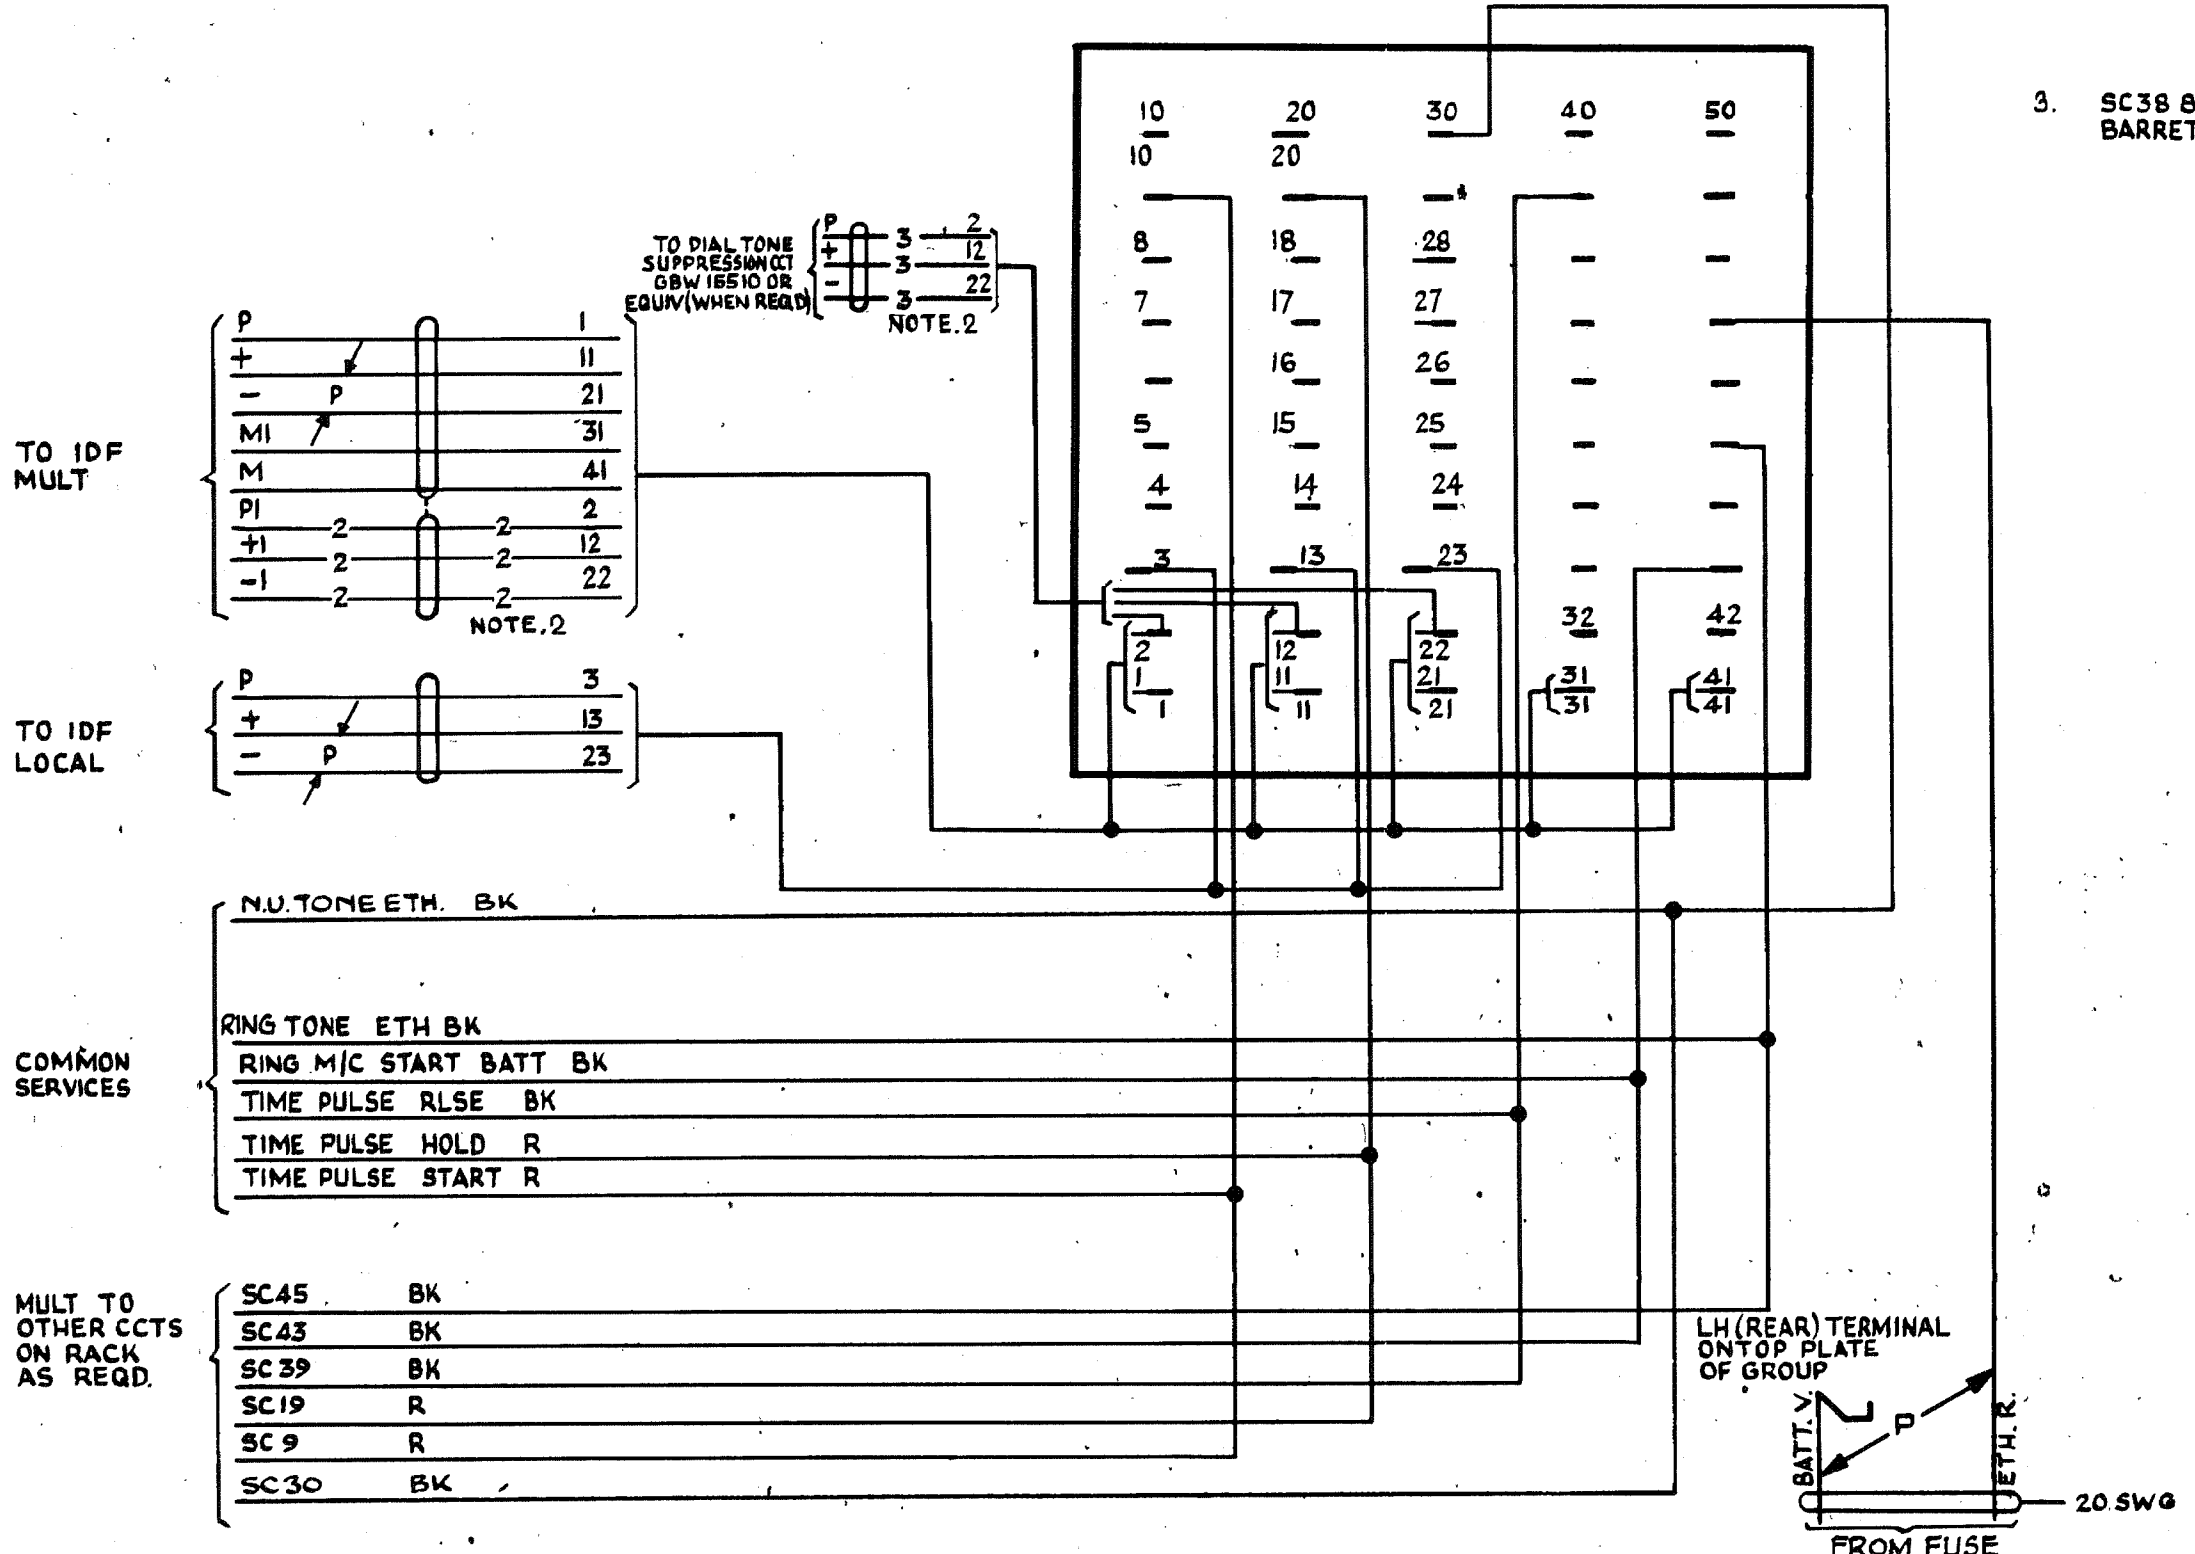

				U.A.X. NZ13 OUTGOING JUNCTION TERMINAL U.A.X. TO PARENT EXCHANGE			
				(20831)	11-11-69	RW	
AMENDMENT PARTICULARS				ISSUE	DATE	APP	REF.: GBU16671
				50V H			
				GBU20100			
NZ.P.O.				DRAWN D.J.T.	CHECKED e.j.c.	WIRING	CIRCUIT