

FIG. 1A M.D.F


(FOR EXPLANATORY PURPOSES ONLY ϕ)

FIG. 2 CONTROLLED EXCHANGE. (M.A.R.)

MAINTENANCE CONTROL EXCHANGE.

FIG. 3A M.A.R.

FIG. 3B TEST DESK

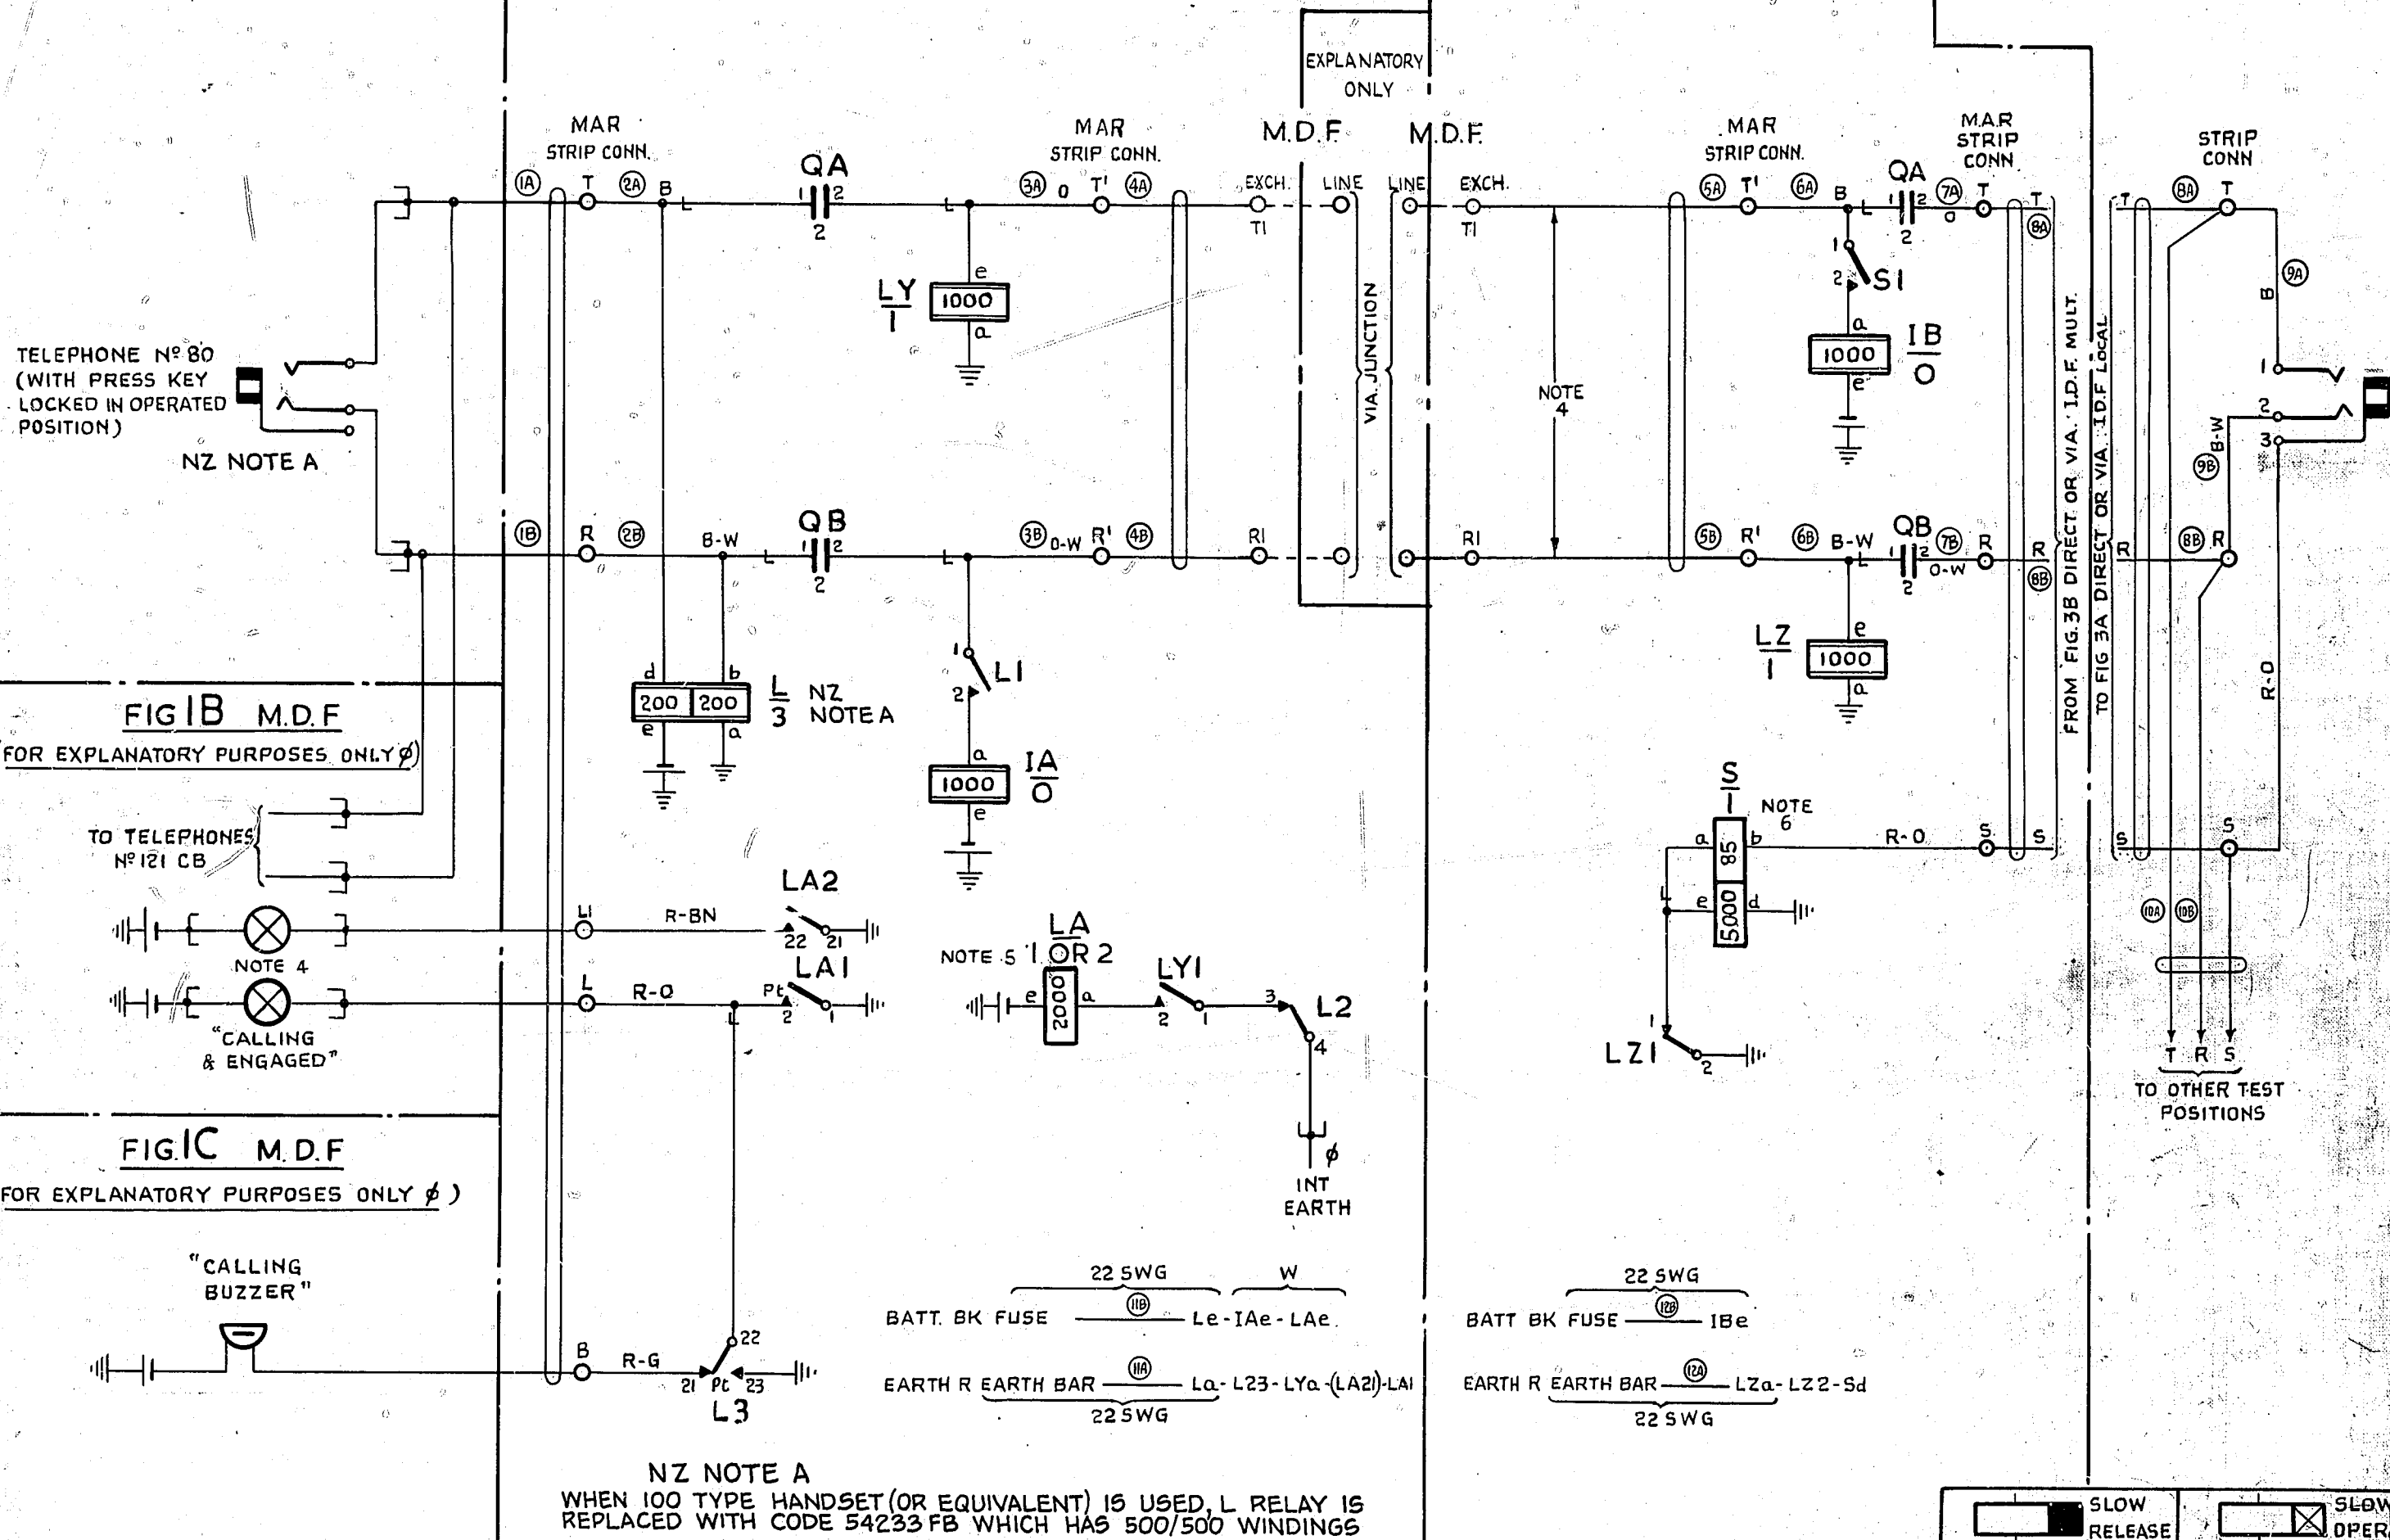

- NOTES :-
- FUSING: FIG. 2 1.5A PER CIRCUIT
FIG. 3A 1.5A PER CIRCUIT
 - ϕ FOR WIRING IN FIGS 1A, 1B, 1C, SEE GBW.10870 OR EQUIV. FOR WIRING IN FIG. 2 SEE GBW 10690 OR EQUIV.
 - ALL WIRING UNLESS OTHERWISE STATED TO BE 25 SWG.
 - AT SOME EARLY EXCHANGES THE CONNECTIONS BETWEEN FIG. 3A AND THE M.D.F. ARE ROUTED, VIA THE I.D.F.
 - MAX. NO. OF LAMPS PER CONTACT MUST NOT EXCEED 2. CONTACT LA2 & TERM'L LI ARE ONLY PROVIDED WHEN MORE THAN 2 LAMPS ARE REQUIRED.

NZ NOTE A ADDED	(55988)	5A	10.9.76	C.J.W
FIG. 4. DELETED. NOTE 4 & RELAY'S CHANGED. NOTE 6 ADDED.		5	23.10.64	JX
JUNCTION EXPLANATORY FIG. REVISED. (66512) (89980)		4	13.3.63	D.B.H.
REFERENCES TO M.D.F ADDED IN FIGS 3A & 3B		3		
FIG. 4, NOTES 3 & 4 & REFERENCES ADDED		2		
		1		
AMENDMENT PARTICULARS		ISSUE	DATE	APPD
N.Z.P.O.		IND	DRAWN	CHECKED
				WIRING
				CIRCUIT

TEST DESK
SPEAKER CIRCUIT
TO REMOTE EXCHANGES.

SIZE S 50V E

GBW 10620

SLOW RELEASE
 SLOW OPERATE