


FIG. 1A
FIG. 1B

NOTE 4

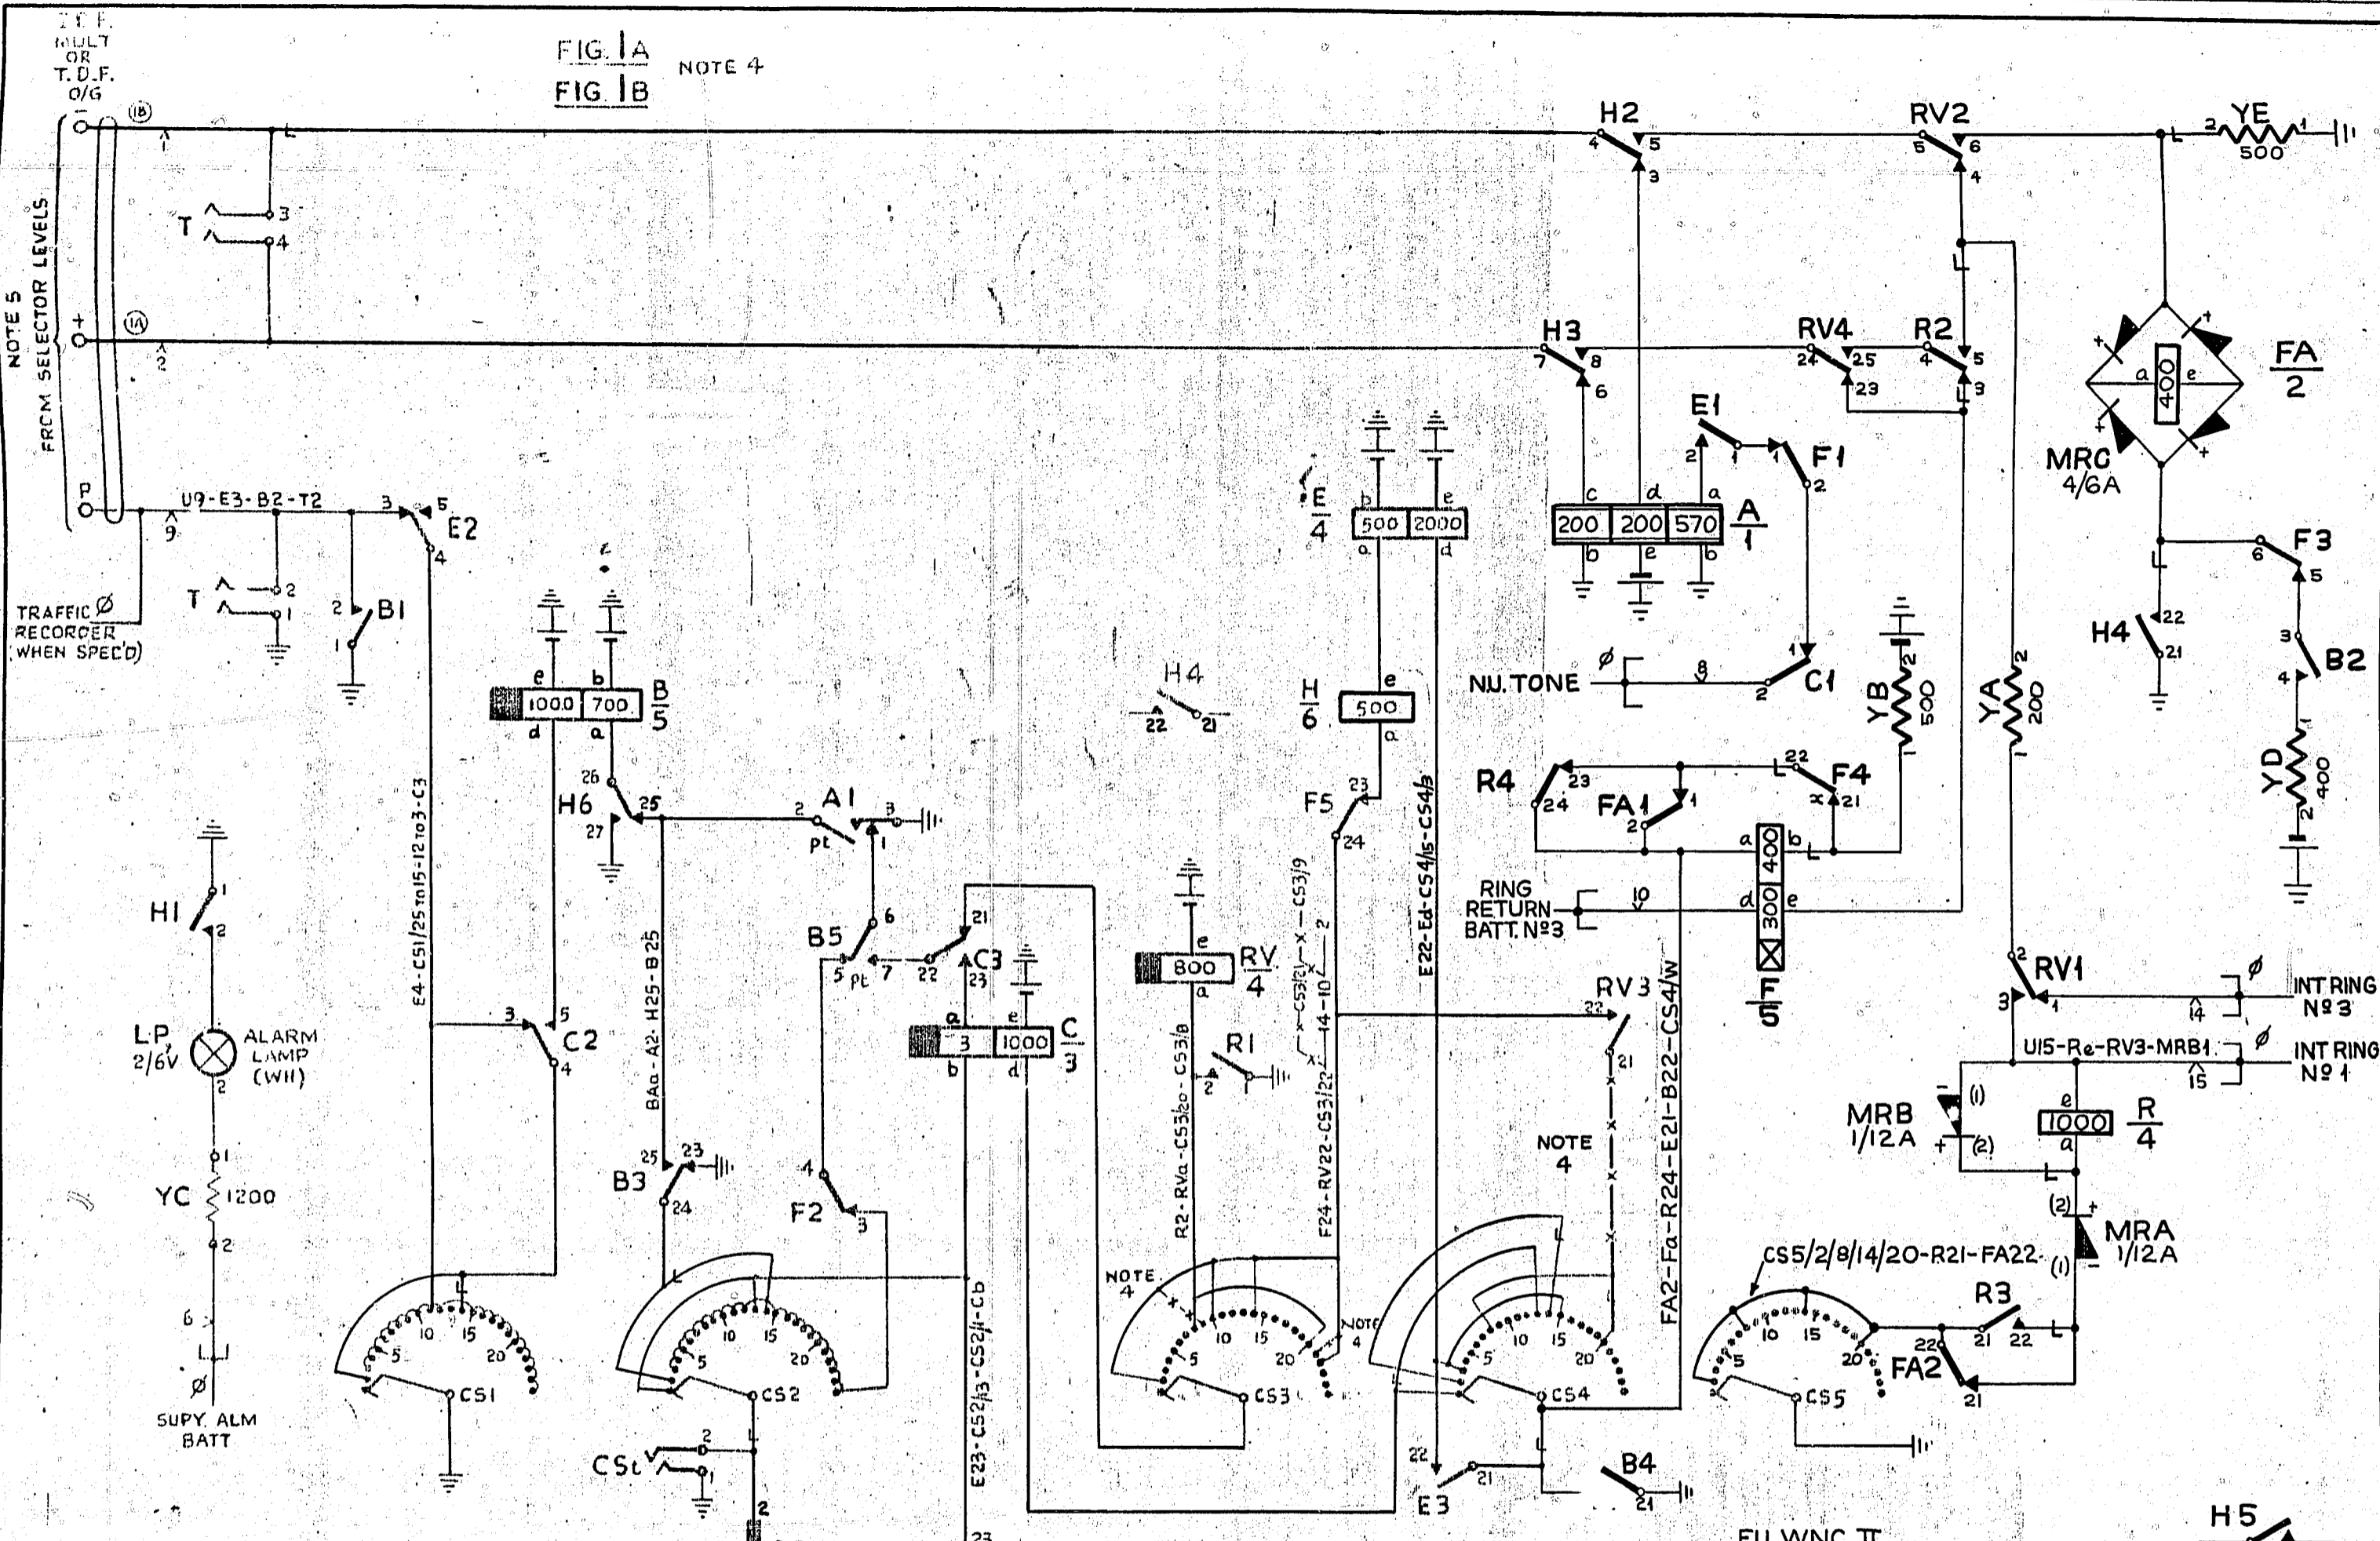

- NOTES**
1. FUSING - 1.5A PER CIRCUIT
 2. U9 & U11 TO MAKE CONTACT WHEN RELAY SET IS REMOVED.
 3. Ø FOR WIRING SEE LBW 10640 OR EQUIV.
 4. FOR EXCHANGES WITH DIGITS 2 FOR ORDINARY, 3 FOR X PARTY, 4 FOR Y PARTY RING BACK SPECIFY FIG 1A AND ADD CONNECTIONS SHOWN THUS —X—X— FOR EXCHS. WITH DIGIT 2 FOR ORDINARY AND X&Y SHARED SERVICE RING BACK SPECIFY FIG 1B AND OMIT CONNECTIONS SHOWN THUS —X—X—
 5. WHEN FULL AVAILABILITY FROM SELECTOR LEVELS IS SPECIFIED I/C LEADS ARE CABLED DIRECT FROM SELECTOR STRIP CONN. & NOT VIA I.D.F. OR T.D.F.

BATT (W) U12-BAe-Ae-Eb-Ec-RVe-YD2-CSdme-Ce-Cb-Be-YB2
 EARTH (R) U11-Ab-A3—H27-H4-HI-YE1-CSt1-CS1/W-CS5/W-QA4-B21-B23-BI-T1

YD2 SHOWN CONNTD. TO EARTH. HS NOT SHOWN SPR. (69399)	C	1.11.63	D.B.H.
NZPO DIGIT REFS DELETED. (33777)	B	21.8.59	J.N.
(32425)	A	29.6.59	J.N.
TRAFFIC RECORDER LEAD ADDED.	B	26.7.57	A.H.S.
I.D.F. TERMINATION. NOTE 5.3 RESISTOR YD ADDED.		11.7.55	C.W.H.
CONNECTION TO CS3/21 MADE ALTERNATIVE	6	12.12.52	C.W.H.
FIG NO. NOTE 4. REFERENCES ADDED.	5	20.10.52	C.W.H.
SUPERVISORY ALARM CRY. MODIFIED.	4	19.3.51	W.H.S.
RELAY B. ADDED.	3	20.1.50	
CONNECTION TO CS5/W ADDED.	2	16.5.49	
	1	28.3.49	W.H.S.

AMENDMENT PARTICULARS



REVERTIVE
RINGING RELAY SET.

REF: GEC DRG S8686 SIZE S 50V E

GBW10730 MOD A

NZ.P.O.					
DRAWN	M.H.	CHECKED	J.H.	BY	W.H.S.