


Centimetres

0 5 10 15 20

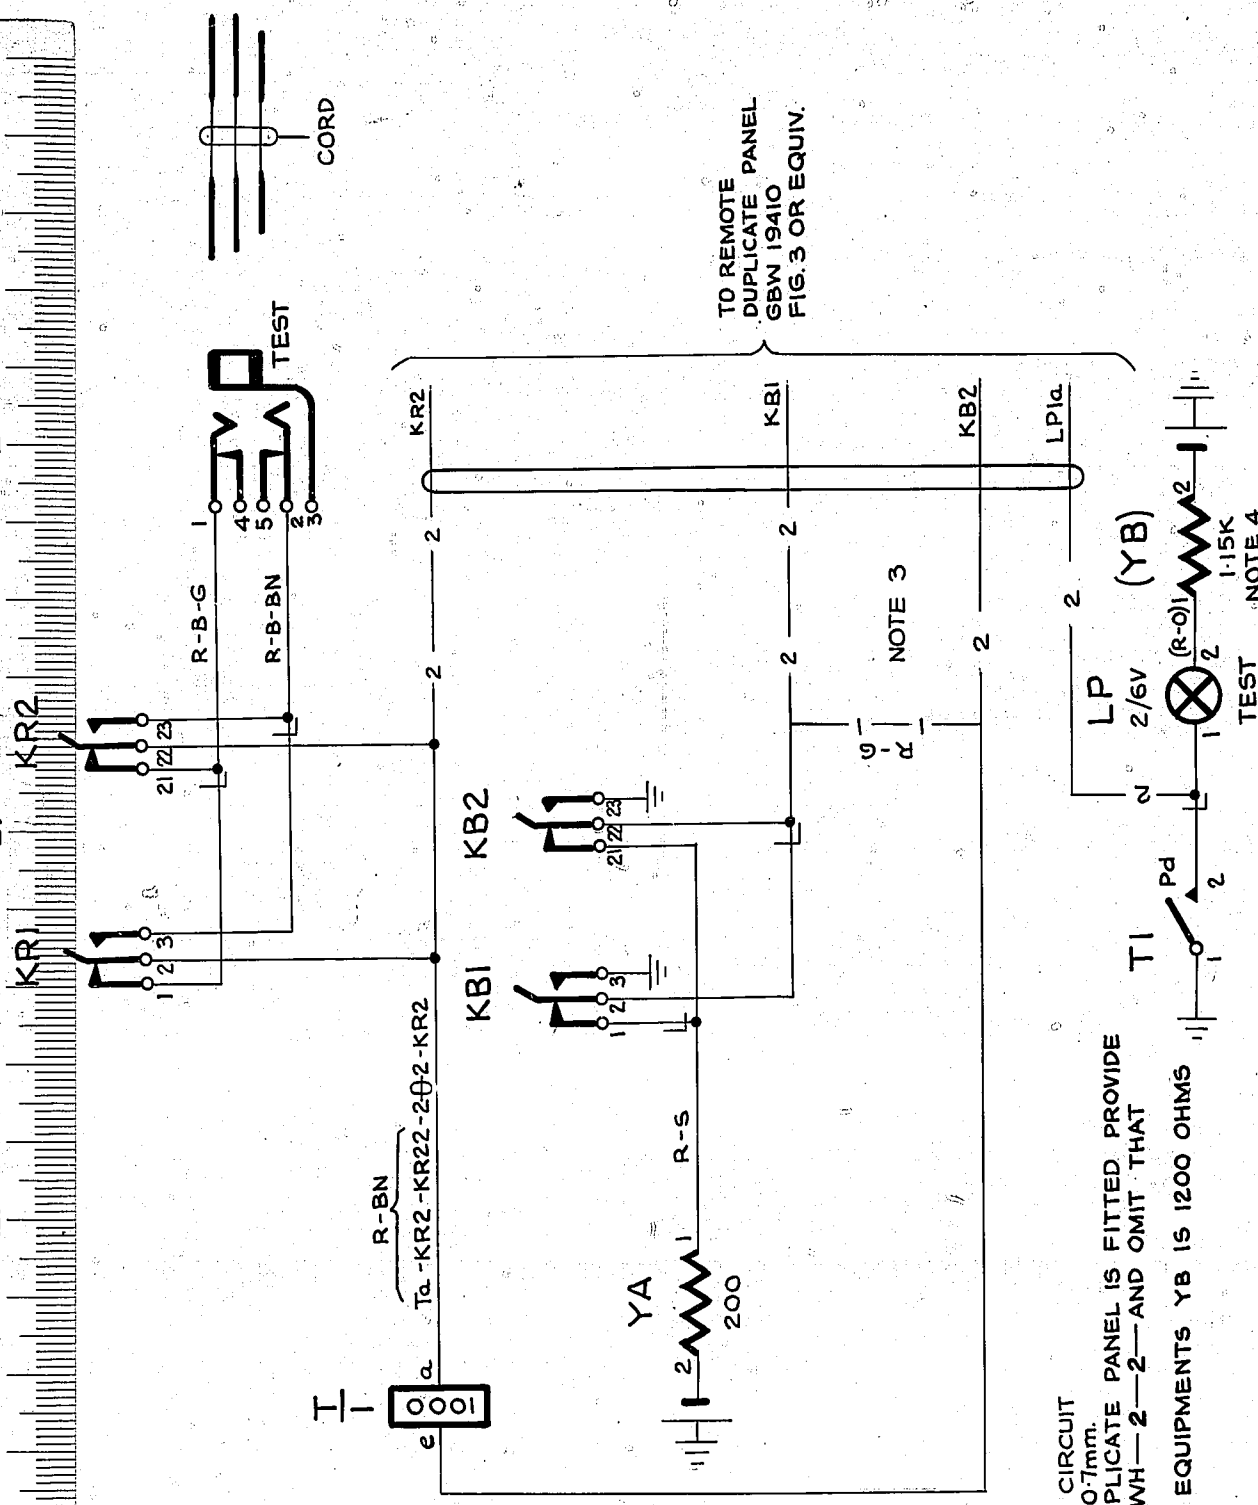

TO REMOTE
DUPLICATE PANEL
GBW 19410
FIG. 3 OR EQUIV.

NOTES

1. FUSING 1.5A PER CIRCUIT
2. ALL WIRING TO BE 0.7mm.
3. WHEN REMOTE DUPLICATE PANEL IS FITTED PROVIDE CONNECTIONS SHOWN—2-2—AND OMIT THAT SHOWN—1-1—
4. ON SOME EARLY EQUIPMENTS YB IS 1200 OHMS

BATT BK FUSE—YA2—YB2

EARTH R ETH BAR—T1—KB3—KB23

TEST CIRCUIT FOR PULSE DISTRIBUTION
A.E.R.

RETRACED & METRICATED (157686)	2A	16-8-78	RED
UPDRAWN. NOTE 3 & CONNS TO GBW 15410 APP. (53411)	2	2-7-66	

AMENDMENT	PARTICULARS	ISS	DATE	APP.
-----------	-------------	-----	------	------

SIZE A4 50V E

N.Z.P.O.	DRAWN	CHECKED	WIRING	CIRCUIT
----------	-------	---------	--------	---------

GBW 10940

TEST BATTERY(KB)	2
TEST DISTRIBUTION(KR)	2