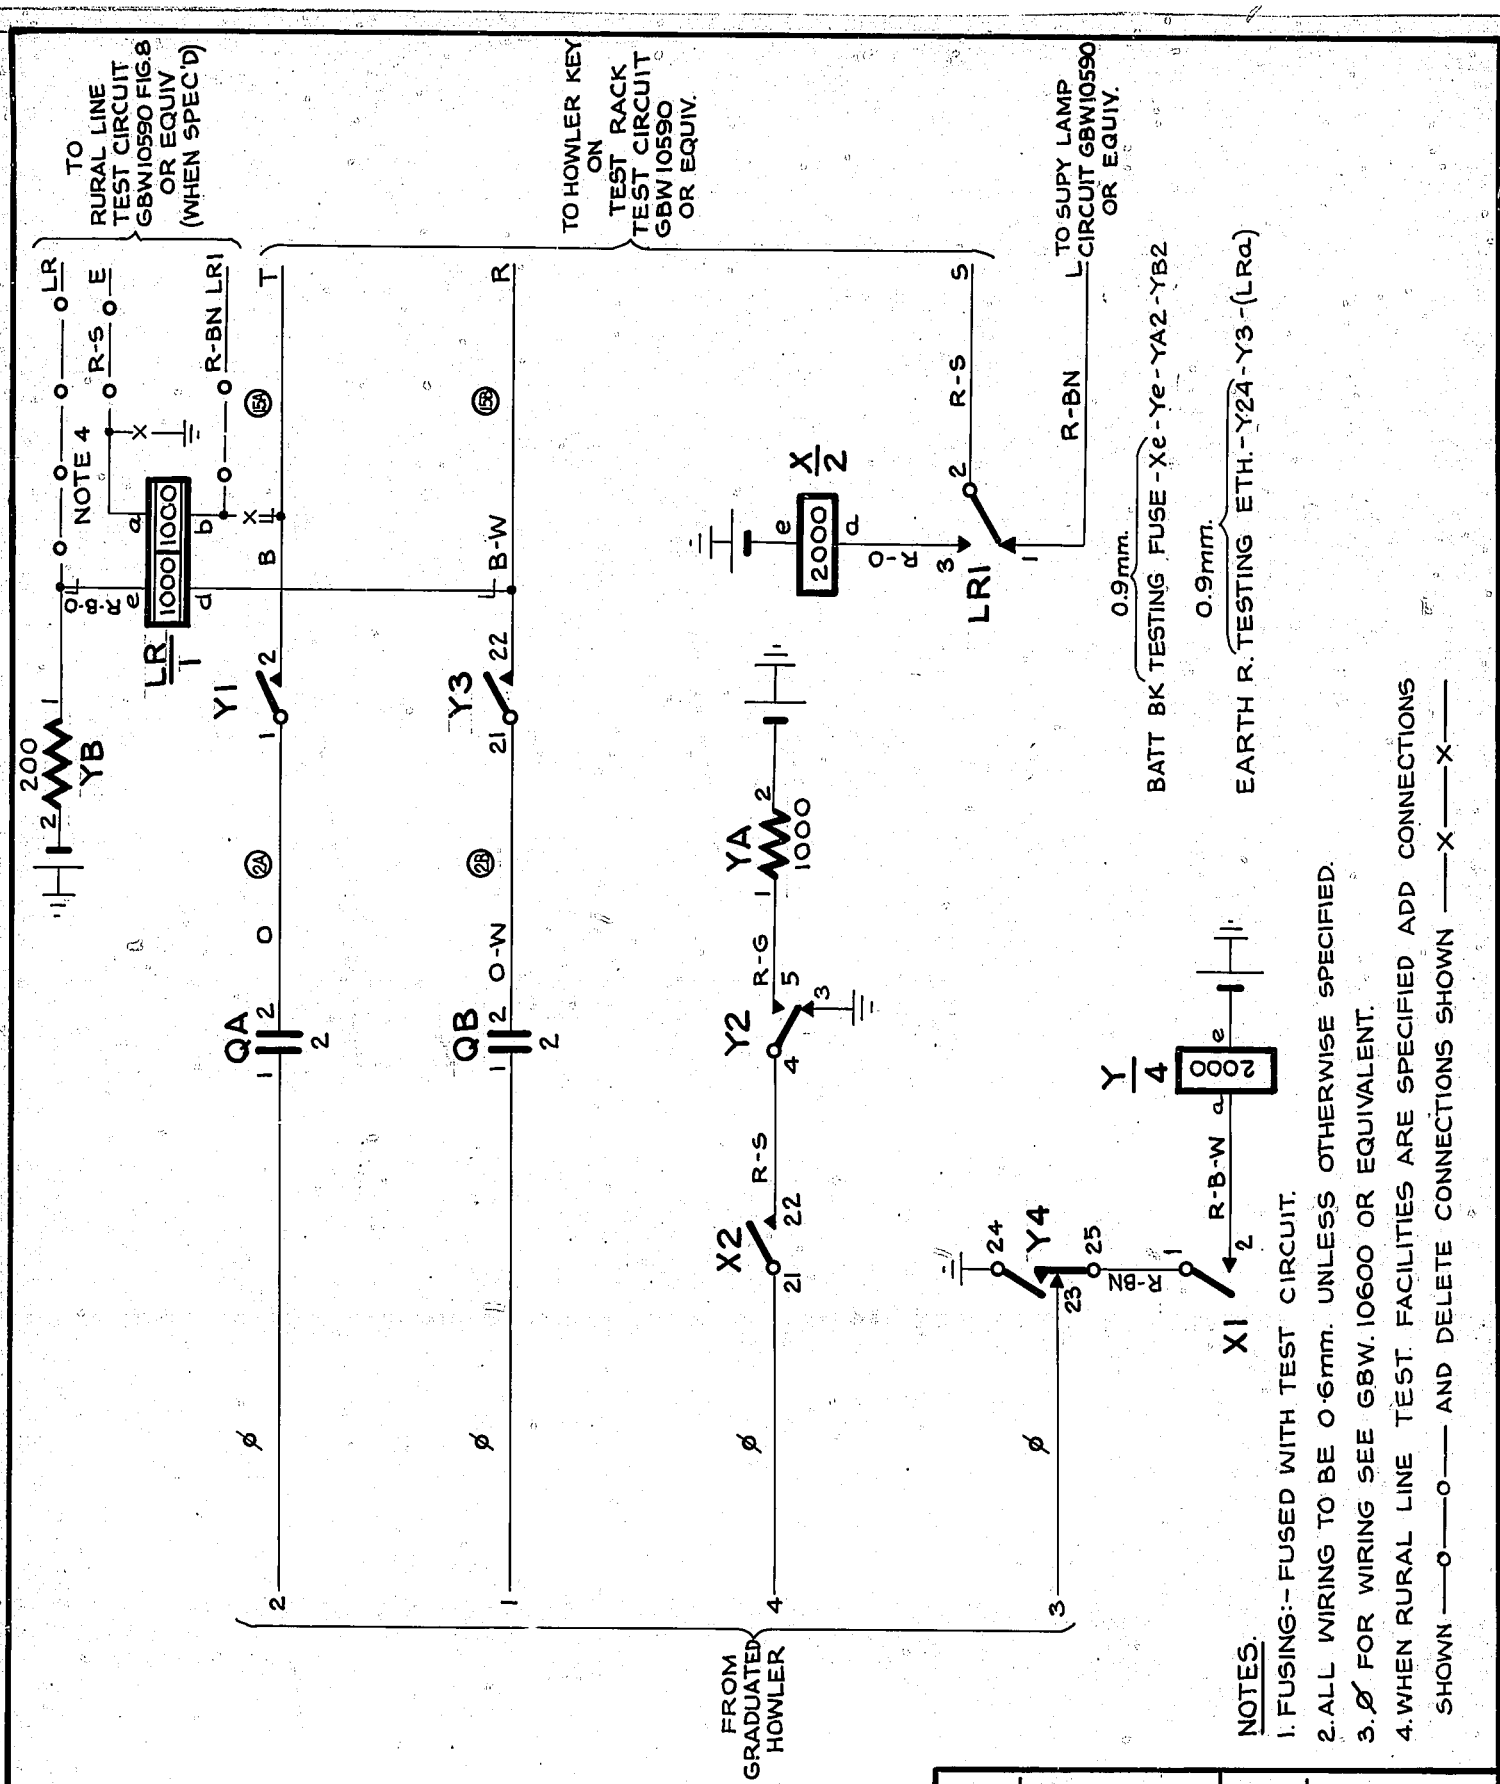

NOTES.

1. FUSING:- FUSED WITH TEST CIRCUIT.
2. ALL WIRING TO BE 0·6mm. UNLESS OTHERWISE SPECIFIED.
3. Ø FOR WIRING SEE GBW. 10600 OR EQUIVALENT.
4. WHEN RURAL LINE TEST FACILITIES ARE SPECIFIED ADD CONNECTIONS SHOWN —o—o— AND DELETE CONNECTIONS SHOWN —X—X—

SUPERSEDED BY GBW 10821 FIG. 3B.

SLOW RELEASE | SLOW OPERATE

AMENDMENT PARTICULARS		ISS.	DATE	APP
RETRACED & METRICATED	(157687)	3A	15·8·78	R.E.D
LR RELAY, NOTE 4 & SUPER' NOTE ADD	(35084)	3	14·11·60	D.B.H
DESIGNATIONS ADDED ON HOWLER LEADS	(72623)	2		
		1		

TEST RACKS
HOWLER ACCESS EQUIPMENT FOR TEST CIRCUIT

SIZE A4 | 50V | E

NZPO | DRAWN | CHECKED | WIRING | CIRCUIT

GBW 10960

Centimetres