



T.D.F. O/G
I.D.F. LOCAL
OR I.D.F. MULT

FROM TOLL GROUP SELECTOR LEVELS

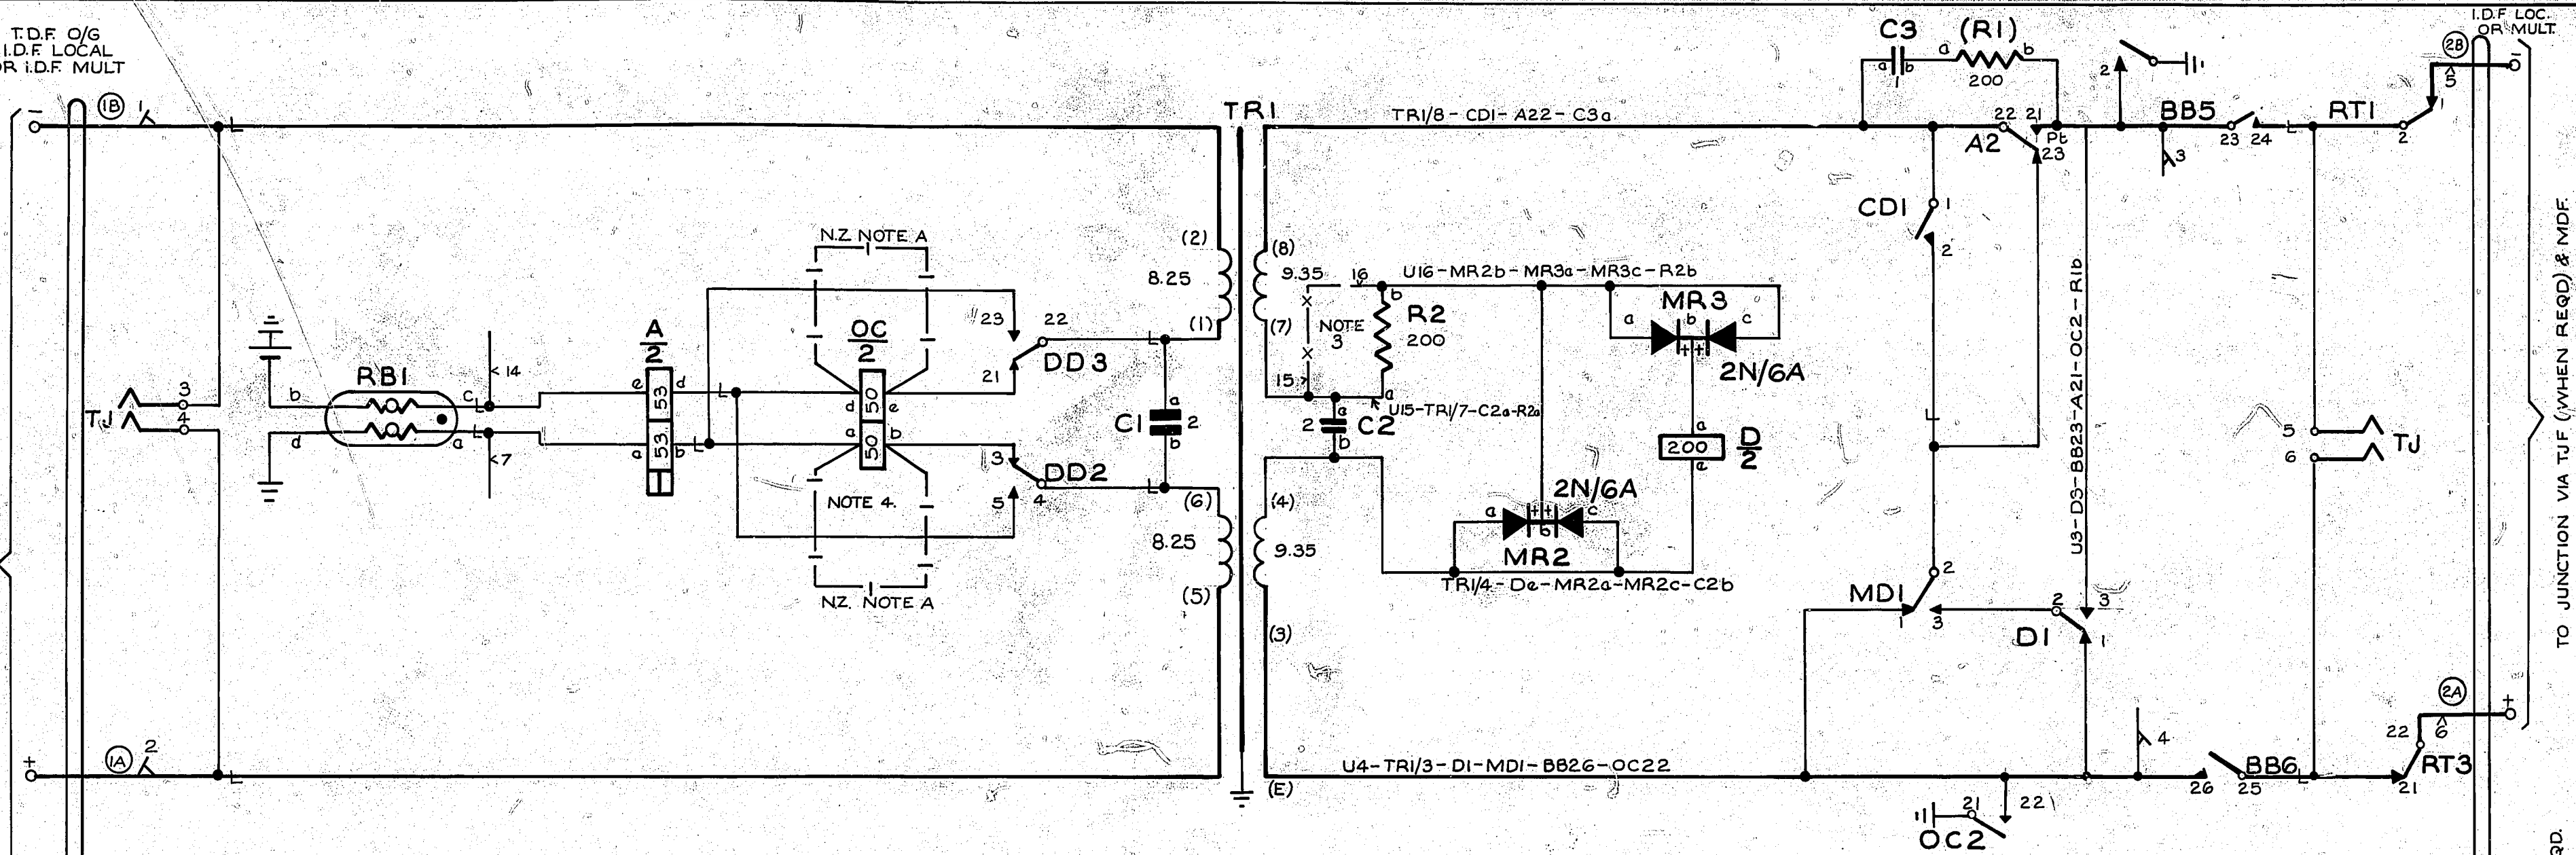

TO JUNCTION VIA T.J.F. (WHEN REQD) & M.D.F.
TO GROUP SELECTOR OR TO O/G JUNCTION RELAY SET
TO T.J.F. WHEN REQD.

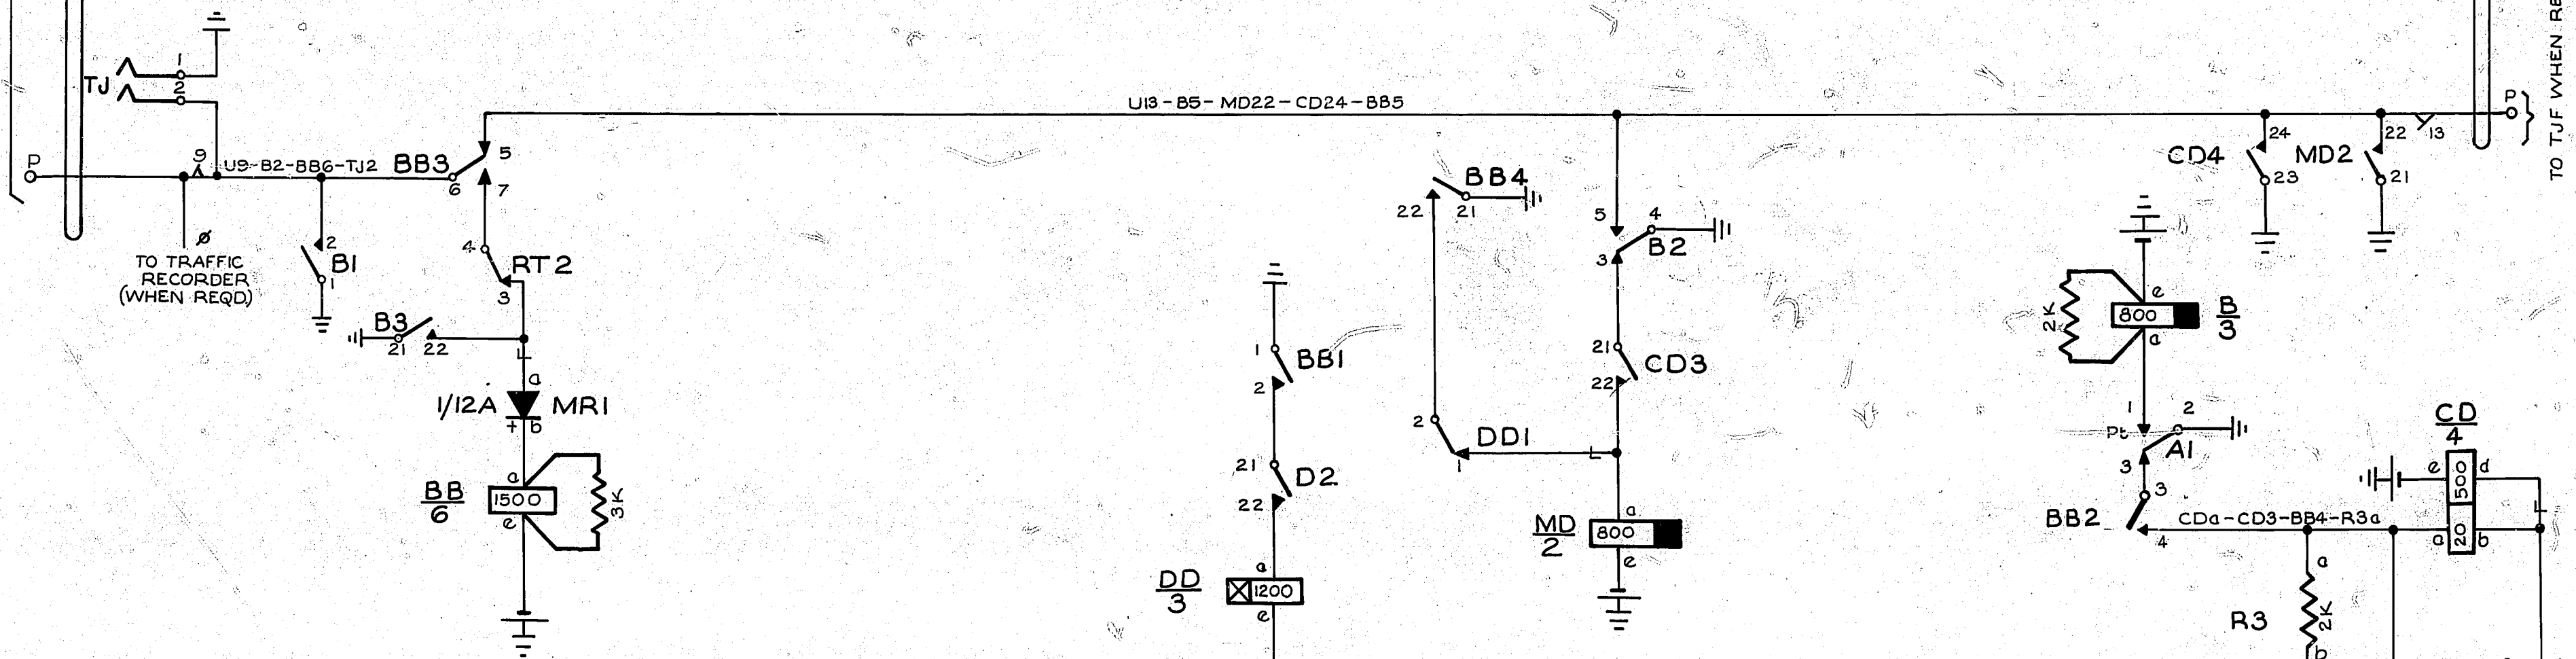

N.Z. NOTES:
A- AT NEW PLYMOUTH THIS EQUIPMENT IS USED AS A REPLACEMENT FOR GBW 12130 ON SUBSCRIBER DIALLING ROUTES. WIRING SHOWN IS TO BE ADDED TO DISABLE THE TRUNK OFFERING FACILITY.

- NOTES.
1. FUSING 1.5 A PER CCT.
 2. SHELF JACK U POINTS 9&11 MAKE CONTACT WHEN RELAY SET IS REMOVED.
 3. WHEN JUNCTION RESISTANCE IS LESS THAN 200Ω REMOVE STRAP BETWEEN UPTS. 15 & 16.
 4. WINDINGS OF RELAY OC ARE CONNECTED DIFFERENTIALLY.
 5. Ø FOR WIRING SEE RACK COMMON SERVICES DIAGRAM GBW 10640 OR EQUIVALENT.

BATT. BK. 0.7mm. FUSE U12
ETH. R. 0.7mm. ETH BAR U11
BATT. W. U12-Bc-MDe-RTe-DDe-CDe-BBe
RBIb-R3b.
EARTH-R.U11-TR/E-B21-B1-B4-MD21-CD23-BB21
BB1-A2-OC21-OCI-RBIId-TJ1.

PROOF

| | | | |
|--------------------------------------------|---------|--------------------------------------------------|----------|
| <input type="checkbox"/> SLOW RELEASE | | <input checked="" type="checkbox"/> SLOW OPERATE | |
| SUPERSEDED BY GBW 16440 | | | |
| RETRACED | (17008) | GB | 13.12.79 |
| N.Z. NOTE A ADDED | (94675) | GA | 20.6.86 |
| SUPERSESSION NOTE ADDED | | G | |
| REF. TO TFC.RECDR. & O/G JCN. R.S ADDED | | 5 | |
| OC MOVED. B22 WAS TO MR1b. | | 4 | |
| RELAY H& SUPY ALARM DELETED DD. SIMPLIFIED | | 3 | |
| POSITIVE METERING FACILITY REMOVED | | 2 | |
| AMENDMENT PARTICULARS | | ISSUE | DATE |
| | | APD | |
| | | REF.GS1-379 | MODIFIED |
| | | SIZE: A2 | 50 V. W |
| N.Z. P.O. 40- | | DRAWN 45 | GBW 50 |
| | | CHECKED 45 | 50 |
| | | WIRING 45 | 55 |
| | | CIRCUIT 45 | 55 |

