


0  
5 Centimetres  
10  
15  
20  
25  
30

M.A.R.  
STRIP CONN.

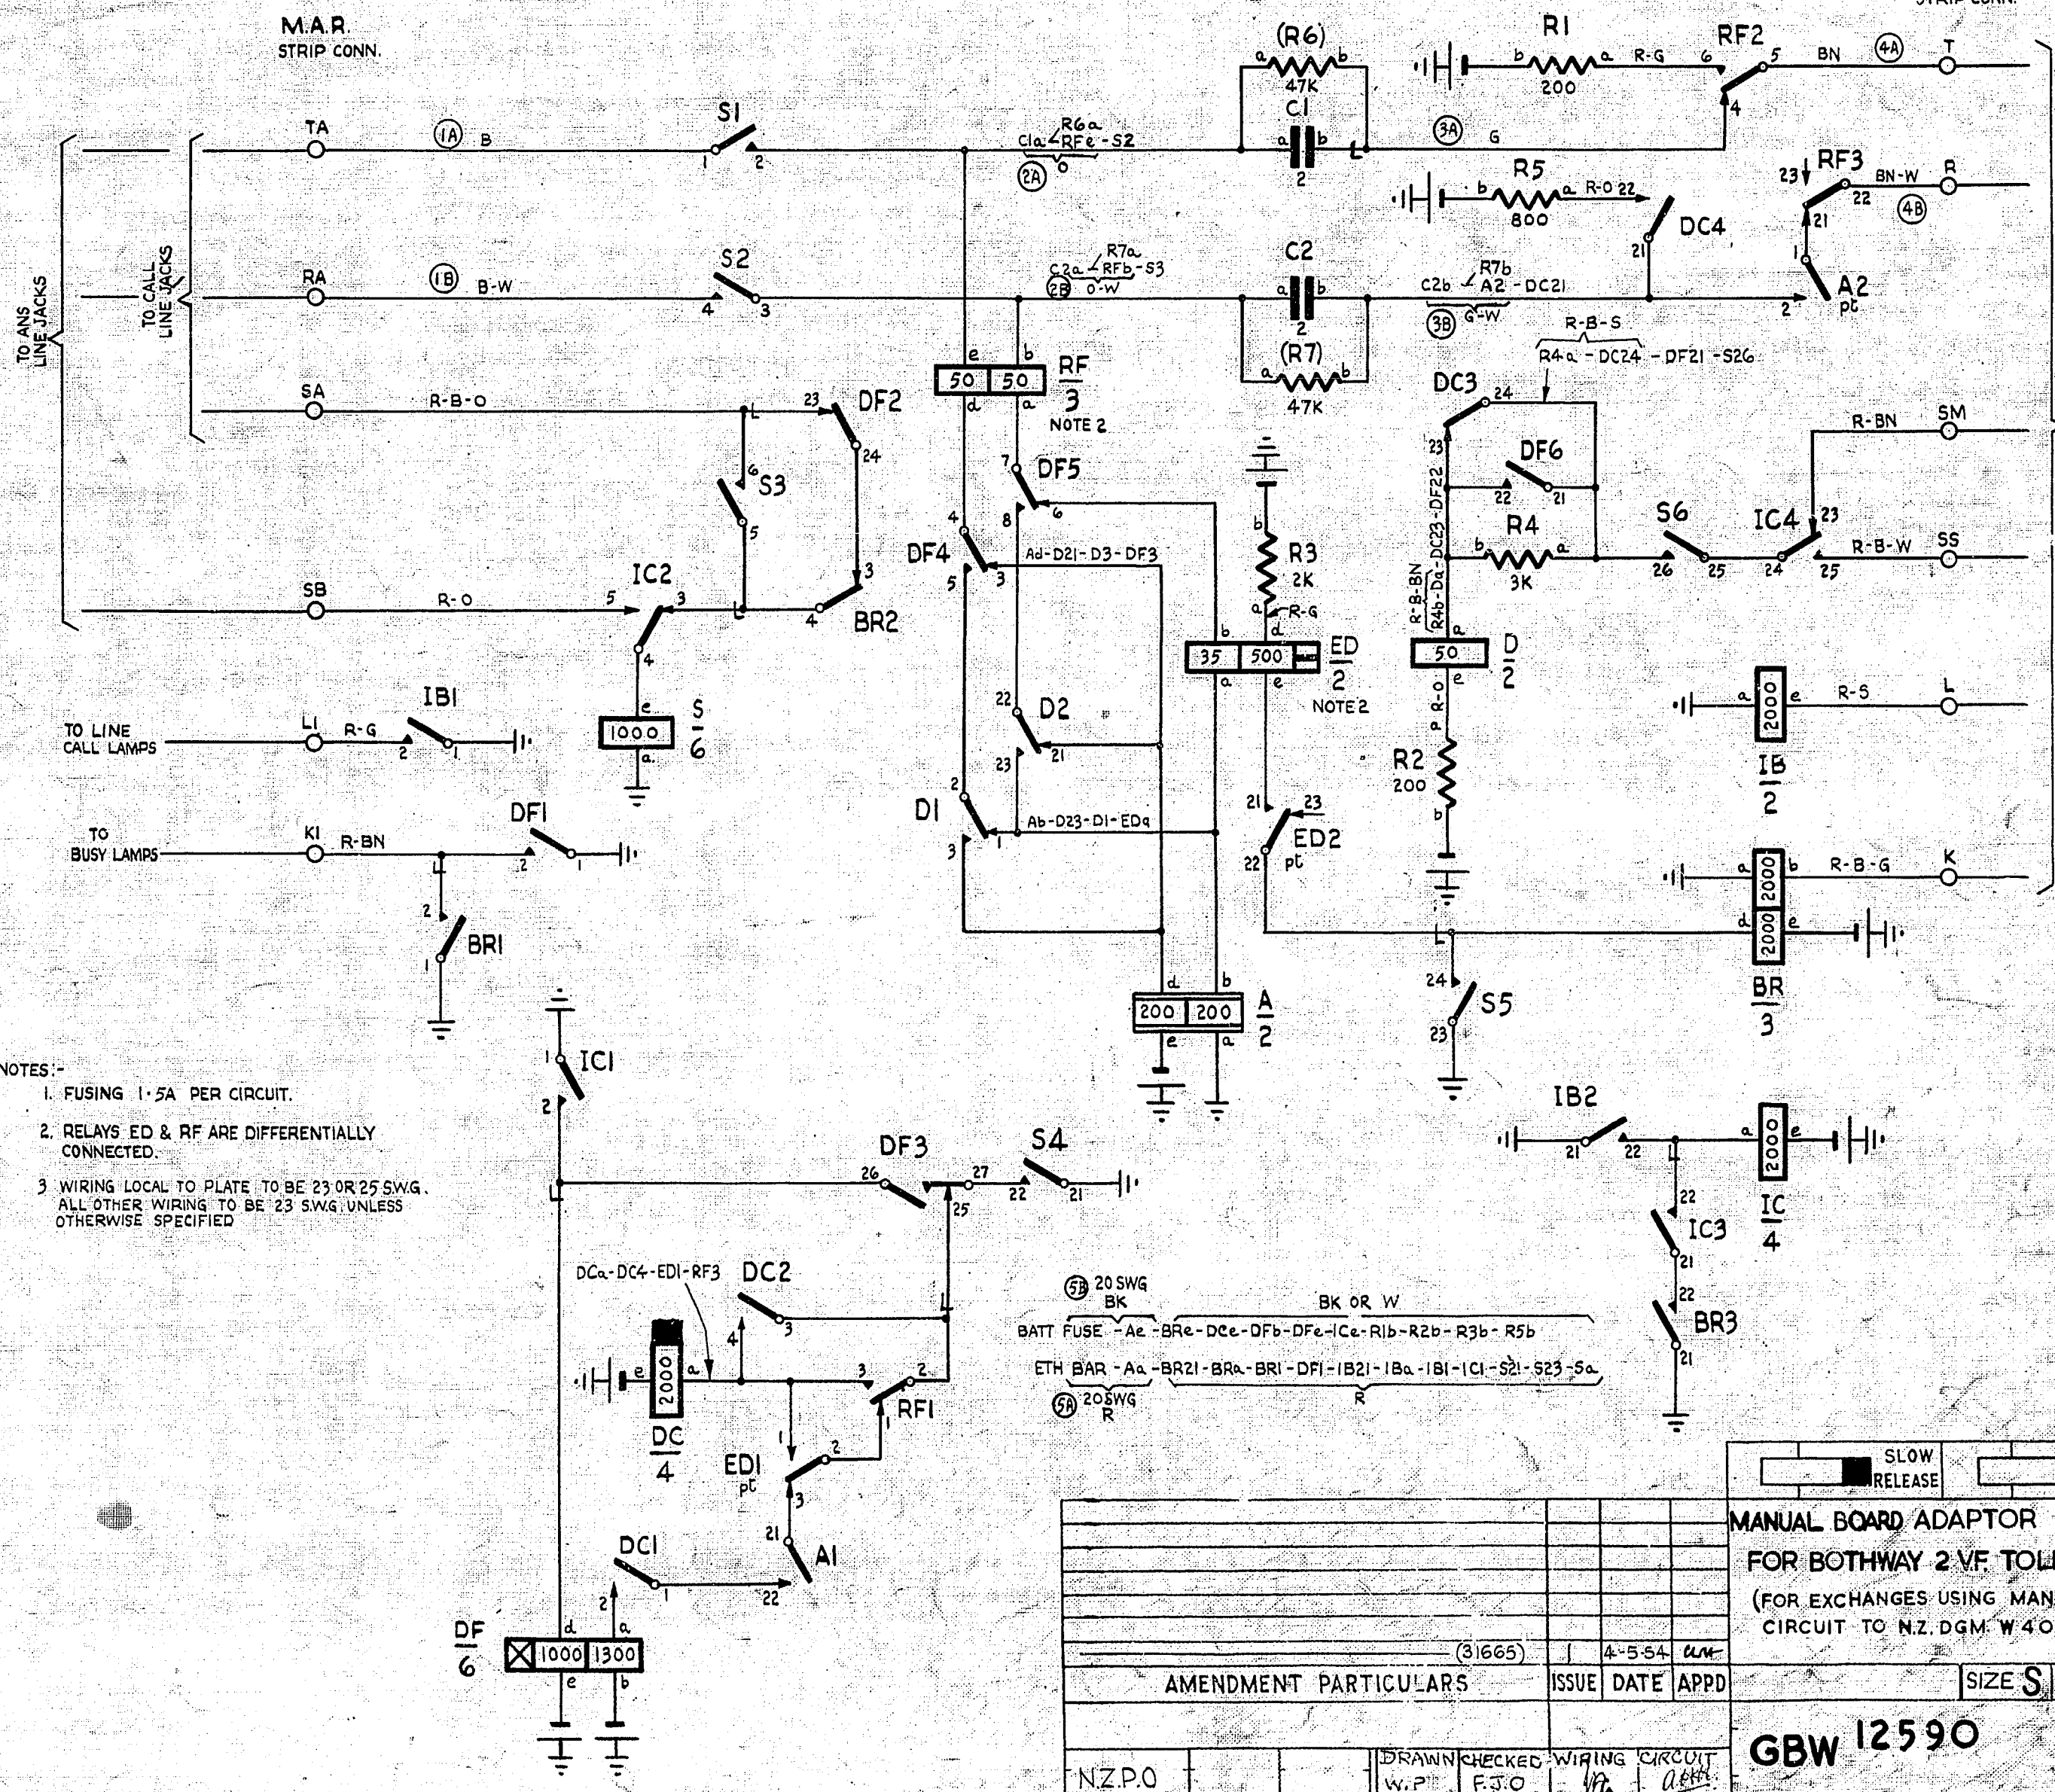

- NOTES:-
1. FUSING 1.5A PER CIRCUIT.
  2. RELAYS ED & RF ARE DIFFERENTIALLY CONNECTED.
  3. WIRING LOCAL TO PLATE TO BE 23 OR 25 SWG. ALL OTHER WIRING TO BE 23 SWG UNLESS OTHERWISE SPECIFIED

Ⓜ 20 SWG BK  
BATT FUSE - Ae - BRe - Dce - Dfb - Dfe - Ice - Rib - R2b - R3b - R5b  
ETH BAR - Aa - BR21 - BRa - BRi - Dfi - IB21 - IBa - IBi - ICI - S21 - S23 - Sa  
Ⓜ 20 SWG R

SLOW RELEASE  SLOW OPERATE

MANUAL BOARD ADAPTOR CIRCUIT  
FOR BOTHWAY 2 VF TOLL LINE  
(FOR EXCHANGES USING MAN. BD. CIRCUIT TO NZ. DGM. W 4025)

AMENDMENT PARTICULARS		ISSUE	DATE	APPD	SIZE	S	50V	S
N.Z.P.O.		DRAWN	CHECKED	WIRING	CIRCUIT			
		W.P.	F.J.O.					

GBW 12590