


5 Centimetres  
10  
15  
20  
25  
30  
35  
40  
45  
50  
55  
60

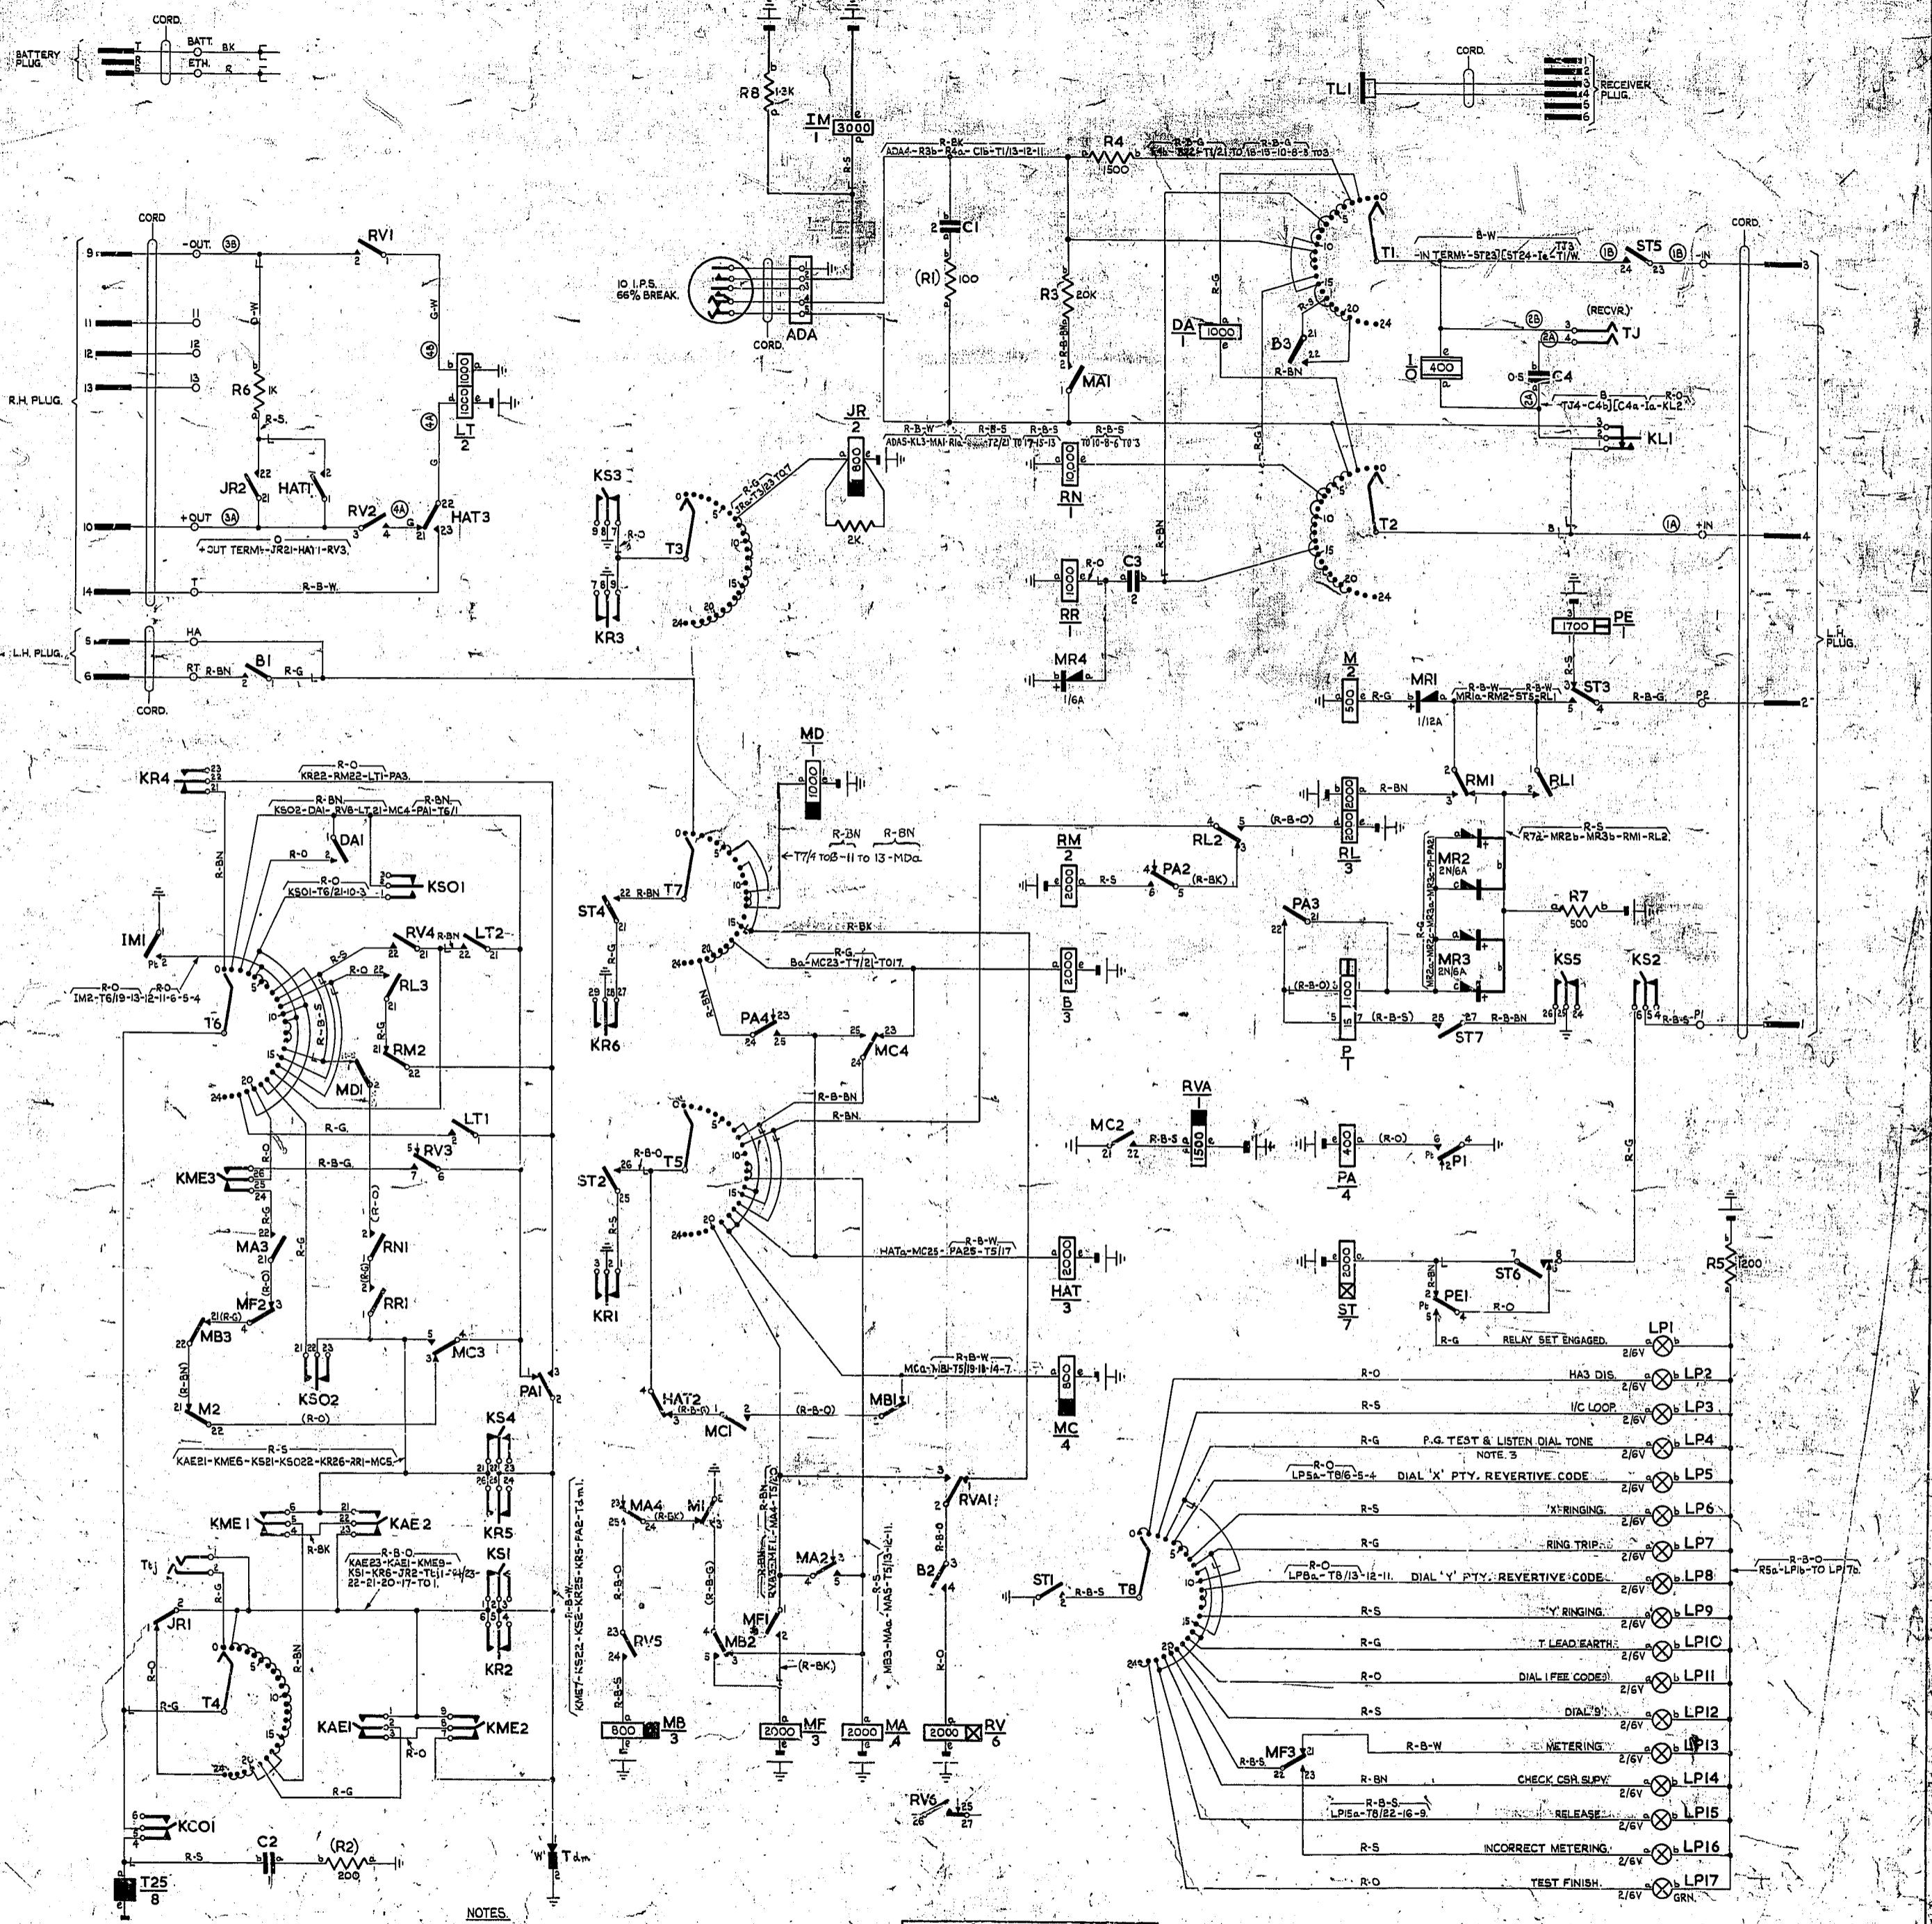

**NOTES**

1. ALL WIRING TO BE 23 S.W.G. UNLESS OTHERWISE SPECIFIED.

UNISELECTOR BANK WIRING TO BE 25 S.W.G.


UNISELECTOR BANK STRAPPING TO BE 23 B.T.C. ON ADJACENT CONTACTS OR 23 B.T.C. & ELEEWING ON NON-ADJACENT CONTACTS WHEN NOT INCLUDED IN THE LOCAL CABLE PLATE STRAPPING TO BE 23 OR 25 S.W.G. WHEN 25 S.W.G. IS USED, COLOURS SHOWN IN BRACKETS TO BE DISREGARDED.

2. THIS CIRCUIT IS USED FOR TESTING RELAY SET GBW 12610 EITHER WITH OR WITHOUT ASSOCIATED MULTIFREQUENCY AND/OR FOR GEN/125 SO WITH OR WITHOUT ASSOCIATED MULTI-FREQUENCY CONTROL EQUIPMENT.

3. WHEN TESTING GBW 12610 ONLY, LPA TO BE DESIGNATED LISTEN DIAL TONE.

LISTEN (KL)	START (KS)	RESET (KR)
2	6	6
METERING ELIMINATE (KME)	AUX. EST. ELIMINATE (KAE)	
4		

STEP ON (KSO)	CAMP ON (KCO)
2	2

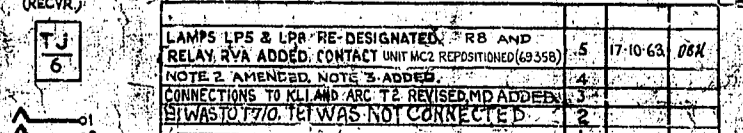

BATT. BK. BATT. TERM. - R51-R76-88-BF-H16-F19-M14-YM-122-116-  
ST-1-RV4-MR4-MR5-MR6-MR7-MR8-MR9-MR10-MR11-MR12-  
ETH. R. ETH. TERM. - ADA1-MR4-KR2-KR3-KR4-KR5-KR6-KR7-  
R10-R11-LT1-LT2-LT3-LT4-LT5-LT6-LT7-LT8-LT9-LT10-LT11-LT12-  
L1-L2-L3-L4-L5-L6-L7-L8-L9-L10-L11-L12-L13-L14-L15-L16-L17-L18-L19-L20-L21-L22-L23-L24-L25-L26-L27-L28-L29-L30-L31-L32-L33-L34-L35-L36-L37-L38-L39-L40-L41-L42-L43-L44-L45-L46-L47-L48-L49-L50-L51-L52-L53-L54-L55-L56-L57-L58-L59-L60-L61-L62-L63-L64-L65-L66-L67-L68-L69-L70-L71-L72-L73-L74-L75-L76-L77-L78-L79-L80-L81-L82-L83-L84-L85-L86-L87-L88-L89-L90-L91-L92-L93-L94-L95-L96-L97-L98-L99-L100

LAMP LPS & LPR RE-DESIGNATED. RB AND RELAY RVA ADDED. CONTACT UNIT MC2 REPOSITIONED (69358)	5	17-10-63	DJK
NOTE 2 AMENDED. NOTE 3 REVISED.	4		
CONNECTIONS TO KL1 AND ARC T2 REVERSED AND ADDRESS 21 WAS TO 170. TET WAS NOT CONNECTED	2		

AMENDMENT PARTICULARS	ISSUE DATE	APPROV.	SIZE M50V17

TESTER FOR AUTO TO AUTO RELAY SETS WITH REVERTIVE RINGING SATELLITE EXCHANGES 2000 TYPE.

GBW 12610