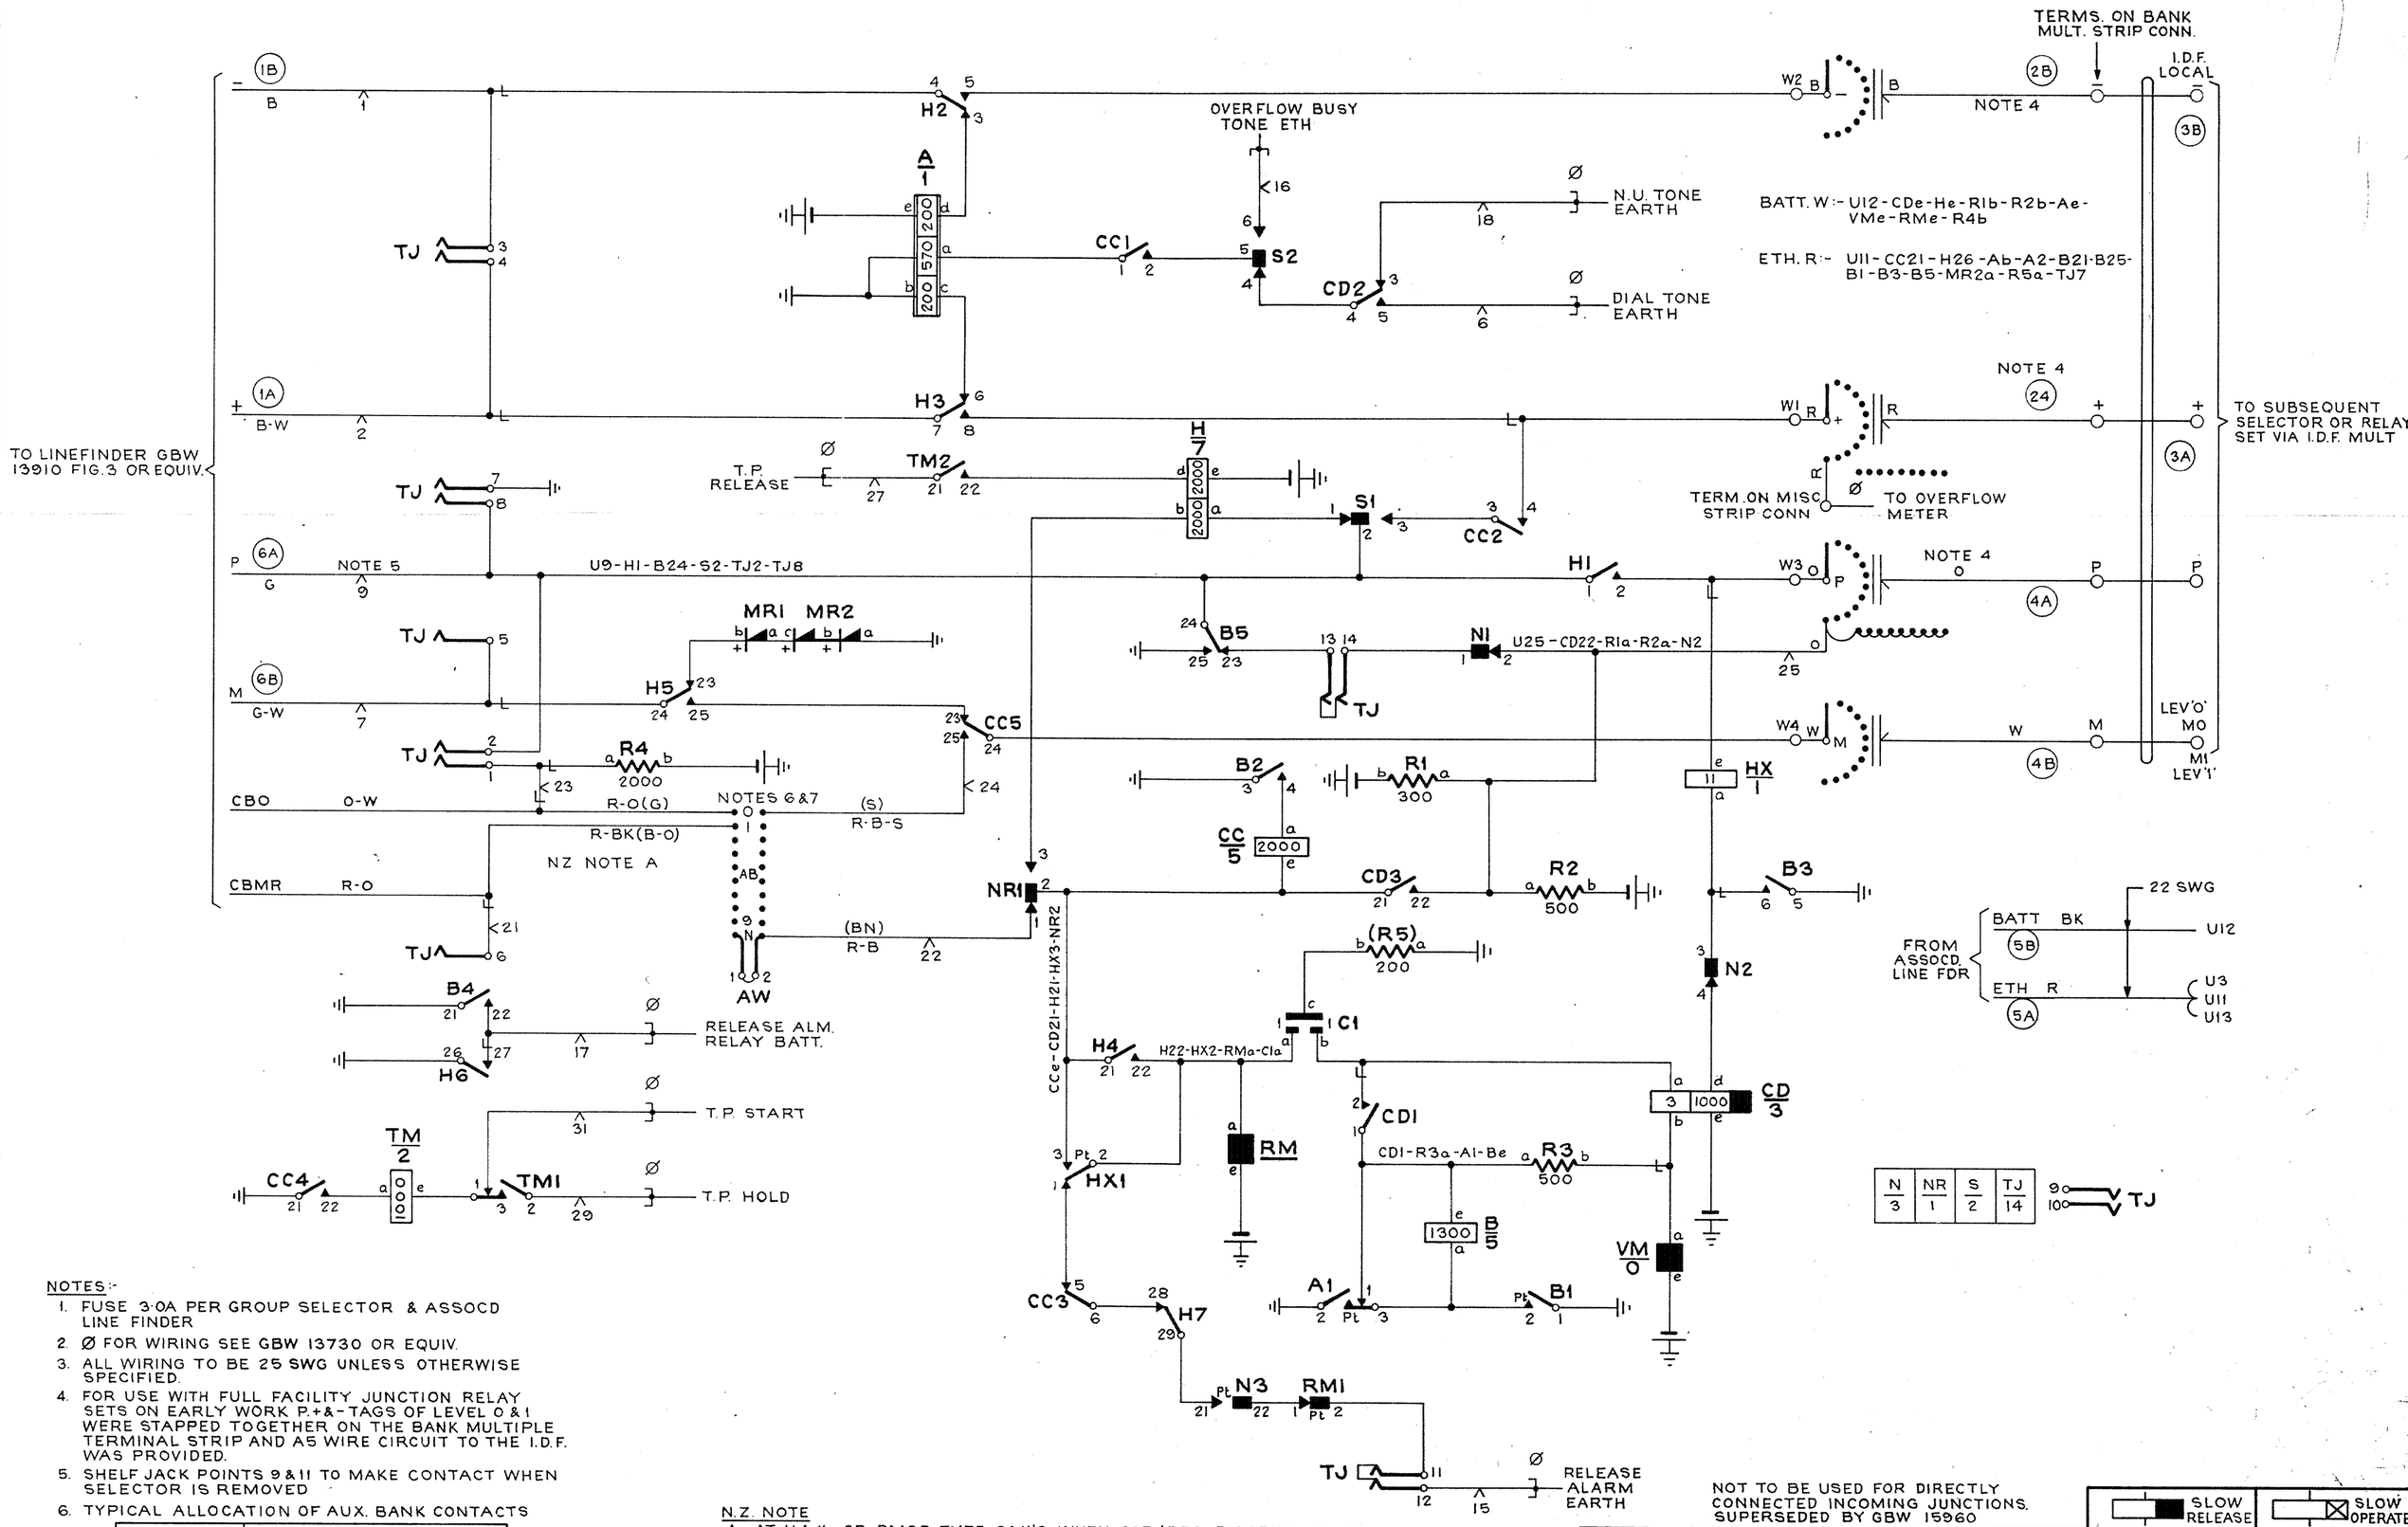

NOTES:-

1. FUSE 3·0A PER GROUP SELECTOR & ASSOCD LINE FINDER
2. Ø FOR WIRING SEE GBW 13730 OR EQUIV.
3. ALL WIRING TO BE 25 SWG UNLESS OTHERWISE SPECIFIED.
4. FOR USE WITH FULL FACILITY JUNCTION RELAY SETS ON EARLY WORK P.+&-TAGS OF LEVEL 0 & 1 WERE STAPPED TOGETHER ON THE BANK MULTIPLE TERMINAL STRIP AND A5 WIRE CIRCUIT TO THE I.D.F. WAS PROVIDED.
5. SHELF JACK POINTS 9 & 11 TO MAKE CONTACT WHEN SELECTOR IS REMOVED
6. TYPICAL ALLOCATION OF AUX. BANK CONTACTS

	ON APPROPRIATE LEVEL	
	STRAP AB1 TO	STRAP AB2 TO
UNIT FEE AUTO-AUTO ROUTE	U21	U24
BARRED	U21	U22
SPARE LEVEL	U23	U22

7. ON SOME EARLIER EQUIPMENTS COLOURS SHOWN IN BRACKETS ARE USED

N.Z. NOTE

A. AT U.A.X.-CB BMSB TYPE CAX'S WHEN CCB/REG DISCRIMINATION IS REQUIRED ON I/C JUNCTION DEMAND CALLS, VIA LEV'O' & LEV'9' RESPECTIVELY. THE VERTICAL MARKING BANK WIRING IS TO BE CHANGED AS FOLLOWS:-

(i) REMOVE WIRE FROM U23 TO AB1 LEV O & CONNECT U23 TO AB1 LEV 9
(ii) WIRE U23 TO AB1 LEV O
(iii) STRAP AB2 LEV O & LEV 9

NOT TO BE USED FOR DIRECTLY CONNECTED INCOMING JUNCTIONS. SUPERSEDED BY GBW 15960

SLOW RELEASE ■ SLOW OPERATE ⊠

BATT SYMBOL DEL FROM 'B' TAG OF RELAY 'A' (68436)	8C	7·5·75	BS-H
SUPPRESSION NOTE AMD. RETRACED (99971)	8B	29·8·73	BS-H
NZ. NOTE A ADDED (28084)	8A	15·12·70	BSH
NOTES 4 & 6 REVISED (46790)	8	14·3·67	NBH
AMENDMENT PARTICULARS	ISS	DATE	APD

U.A.X. Nº N.Z. 13
GROUP SELECTOR

REF: SIZE A2 50V H

NZPO		DRAWN	CHECKED	WIRING	CIRCUIT
		RL	KC	KC	R.F.L.

GBW 13890