



- NOTES:-**
- FUSE:- 1-0A PER CIRCUIT
 - LEVELS 8 & 9 REFER TO N.Z.P.O REVERSED DIAL NUMBERING SCHEME
 - CONNECT STRAPS SHOWN -○-○- WHEN LINE FINDER CONTROL RELAY SET NO.1 IS FIRST CHOICE
CONNECT STRAPS SHOWN -x-x- WHEN LINE FINDER CONTROL RELAY SET NO.2 IS FIRST CHOICE
 - WHEN ROUTE IS BARRED TO CALLS FROM I/C JUNCT. STRAP TERMinals 15C 31 & 32 SHOWN -
 - Ø FOR WIRING SEE GBW 13730 OR EQUIV.
 - WHEN PARENT MANUAL BOARD IS WIRED FOR BATTERY DIALING DISCONNECT WIRING SHOWN THUS - - - AND STRAP TERMINALS 15C 47 & 49 AND 15C 48 & 50 SHOWN - - -
 - RESISTOR R4 WILL BE SUPPLIED BY N.Z.P.O. VALUE OF R4 TO BE SUCH THAT THE LINE CURRENT GIVES PD OF 2.4 VOLTS BETWEEN TJB11 & TJB12
 - STRAP TERMINALS 25C 10 & 20 TO ENABLE OPERATOR TO TRUNK OFFER SHOWN - - -
 - 15C REFERS TO UPPER STRIP CONN. 25C REFERS TO LOWER STRIP CONN.
 - ALL WIRING TO BE 255W.G. UNLESS OTHERWISE SPECIFIED.
 - WHEN PARENT EXCHANGE IS 2000-TYPE S.C.S. OR USES NON-RING THROUGH CORD CIRCUITS, CONNECT EARTH TO TERMINAL 15C 46 SHOWN THUS - - -

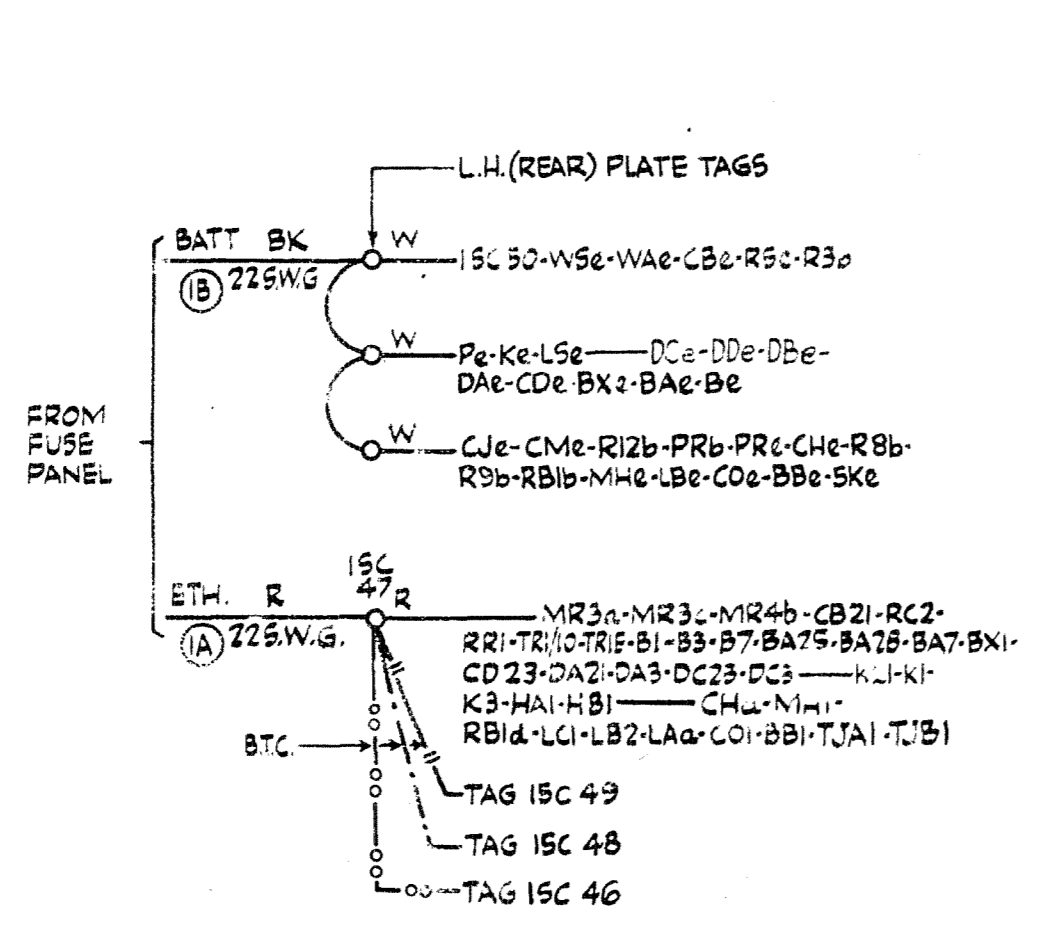

- NZPO NOTES:-**
- AT A TANDEM UAX, THESE RELAY SETS OUTGOING TO NON PARENT MANUAL EXCHANGES SHOULD HAVE THE NORMAL 'e' AND 'a' CONNECTIONS TO RELAY 'L.C.' REVERSED.
 - IN CASES OF PREMATURE OPERATION TM RELAY SHOULD BE CHANGED TO 1000 OHMS

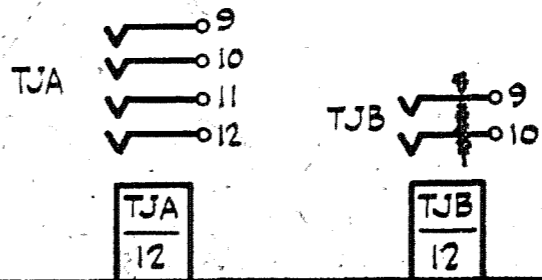

NZPO NOTE B ADDED (133486)	GB 16.6.71 RED	ADVANCED IN ISSUE ONLY (34031)	GA 5.5.71 B.5.H	U.A.X. N.S.N. Z.13
ICROIC CALL COUNT METER LEADS DELETED (94612)	G 10.2.66 K.G.H	N.Z.P. NOTE A ADDED (69920)	EA 6.5.69 D.B.H	BOTHWAY JUNCTION TO PARENT EXCHANGE LIMITED FACILITY TYPE
VALUE OF TRANSFORMER WINDINGS DELETED	5	DE RELAY WAS SHOWN, NOTE 11 MODIFIED	4	REL. 9PG BX7 & N.I. 8HUNT ACROSS B REL. ADDED
DE RELAY ADDED	3		2	
	1		1	
AMENDMENT PARTICULARS	ISSUE	DATE	APPR	REF
NZPO				
DRAWN: [Signature]				CHECKED: [Signature]
WIRING: [Signature]				CIRCUIT: [Signature]
GBW 14450				