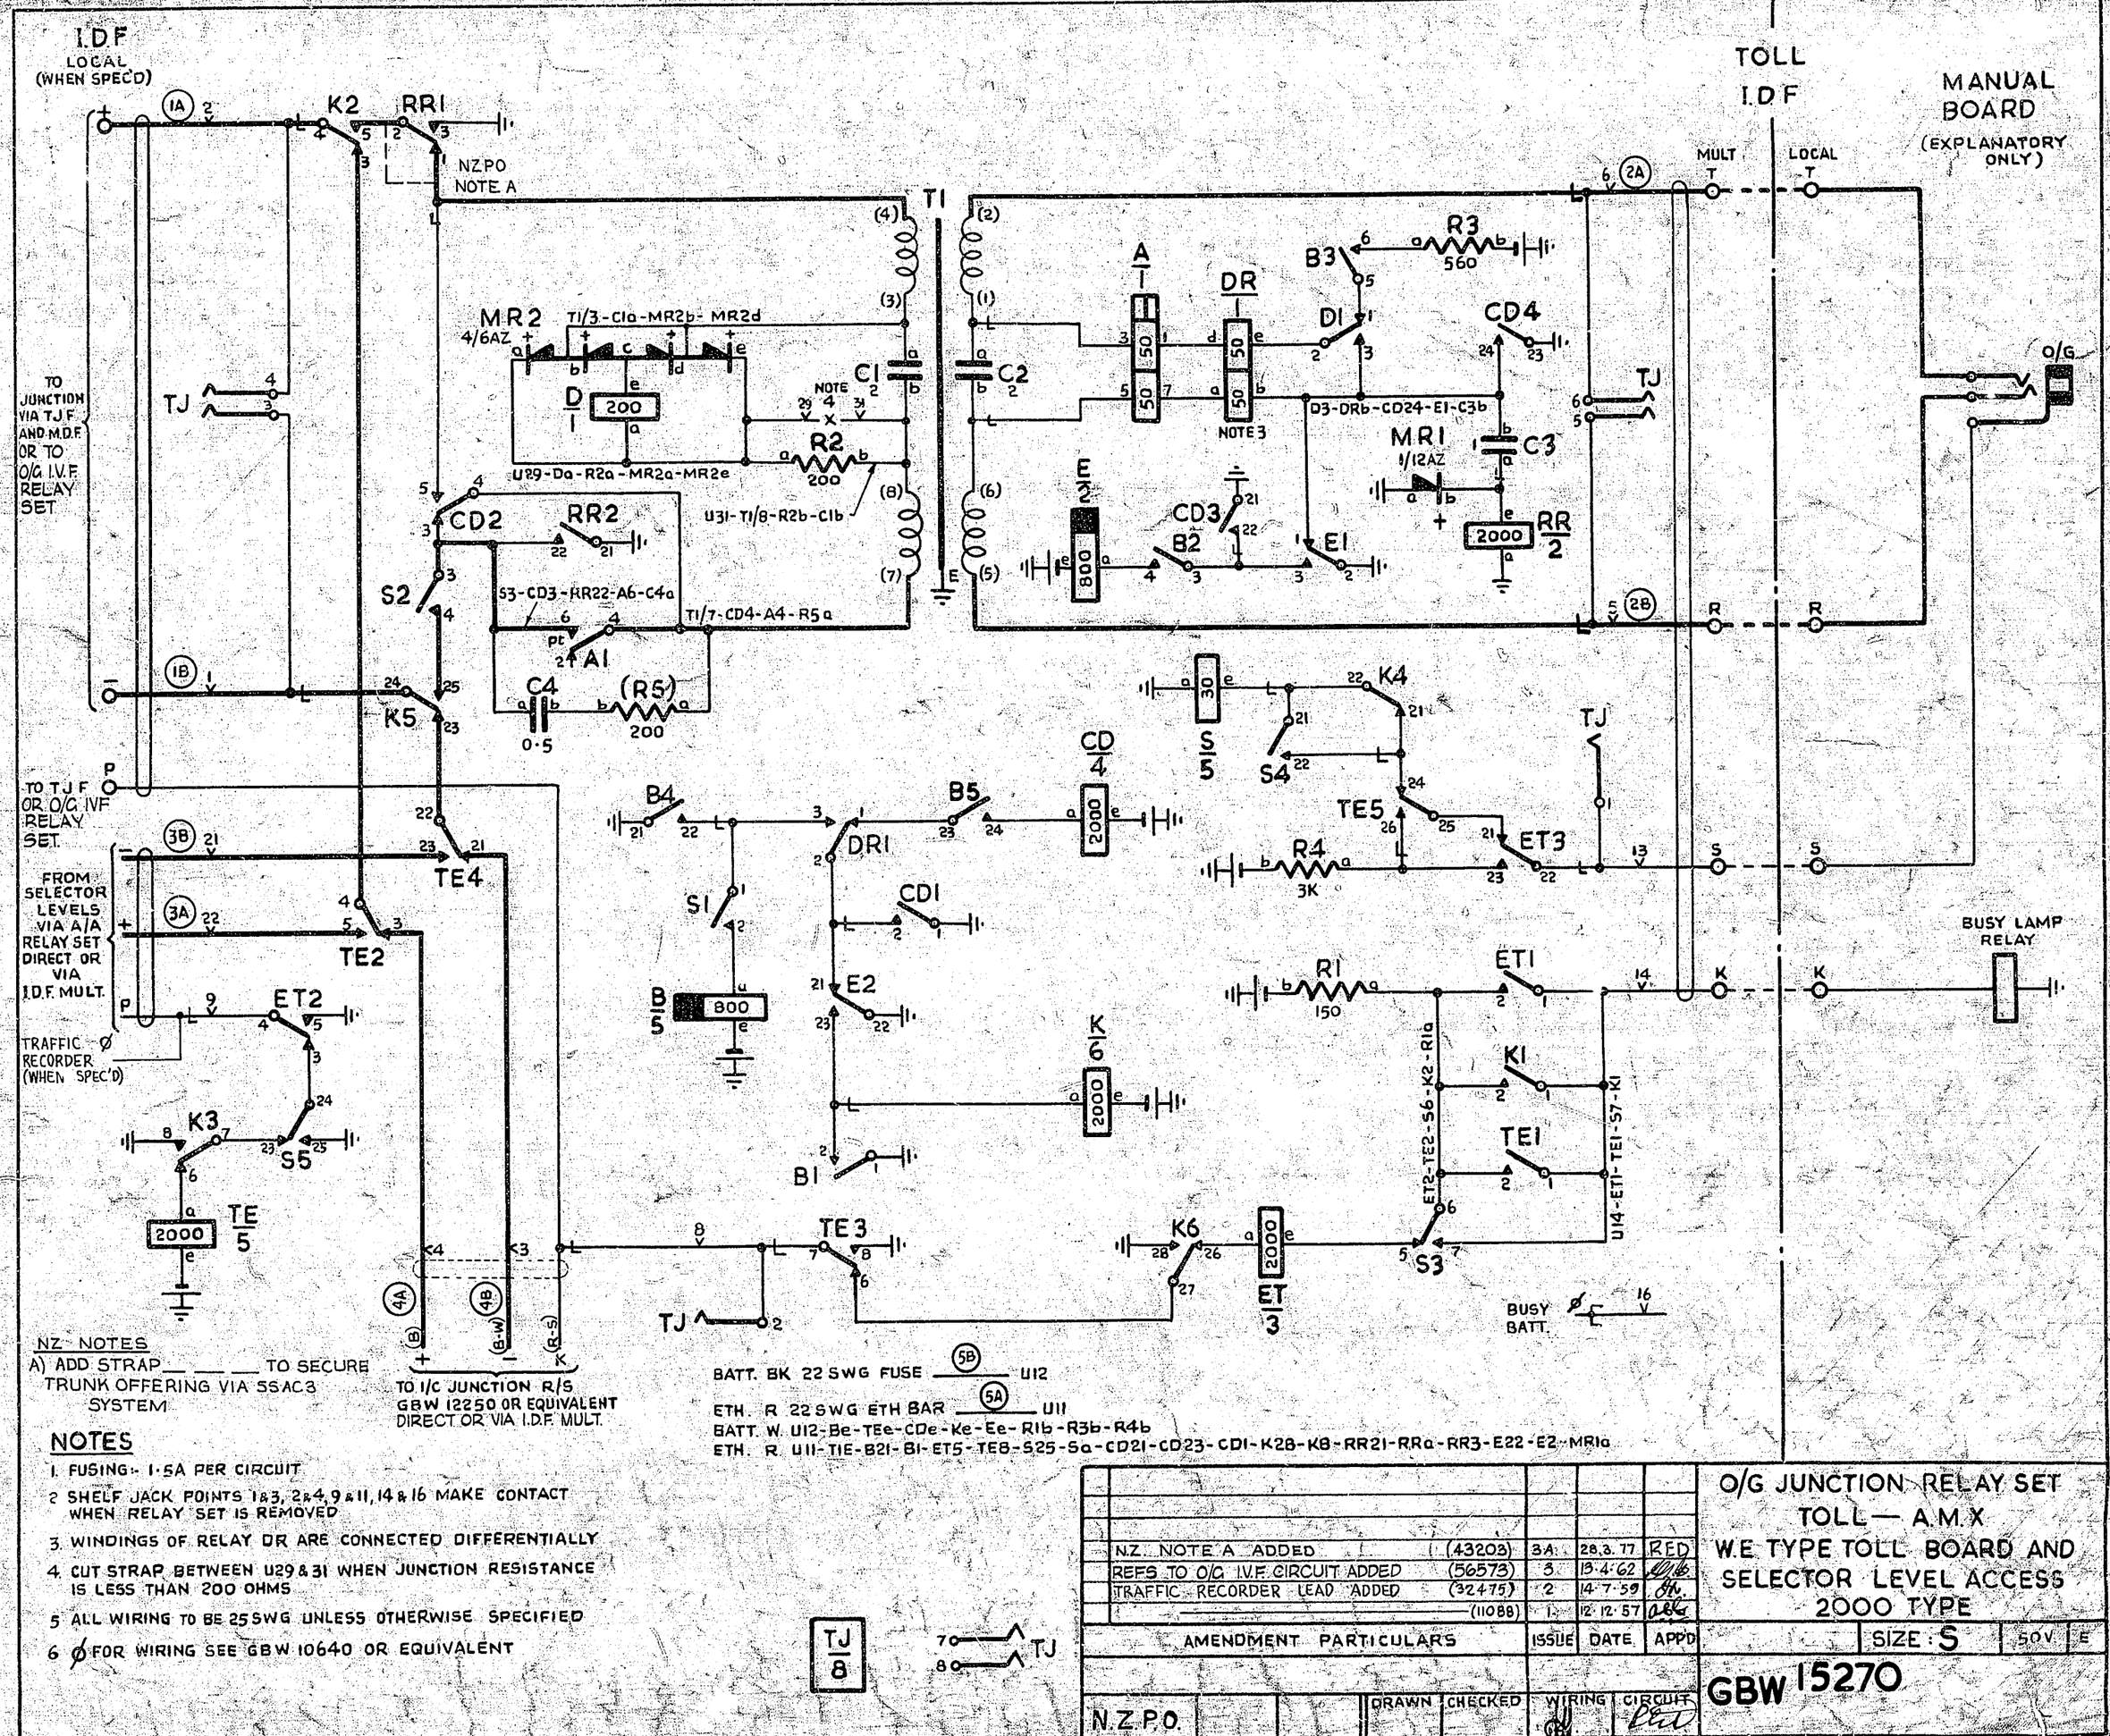

NZ NOTES

A) ADD STRAP ___ ___ ___ TO SECURE TRUNK OFFERING VIA SSAC3 SYSTEM

TO I/C JUNCTION R/S GBW 12250 OR EQUIVALENT DIRECT OR VIA I.D.F. MULT.

NOTES

1. FUSING:- 1·5A PER CIRCUIT
2. SHELF JACK POINTS 1&3, 2&4, 9&11, 14&16 MAKE CONTACT WHEN RELAY SET IS REMOVED
3. WINDINGS OF RELAY DR ARE CONNECTED DIFFERENTIALLY
4. CUT STRAP BETWEEN U29&31 WHEN JUNCTION RESISTANCE IS LESS THAN 200 OHMS
5. ALL WIRING TO BE 25 SWG UNLESS OTHERWISE SPECIFIED
6. Ø FOR WIRING SEE GBW 10640 OR EQUIVALENT

N.Z. NOTE A ADDED	(43203)	3A	28.3.77	RED	
REFS TO O/G I.V.F. CIRCUIT ADDED	(56573)	3	13.4.62		
TRAFFIC RECORDER LEAD ADDED	(32475)	2	14.7.59		
	(11088)	1	12.12.57		
AMENDMENT PARTICULARS		ISSUE	DATE	APPD	

O/G JUNCTION RELAY SET
TOLL — A.M.X
W.E. TYPE TOLL BOARD AND SELECTOR LEVEL ACCESS
2000 TYPE

SIZE: S | 50V | E

GBW 15270

N.Z.P.O. | DRAWN | CHECKED | WIRING | CIRCUIT