


FIG. 1A

MANUAL BOARD AND NIGHT SWITCHING OR MANUAL BOARD OR DIRECTORY SERVICE DESK (EXPLANATORY ONLY)

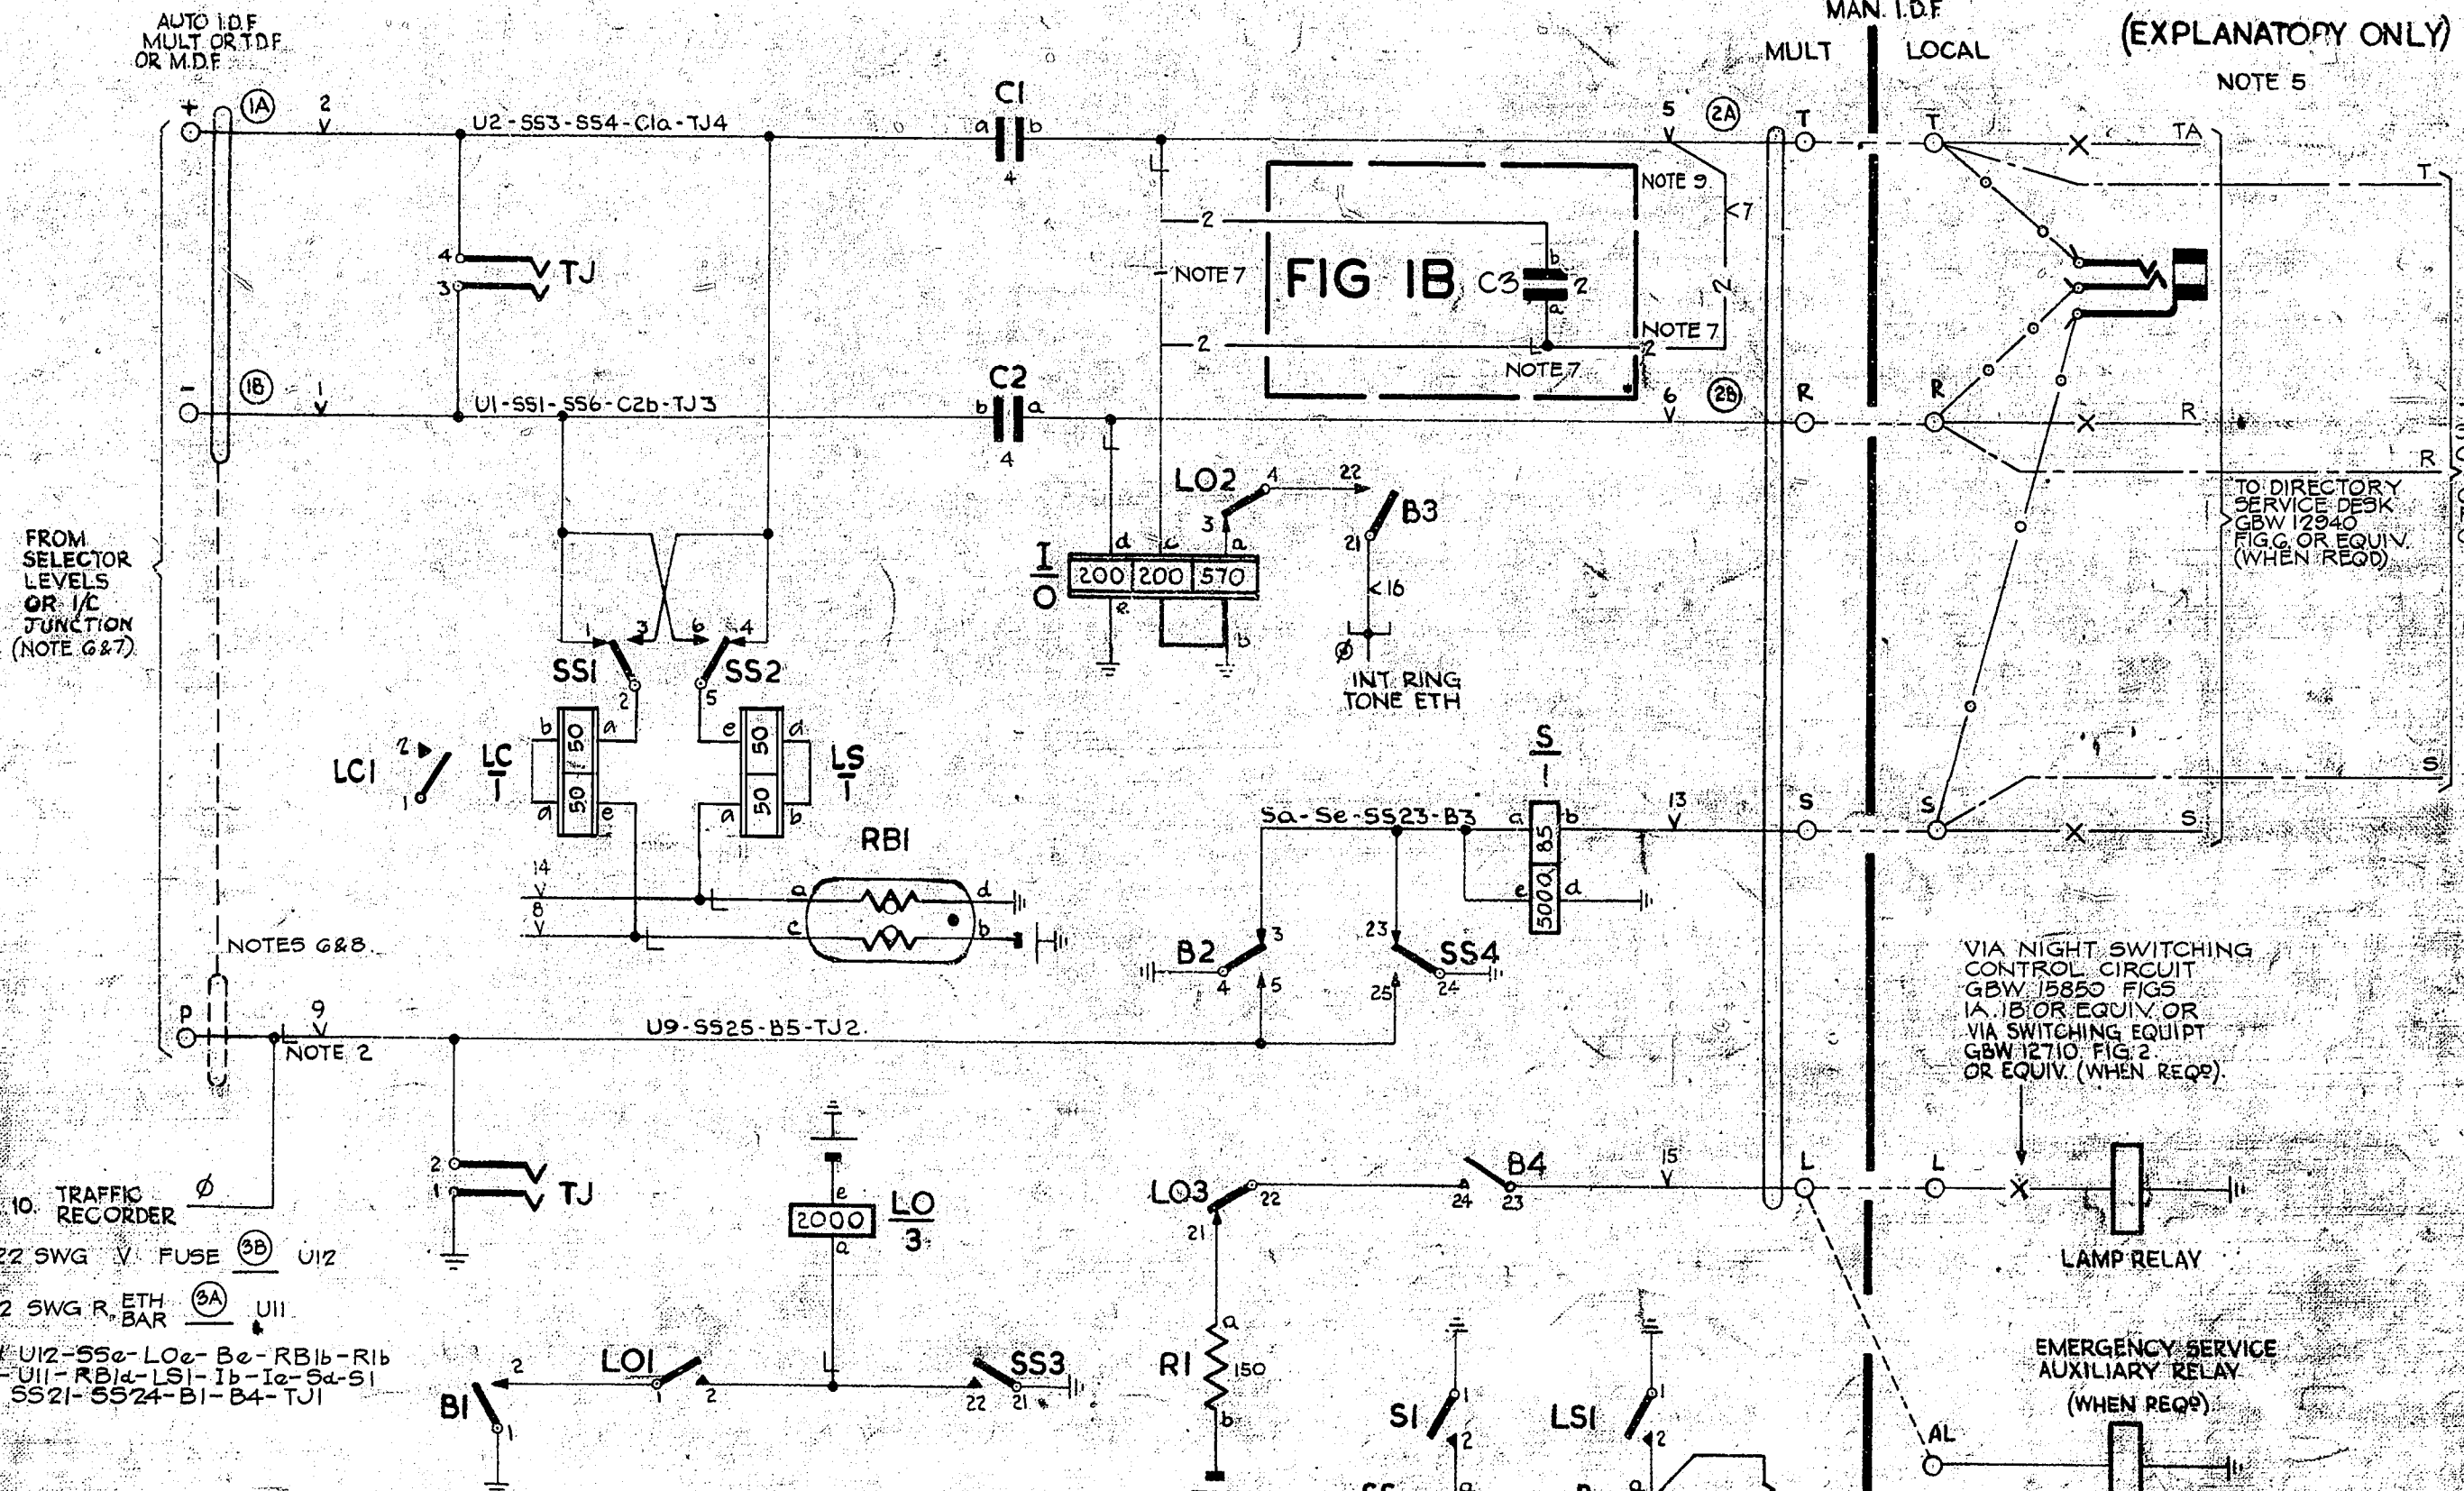

- NOTES.**
1. FUSING 1.5A PER CIRCUIT.
  2. SHELF JACK UPTS 9 & 11 TO MAKE CONTACT WHEN RELAY SET IS REMOVED FROM SHELF
  3. ALL WIRING TO BE 25 SW.G. UNLESS OTHERWISE SPEC.
  4. Ø FOR WIRING SEE GBW 10640 OR EQUIV.
  5. WHEN CONNECTIONS TO DIRECTORY SERVICE ARE REQUIRED CONNECT LEADS SHOWN WHEN CONNECTIONS TO MANUAL BOARD ARE REQUIRED CONNECT LEADS SHOWN WHEN CONNECTIONS TO MANUAL BOARD & NIGHT SWITCHING TO T.M.X. ARE REQUIRED & AT DAY GROUP CENTRES, CONNECT LEADS SHOWN AND
  6. WHEN THIS CIRCUIT TERMINATES AT A JUNCTION THE P WIRE IS NOT CABLED.
  7. FIG 1B IS PROVIDED WHEN THE CIRCUIT TERMINATES A JUNCTION DIRECTLY OR VIA SELECTORS. WHEN THE CIRCUIT TERMINATES CALLS FROM LOCAL SUBSCRIBERS ONLY, WIRING SHOWN -1-1-15 USED & FIG.1B & WIRING SHOWN -2-2-15 OMITTED.
  8. P WIRE IS STRAPPED TO BUSYING CIRCUIT GBW 15350 WHEN REQD.
  9. WHEN FIG.1B IS USED TO CONTROL PAD SWITCHING, STRAP U5-U7 WHEN THE ASSOCIATED JUNCTION IS UNDER 3dB.
  10. ON EARLIER EQUIPMENT COLOUR OF BATTERY WIRING WAS BK OR W.

			SELECTOR LEVEL OR I/C JUNCTION RELAY SET 2000 TYPE	
NOTE 9 AMENDED	(7940)	B	25.2.69	
	(7795B)	A	16.9.68	
AMENDMENT PARTICULARS		ISSUE DATE	APPD	SIZE S 50V
N.Z.P.O.		DRAWN EWD	CHECKED H.S.O.	WIRING W.J.A.
		CIRCUIT J.F.O.		
			GBW 15450	MOD. A

0  
5 Centimetres  
10  
15  
20  
25  
30