



FIG. A.

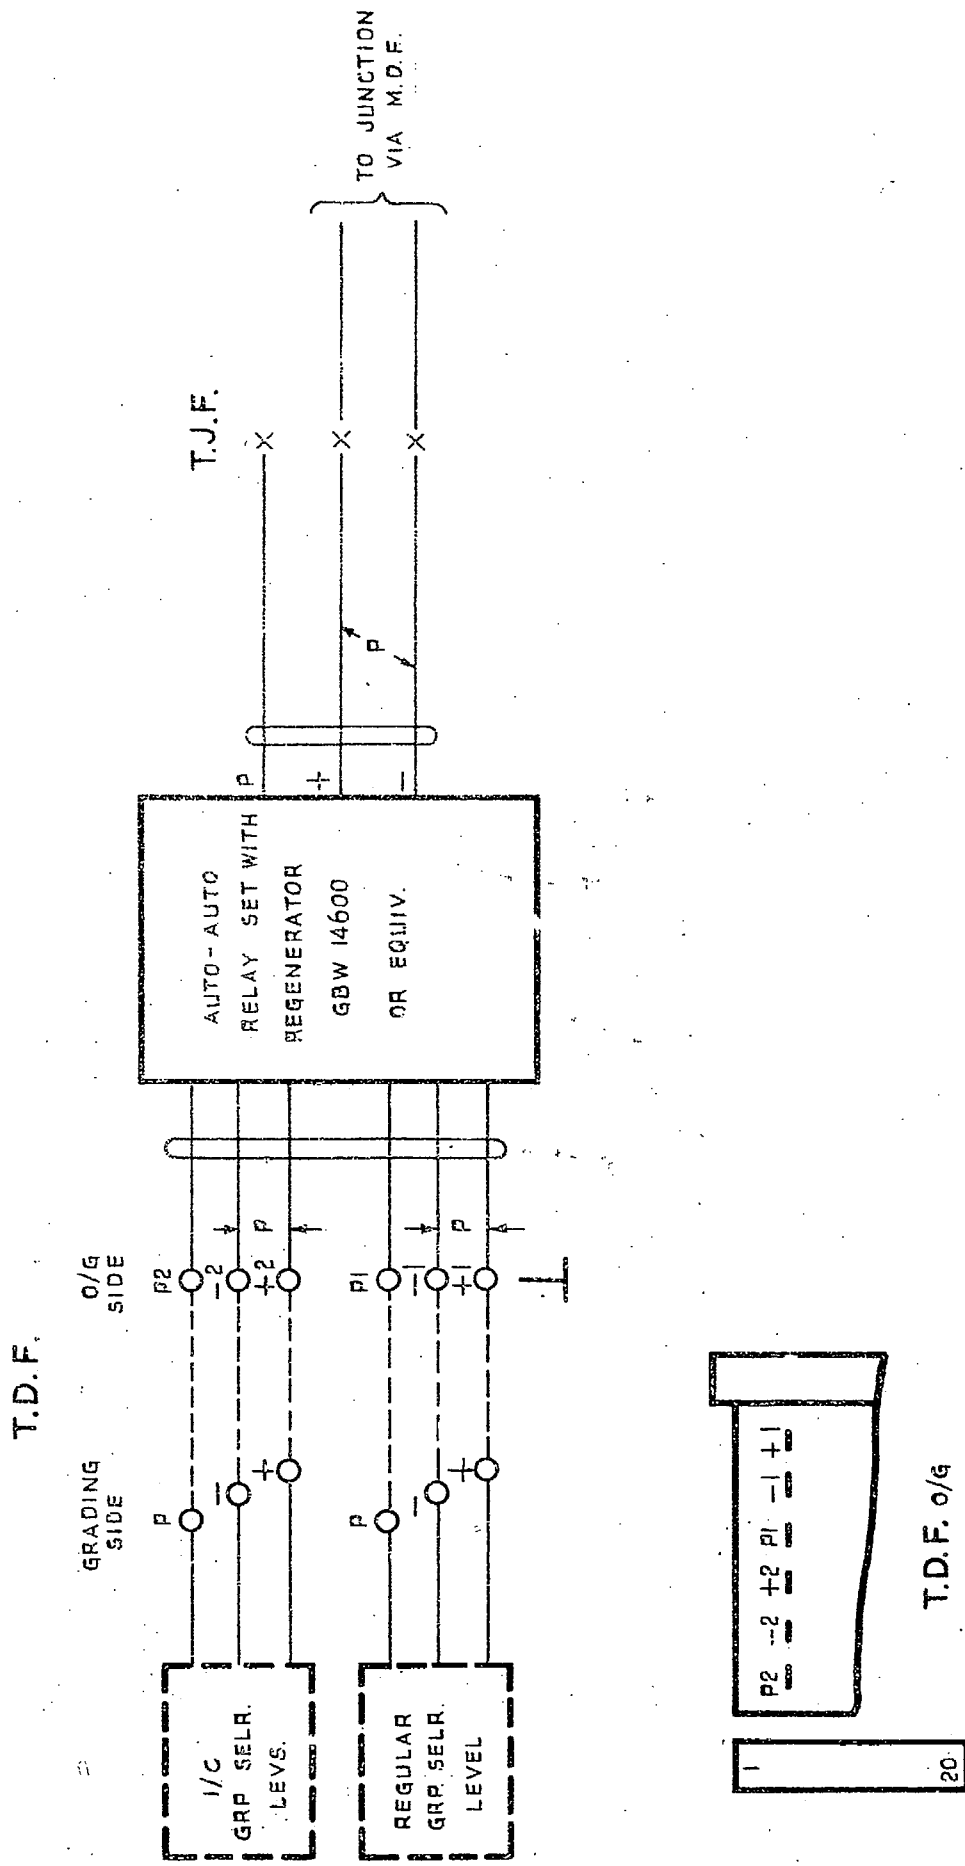


| | | | | | | |
|-----------------------|--|--|--|--|--------------------------------------------------------------------------------------|---------|
| | | | | | AUTO-AUTO RELAY SET WITH REGENERATOR VARIABLE FEE 1-6 UNITS WITH REPEAT METERING. | |
| (G7623) | | | | | 1 | 9-8-56 |
| AMENDMENT PARTICULARS | | | | | ISSUE | DATE |
| | | | | | APPD | E |
| N.Z.P.O. | | | | | DRAWN | CHECKED |
| | | | | | WIRING | CIRCUIT |
| | | | | | GBX 14600 | |
| | | | | | SHEET 1/3 | |

FIG. B

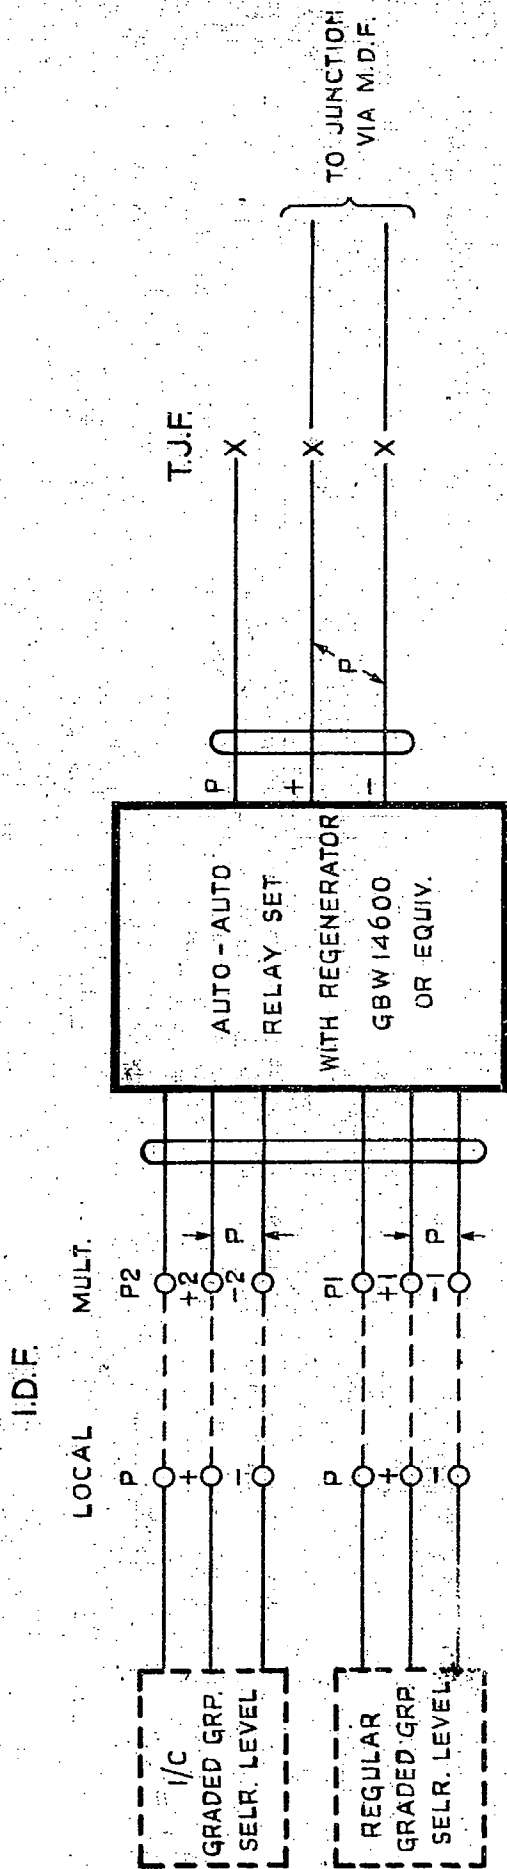

TYPICAL MARKING

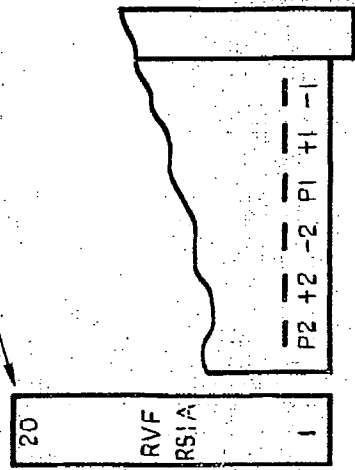



I.D.F. MULT.

| | | | | | |
|-----------------------|--|---------|---------|--------|---------|
| N.Z. P.O. | | DRAWN | CHECKED | WIRING | CIRCUIT |
| AMENDMENT PARTICULARS | | (67623) | 1 | 9-3-56 | CLM |
| | | ISSUE | DATE | APPD | E |

AUTO-AUTO RELAY SET
WITH REGENERATOR
VARIABLE FEE 1-6 UNITS
WITH REPEAT METERING

GBX 14600

FIG. C

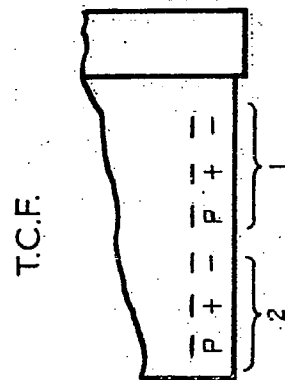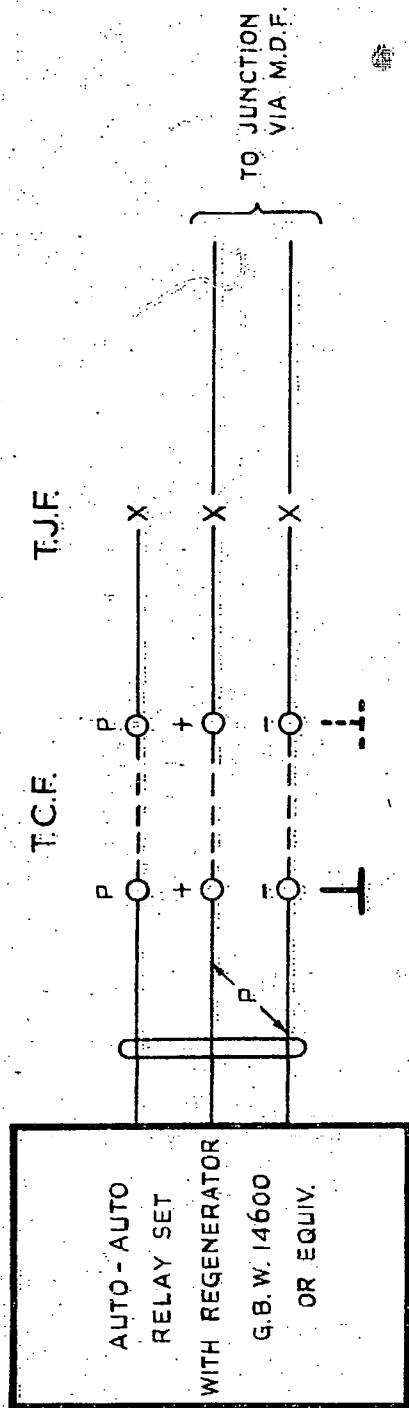

| | | | | | | | |
|-----------------------|--|--|--|-------------------------------------------------------------------------------------------|---------|--------|---------|
| | | | | AUTO-AUTO RELAY SET WITH REGENERATOR VARIABLE FEE 1-6 UNITS WITH REPEAT METERING | | | |
| (67623) | | | | 1 | 9.8.56 | CLM | |
| AMENDMENT PARTICULARS | | | | ISSUE | DATE | APP'D | E |
| N.Z.P.O. | | | | DRAWN | CHECKED | WIRING | CIRCUIT |
| | | | | GBX 14600 | | | |
| | | | | SHEET 3/3. | | | |