

FIG.A. FOR BOTHWAY WORKING AT MAIN EXCHANGES.

				PARENT EXCHANGE	
				O/G N.Z.S.S. ACN#3 LINE CCT.	
				FOR BOTHWAY JUNCTIONS TO	
				DEPENDENT EXCHANGE	
I.D.F. LOCAL & CARRIER I.D.F. BLK. VIEWS SHOWN SEPARATELY (13732)		4	6-10-70	RW	
TITLE CHANGED: ALTYE CABLING VIA CARRIER I.D.F. ADDED (13732)		3	6-10-70	RW	
P WIRE DELETED GBX 15071 & SHT 2. ADDED (66583)		2	21-3-63	DBH	
(35359)		1	10-11-60	DBH	
AMENDMENT PARTICULARS			ISSUE DATE	APPD	REF: S
N.Z.P.O.		DRAWN B.A.	CHECKED BA	WIRING ACB	CIRCUIT
				GBX 15070 15071	
				SHEET 1-2	

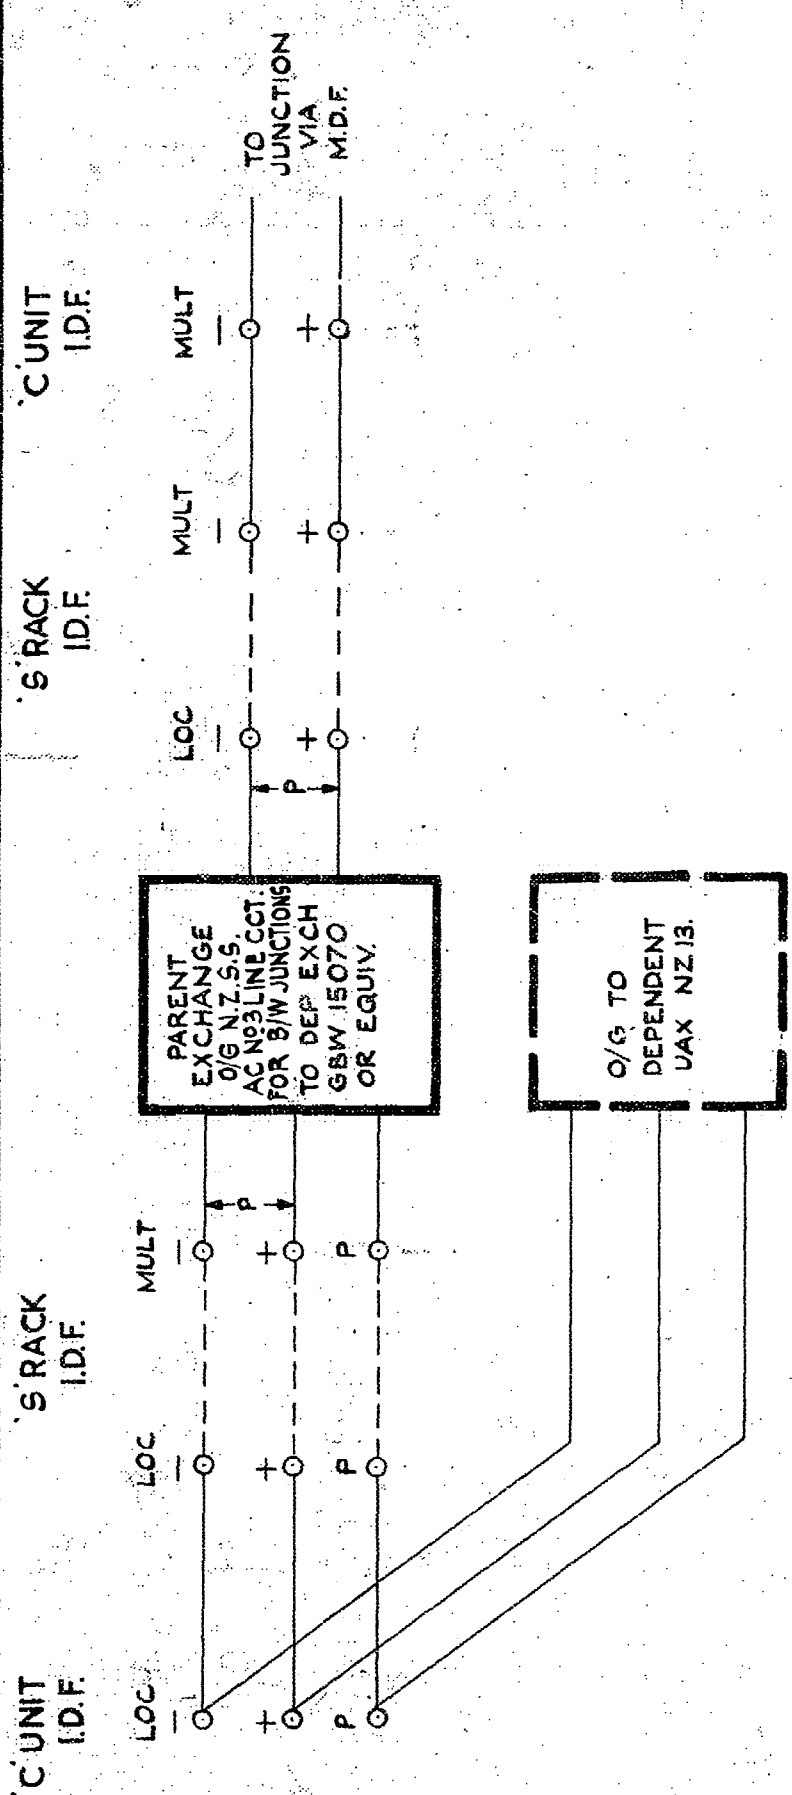


FIG.B. FOR BOTHWAY WORKING AT PARENT UAX.NZ13.

				PARENT EXCHANGE O/G NZ.S.S. AC N°3 LINE CCT. FOR BOTHWAY JUNCTIONS TO DEPENDENT EXCHANGE	
'S' RACK WAS 'B' RACK	(13732)	4	6-10-70	RW	
TITLE CHANGED	(13732)	3	6-10-70	RW	
	(66583)	2	21-3-63	DBK	
AMENDMENT PARTICULARS	ISSUE	DATE	APP	REF.	GBW 15780 FIG.16.
N.Z.P.O.	DRAWN B.A.	CHECKED BA.	WIRING	CIRCUIT	GBX 15070 15071
					SHEET 2-2