


FIG.A.

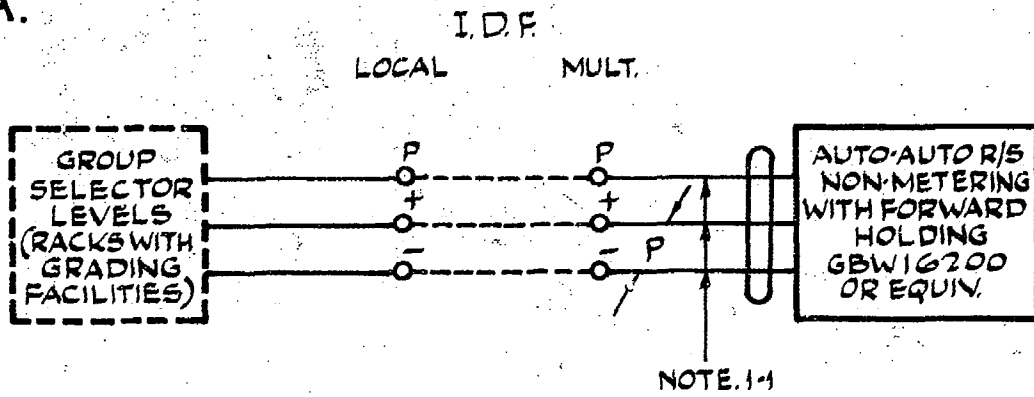

TYPICAL MARKINGS ON I.D.F.



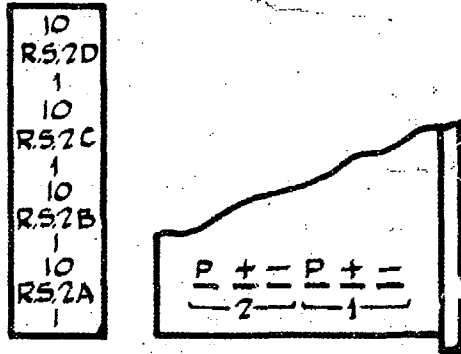


FIG.B.

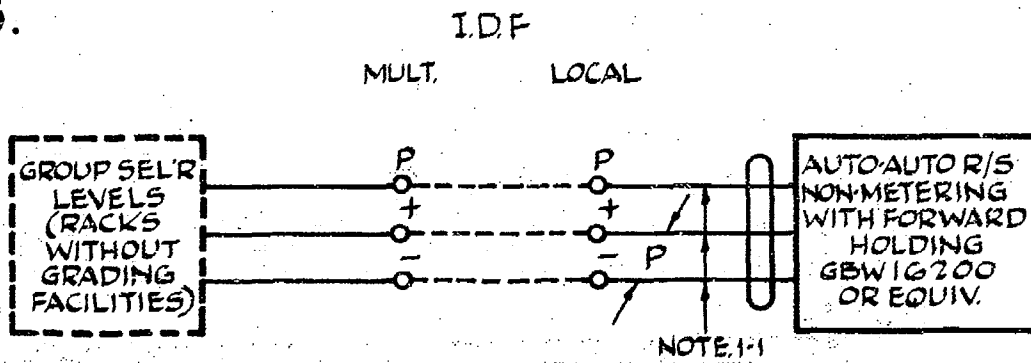

TYPICAL MARKINGS ON I.D.F.

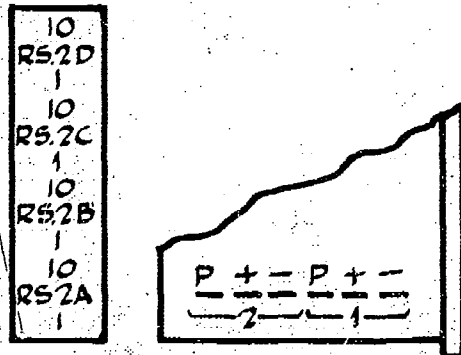


NOTES:-

1:1 WHEN LOCAL CONDITIONS DO NOT REQUIRE I.D.F. TERMINATIONS THESE LEADS MAY BE CABLED DIRECT.

					AUTO-AUTO RELAY SET NON-METERING WITH FORWARD HOLDING 2000 TYPE
REDRAWN & REVISED	(74902)	3	28-8-63	DBK	
AMP LEAD & NOTE 1-2 ADDED		1			
AMENDMENT PARTICULARS		ISSUE	DATE	APP ^d	REF:-
N.Z.P.O.		DRAWN	CHECKED	WIRING	CIRCUIT
GBX 16200					SHEET 1-G

FIG. C


MULT. I.D.F. LOCAL

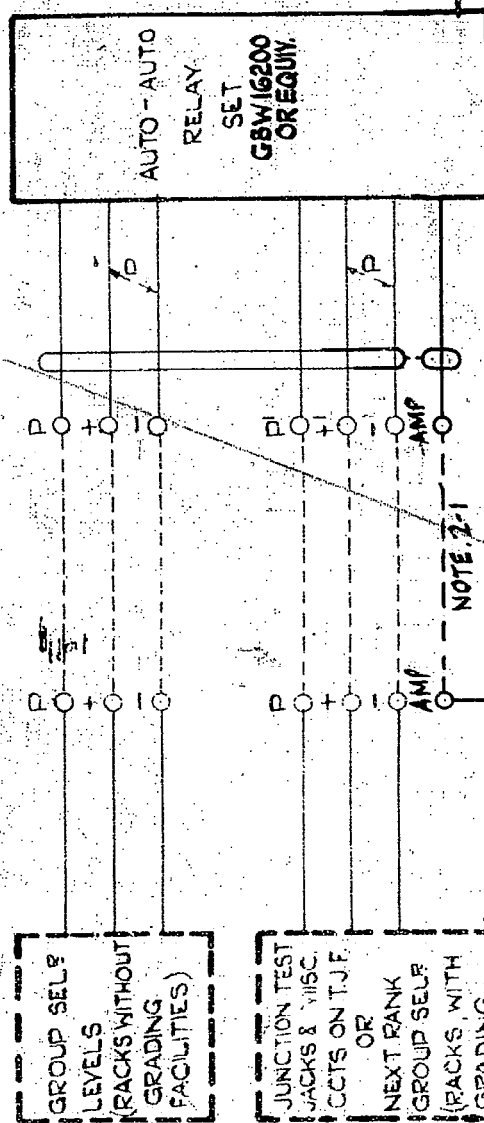

NOTES:-


2/ THIS LEAD PROVIDED FOR OPERATION OF 2 WIRE AMPLIFIERS (NEGATORS) AND IS ONLY CABLED TO I.D.F. WHEN REQ. TAGBLOCK AS SHOWN.

TYPICAL MARKING



I.D.F. LOCAL

TYPICAL MARKINGS

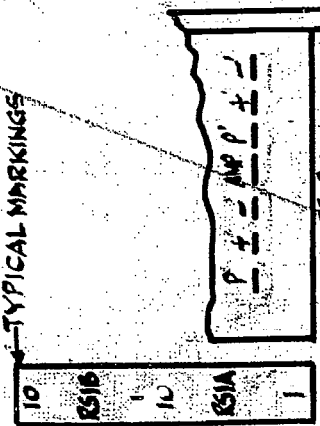

I.D.F. LOCAL

FIG. NO & SHT. NO REVISED
AMP LEAD & NOTE 2/1 ADDED.

(74902) 3 28-8-63 DBH
(77938) 2 24-5-63 DBH

AMENDMENT PARTICULARS	ISSUE	DATE	APPD
-----------------------	-------	------	------

AUTO TO AUTORELAY SET
NON-METERING WITH
FORWARD HOLDING
2000 TYPE

N.Z.P.O.

DRAWN *dec* CHECKED *H.P.A. 1/62* WIRING *—* CIRCUIT

GBX 16200

SHEET 2-6

FIG. D

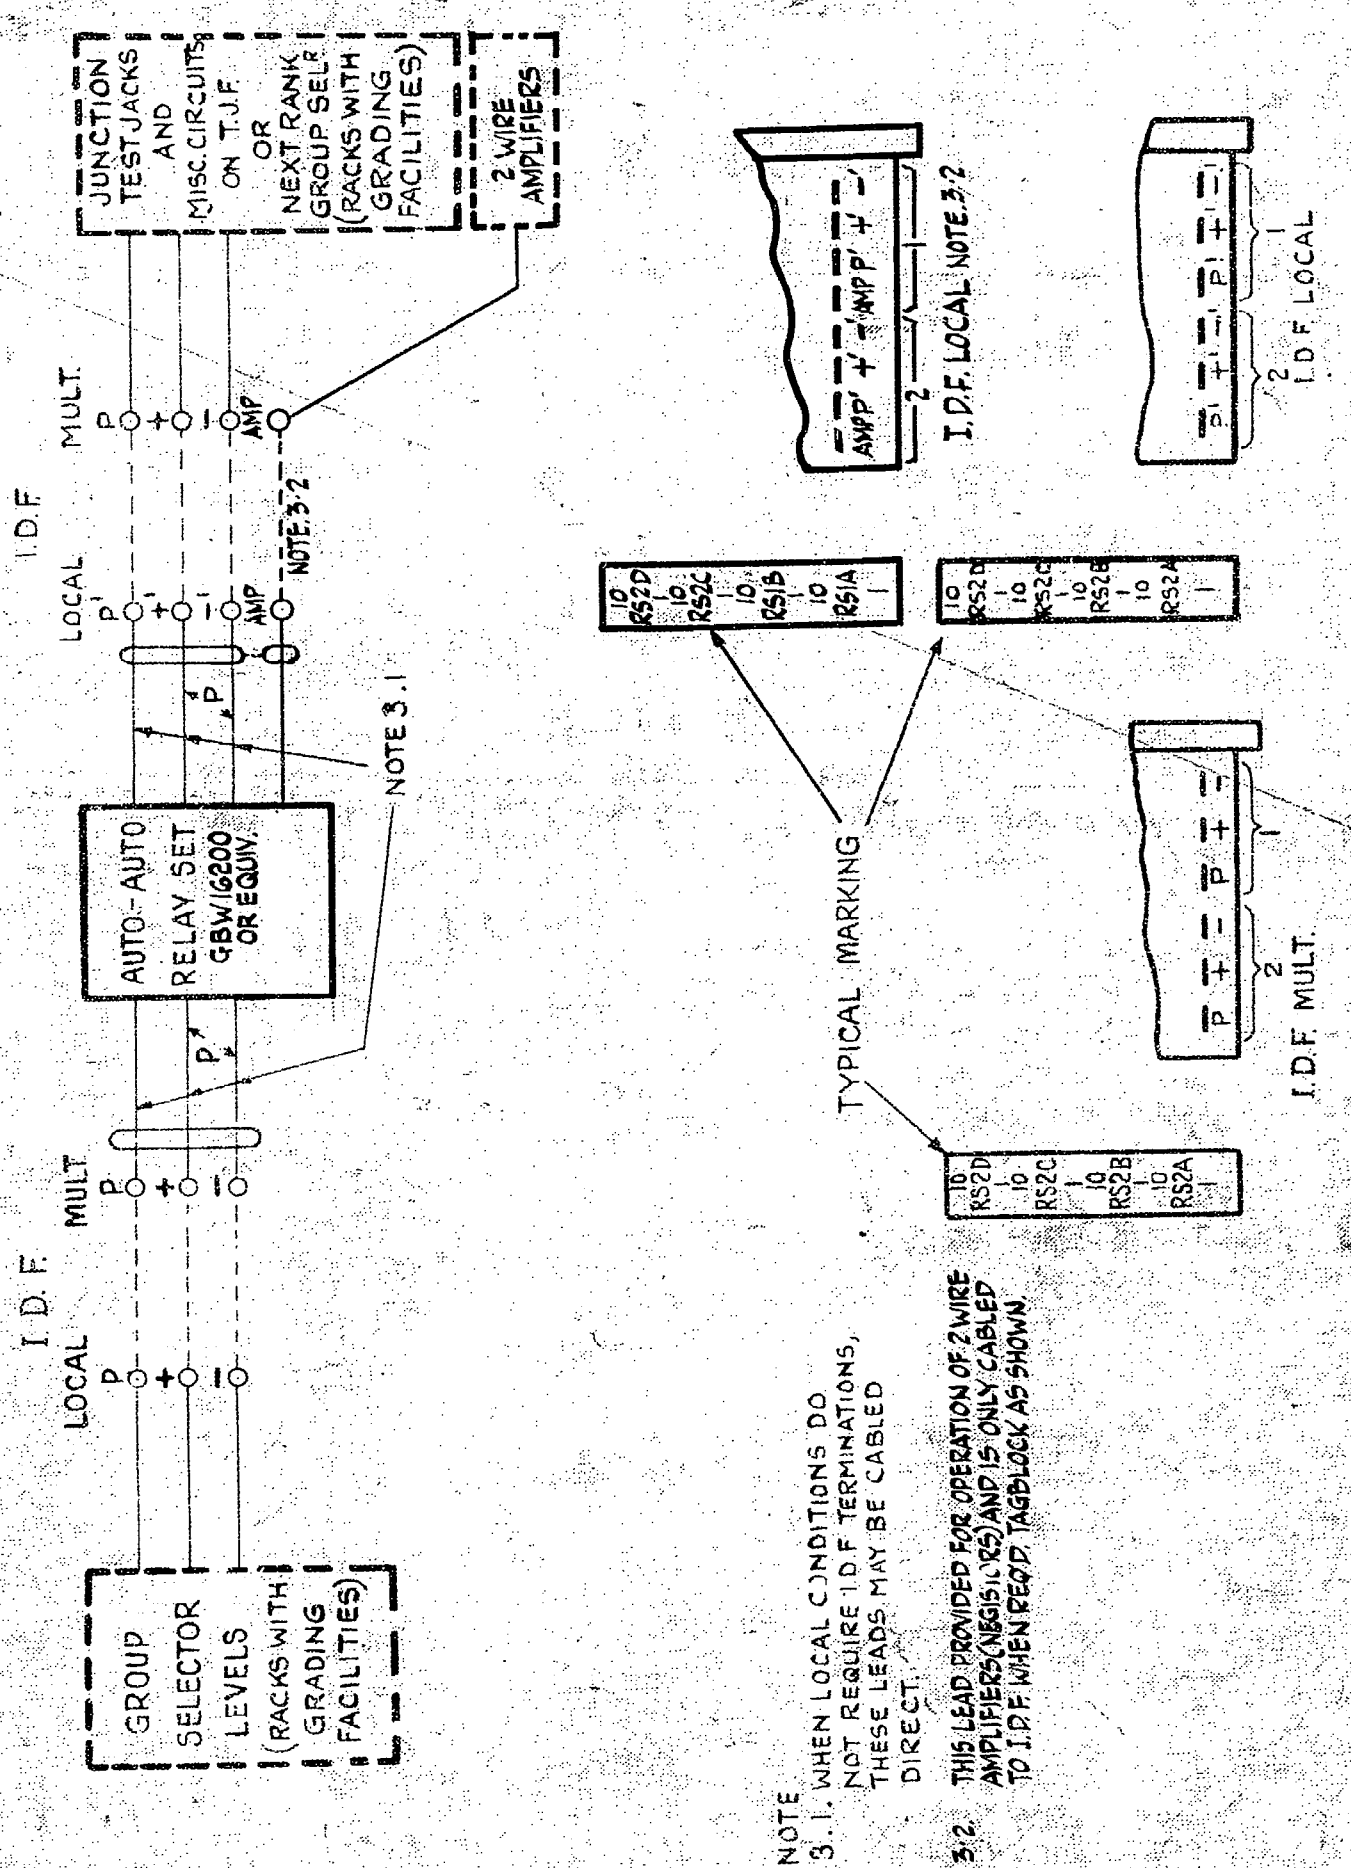



FIG. NO & SHT. NO REVISED	(74902)	3	28-8-63	DDK
AMP LEAD & NOTE 3.2 ADDED.	(77938)	2	24-5-63	DBL
AMENDMENT PARTICULARS	ISSUE	DATE	APPD	H
N.Z.P.O.	DRAWN	CHECKED	WIRING	CIRCUIT
	DEC	J.P.K. 8/1/63		

AUTO TO AUTO RELAY SET
 NON-METERING WITH
FORWARD HOLDING
 2000 TYPE

GBX 16200

SHEET 3-6

FIG. E

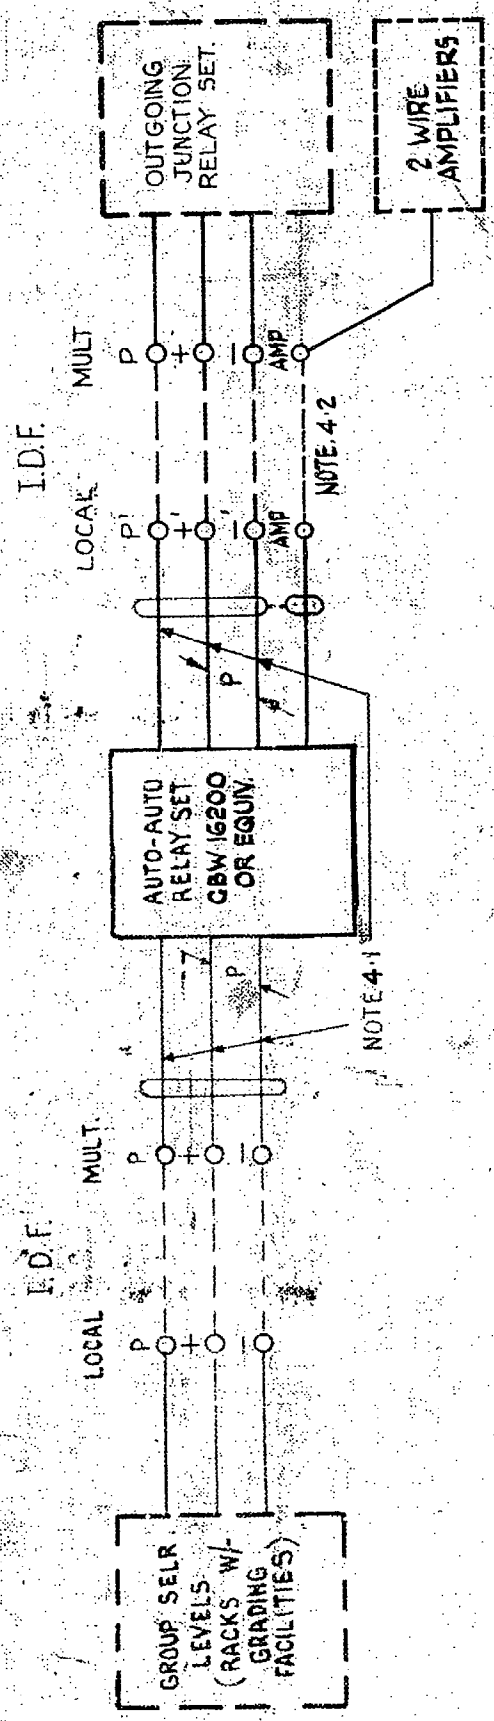

NOTES.

- 4.1 WHEN LOCAL CONDITIONS DO NOT REQUIRE I.D.F. TERMINATIONS, THESE LEADS MAY BE CABLED DIRECT.
- 4.2 THIS LEAD PROVIDED FOR OPERATION OF 2 WIRE AMPLIFIERS (REGISTERS) AND IS ONLY CABLED TO I.D.F. WHEN REQ'D. TAGBLOCK AS SHOWN.

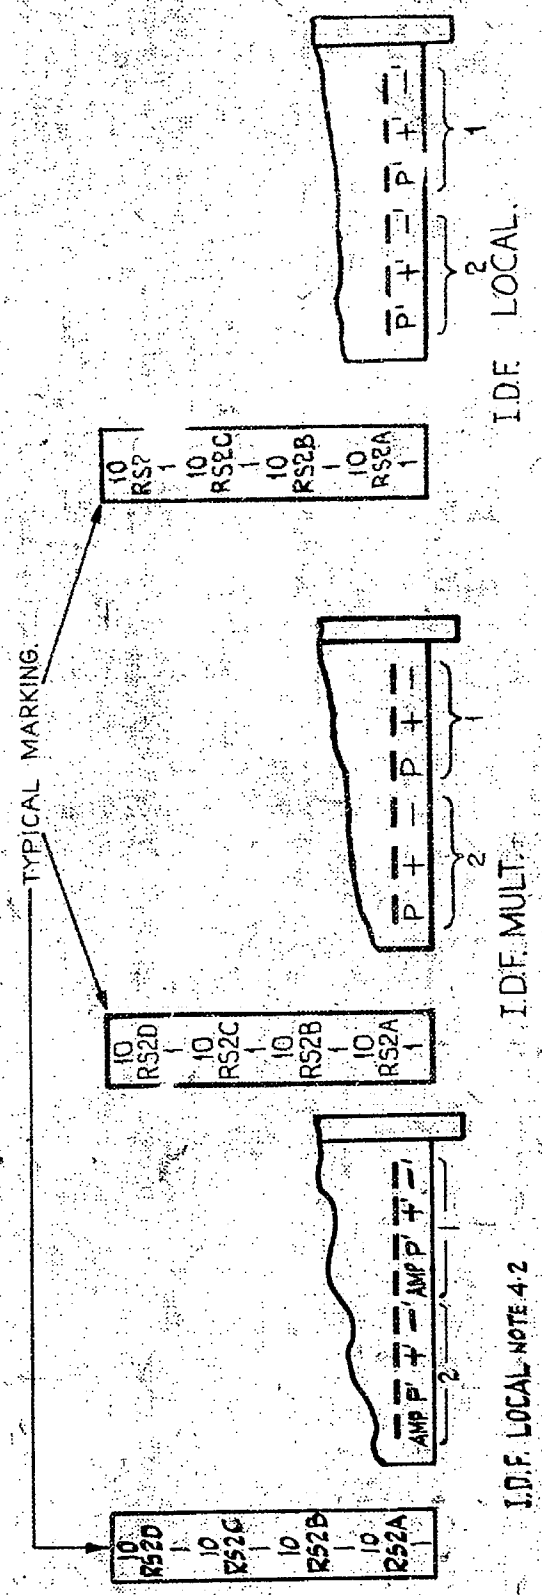


FIG. NO & SHT. NO REVISED	(74902)	3	28.8.63	DBH
'AMP' LEAD & NOTE 7.2 ADDED.	(77938)	2	24.5.63	DBH
AMENDMENT PARTICULARS		ISSUE	DATE	APPD.
N.Z.P.O.	DRAWN	CHECKED	WIRING	CIRCUIT
	DEC.	N.P.A. 8/4/63		

AUTO TO AUTO RELAY SET
NON-METERING WITH
FORWARD HOLDING
2000 TYPE

GBX 16200

SHEET 4-6

FIG. F.

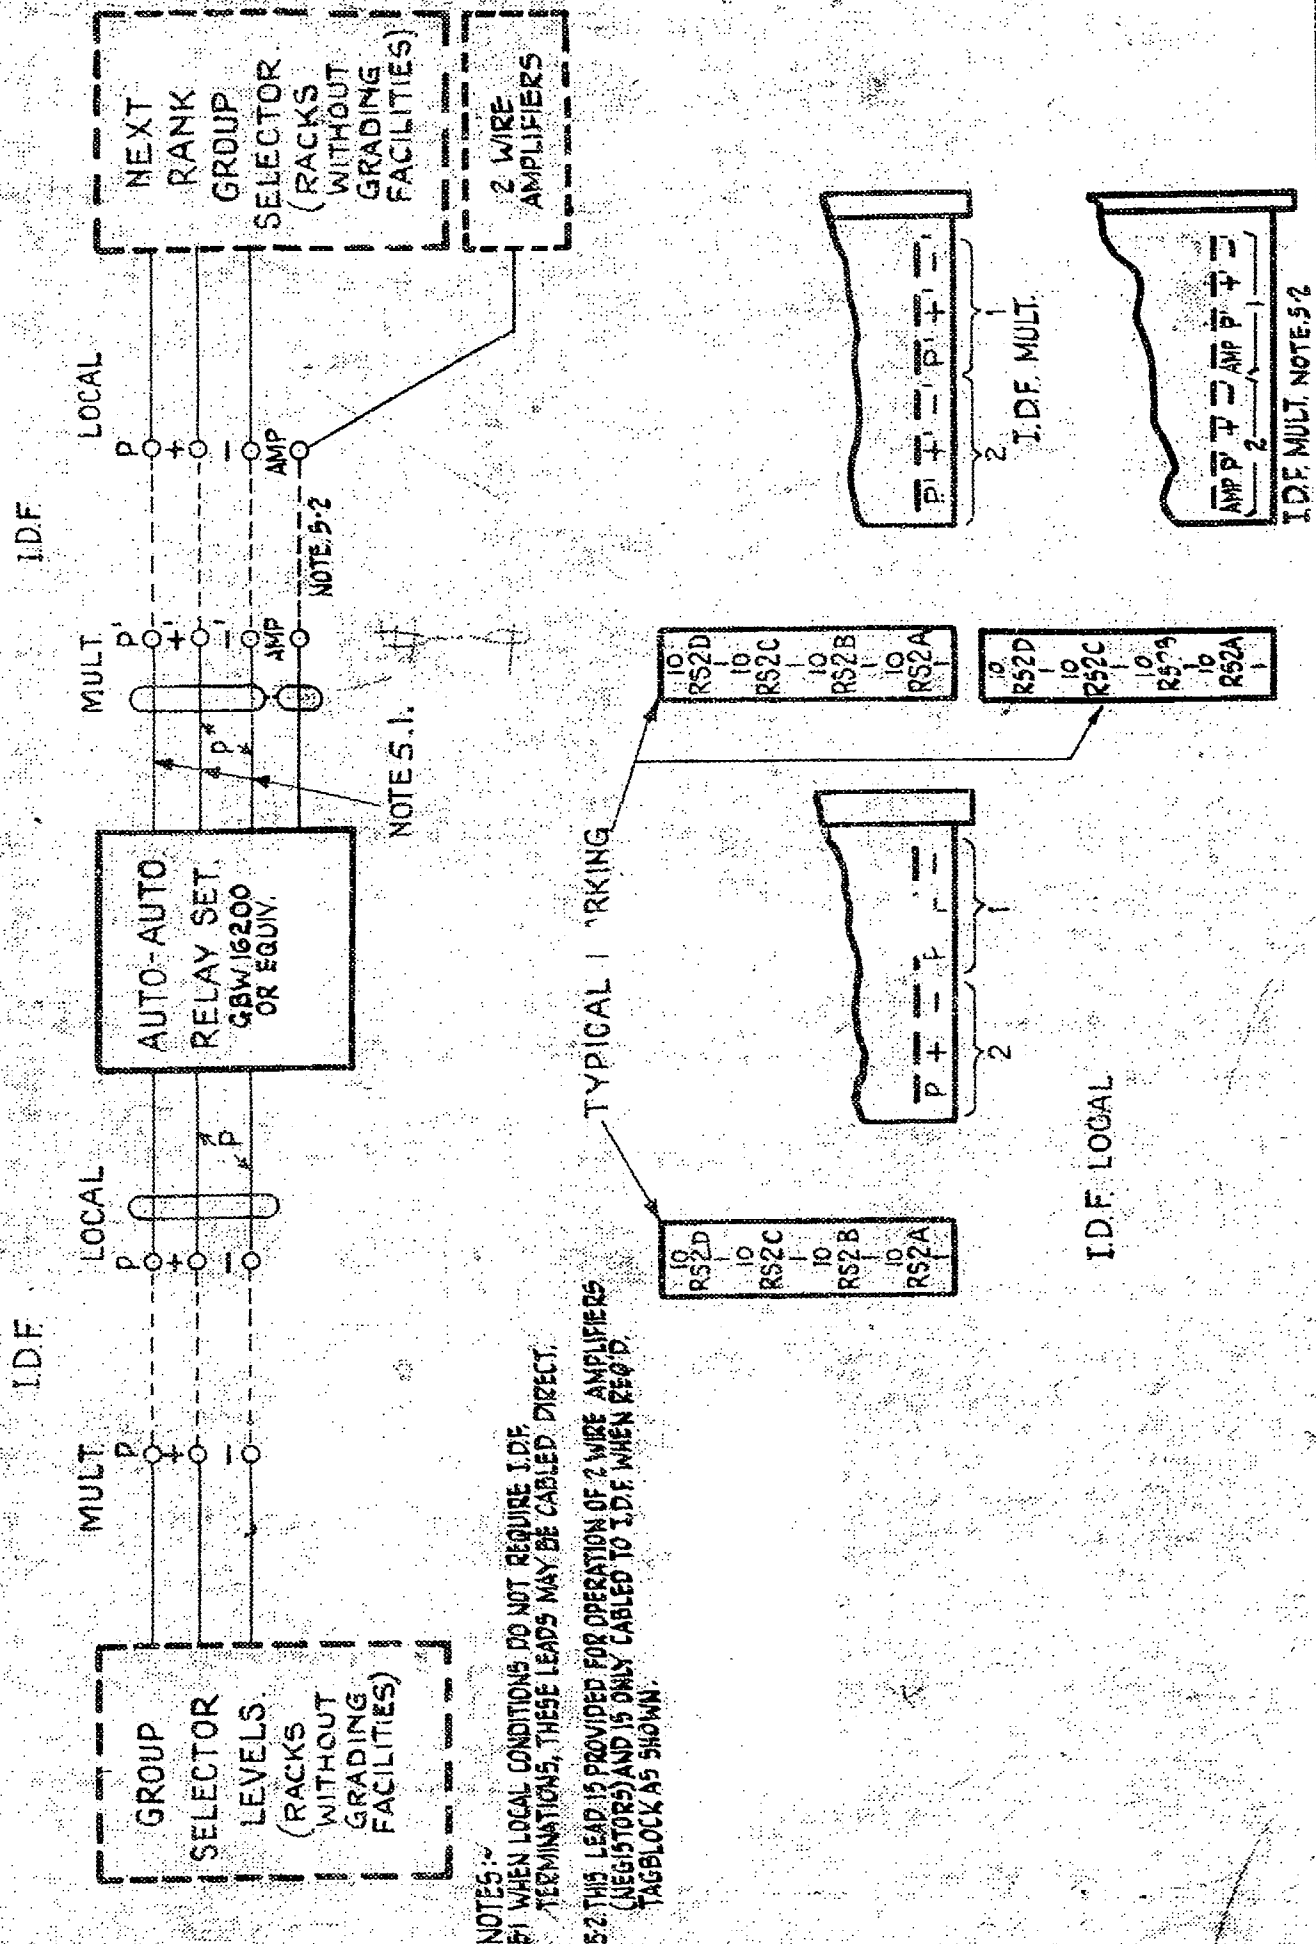


FIG. NO & SHT. NO REVISED.

(74002)

3

28.8.63 ORH

AMP LEAD & NOTE 5.2. ADDED.

(77938)

2

24.5.63 ORH

AUTO TO AUTO RELAY SET
NON-METERING WITH
FORWARD HOLDING
2000 TYPE

AMENDMENT PARTICULARS

ISSUE DATE APPD



N.Z.P.O.

DRAWN CHECKED WIRING CIRCUIT

GBX 16200

FIG G

I.D.F.

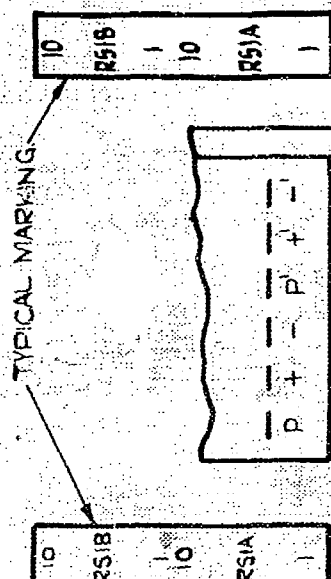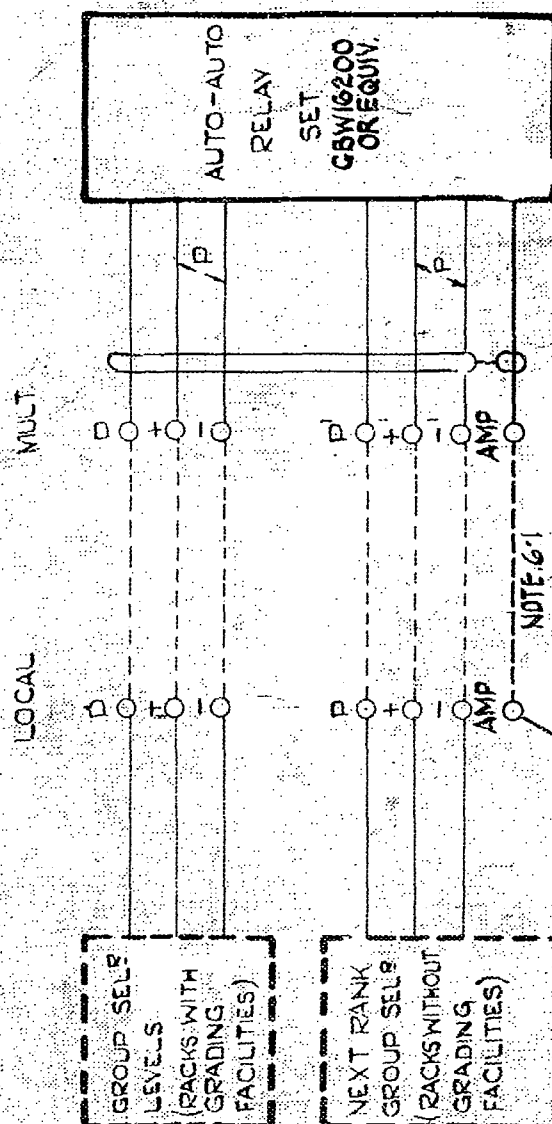

NOTES:-
G-1 THIS LEAD PROVIDED FOR OPERATION OF 2 WIRE AMPLIFIERS (REGISTERS) AND IS ONLY CABLED TO I.D.F. WHEN REQUIRED, TAGBLOCK AS SHOWN.

FIG. NO & SHT. NO REVISED		(74902)	3	28-8-63	DBR
AMP LEAD & NOTE G-1 ADDED		(77938)	2	24-5-63	DBR
AMENDMENT PARTICULARS			ISSUE	DATE	APP
N.Z.P.O.		DRAWN	CHECKED	WIRING	CIRCUIT
		dec	slp 10/63		

AUTO TO AUTO RELAY SET
 NON-METERING WITH
FORWARD HOLDING
 2000 TYPE.

GBX16200

SHEET G-6