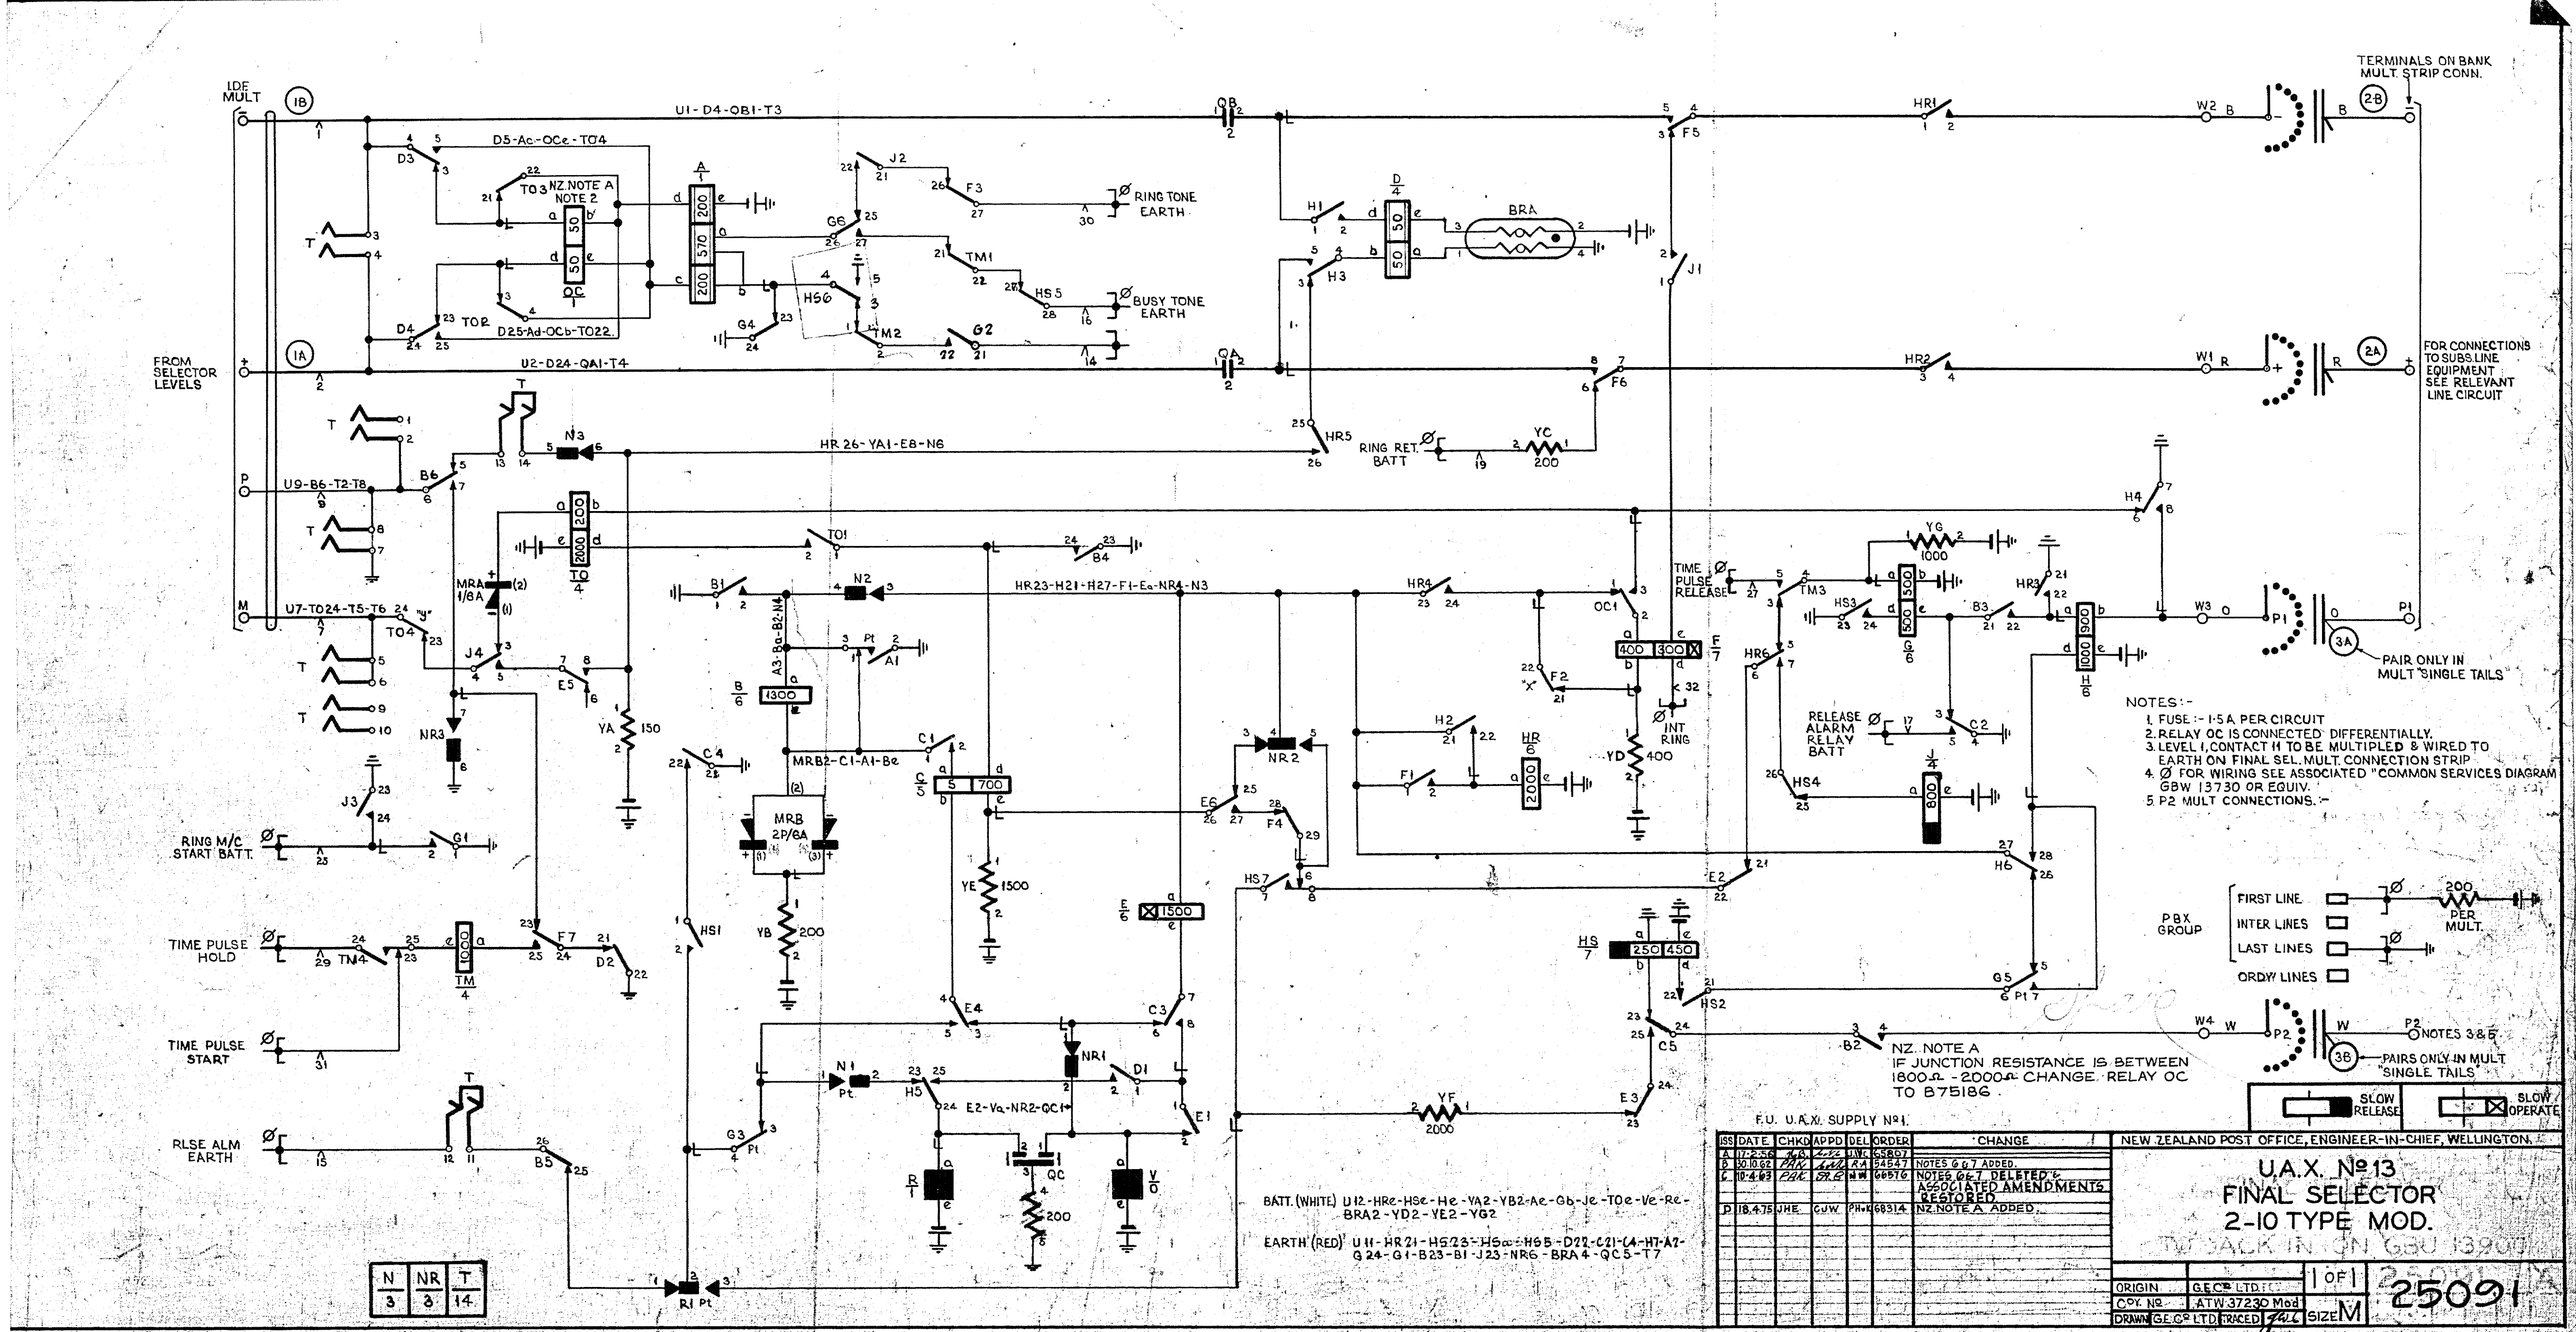

NOTES:-
1. FUSE :- 1·5A PER CIRCUIT
2. RELAY OC IS CONNECTED DIFFERENTIALLY.
3. LEVEL 1, CONTACT 11 TO BE MULTIPLED & WIRED TO EARTH ON FINAL SEL. MULT. CONNECTION STRIP
4. Ø FOR WIRING SEE ASSOCIATED "COMMON SERVICES DIAGRAM GBW 13730 OR EQUIV.
5. P2 MULT CONNECTIONS.-

F.U. U.A.X. SUPPLY No 1.

ISS	DATE	CHKD	APPD	DEL	ORDER	CHANGE
A	17-2-56	[illegible]	[illegible]	J.W.C.	65807	
B	30.10.62	PAK	[illegible]	R.A.	54547	NOTES 6 & 7 ADDED.
C	10-4-63	PAK	[illegible]	[illegible]	66576	NOTES 6 & 7 DELETED & ASSOCIATED AMENDMENTS RESTORED
D	18.4.75	JHE	CJW	PH.K	68314	NZ. NOTE A ADDED.

NEW ZEALAND POST OFFICE, ENGINEER-IN-CHIEF, WELLINGTON.

U.A.X. No 13 FINAL SELECTOR 2-10 TYPE MOD.

TW JACK IN ON GBU 13900

ORIGIN	G.E.Co LTD.	1 OF 1	25091
COY. No	ATW 37230 Mod		
DRAWN	G.E.Co LTD.	TRACED	SIZE M