RELAY DESIGN FOR CIRCUIT GBW 15660

TITLE 6·3 VOLT A.C. HEATER SUPPLY WITH A.C./D.C. CHANGEOVER FACILITY U.A.X. NZ 13 1·V.F. SYSTEM

COMMITTEE'S WIRING DIAGRAM Nº

RELAY NAME	COMM CODE	IF NEW CODE (CARD ATTACHED)	DEPARTURES FROM DIAGRAM: RESISTANCE	DEPARTURES FROM DIAGRAM: CONTACTS	SPRING NUMBERING CONTACT UNIT NUMBER 1	2	3	4	5	6	7	8	REFERENCES TO NOTES BELOW
COA	RELAY SWITCH P.O. 3903 NL $\frac{2-30}{AX}$				2 / 1	4 / 3	23 / 22 / 21						C1
					B	B	CPt						
COB	" " P.O. 3101 NL $\frac{2-30}{AX}$				2 / 1	4 / 3	23 / 22 / 21						C2
					M	M	CPt						
DC	5986				2 / 1	? / 21							
					B	B							
MFA	74614				2 / 1	4 / 3	22 / 21						
					B	B	B						
MFB	5987				2 / 1								
					M								
MFX	2408				2 / 1								
					M								
MFY	2408				2 / 1								
					M								
RS	2017				3 / 2 / 1								
					C								

NOTES
SPECIAL FACTORS OF SAFETY A
SPECIAL ADJUSTMENTS B
CIRCUIT POINTS OR MODIFICATIONS C

CLASS	RELAY	NOTES
C1	COA	CONTACTS 1 & 2 ARE MERCURY TUBE "BREAK" ACTIONS (30 AMPS)
C2	COB	" 1 & 2 " " " "MAKE" " (")

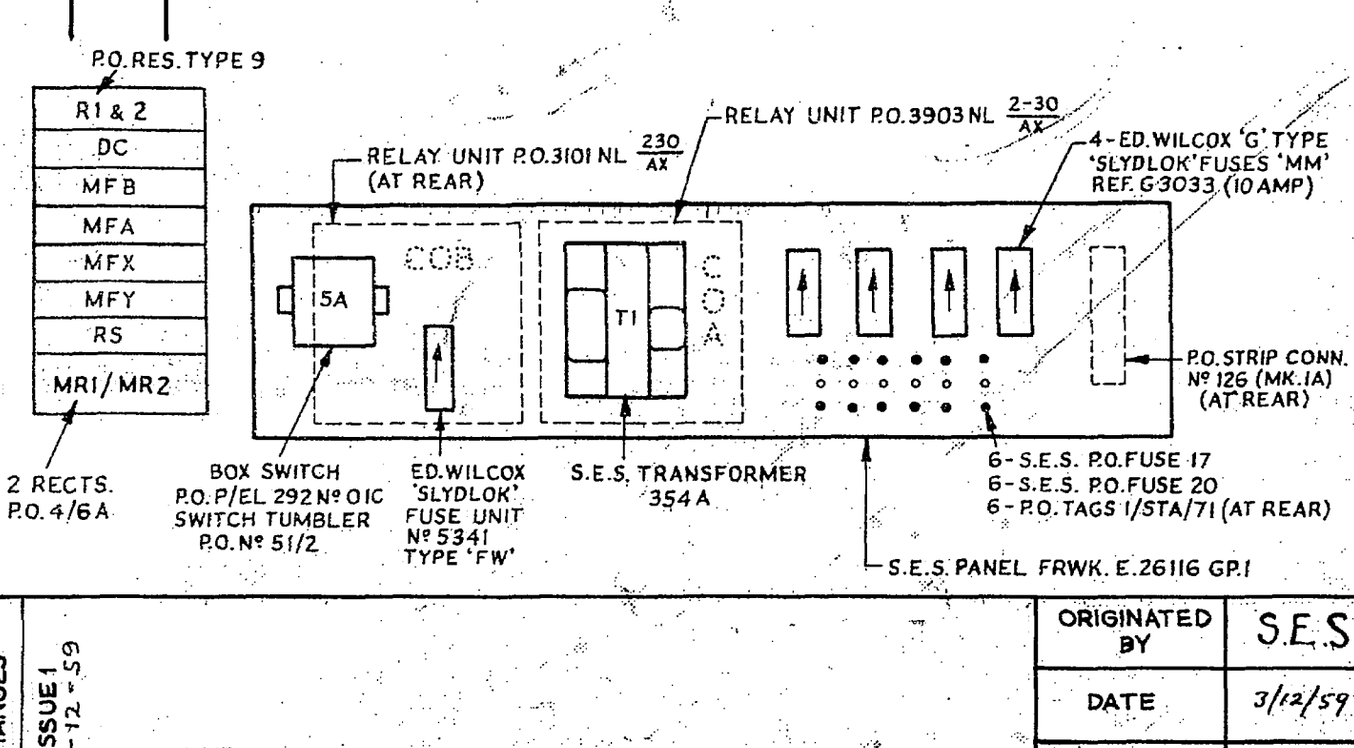

CHANGES
ISSUE 1 3-12-59

ORIGINATED BY	S.E.S
DATE	3/12/59
SIGNED FOR COMMITTEE	