

BELL SYSTEM PRACTICES
Station Installation and Maintenance

SECTION C64.248
Issue 1, 6-1-50
AT&T Co Standard

PREPAYMENT COIN COLLECTORS
D-178936, D-178937, D-178938, D-178939
DIAL SHORT-CIRCUITING, THREE
SPRING RELAY
COMMON BATTERY—CONNECTIONS

1. GENERAL

1.01 This section covers the connections for D-178936, D-178937, D-178938 and D-178939 coin collectors intended for use at anti-sidetone, common battery stations, only.

1.02 The 37A varistor shall be used at all installations.

1.03 The line wires need not terminate in the coin collectors as shown in the connection diagrams herein, unless otherwise specified by the Telephone Company. They may terminate at the associated terminals in the subscriber sets.

2. DIAL SHORT-CIRCUITING—THREE SPRING RELAY TYPE—COMMON BATTERY STATIONS—CONNECTIONS


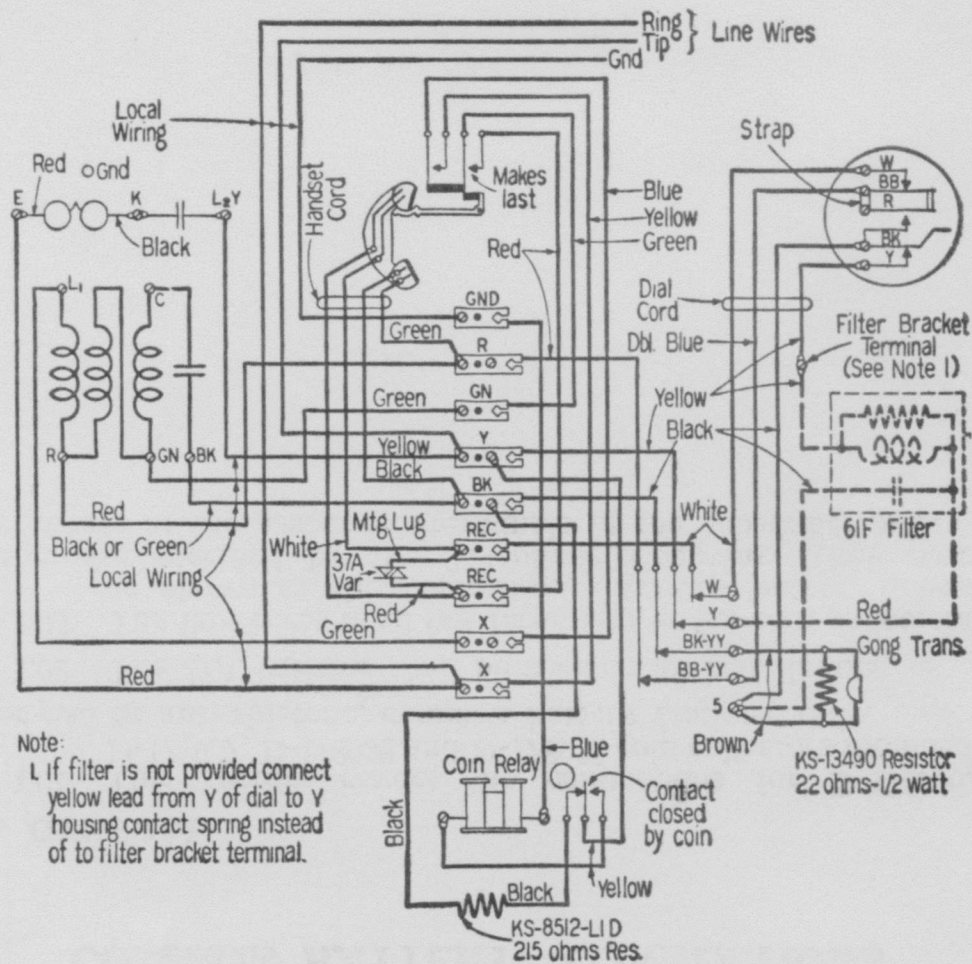


Fig. 1—D-178936 and D-178937 Coin Collectors

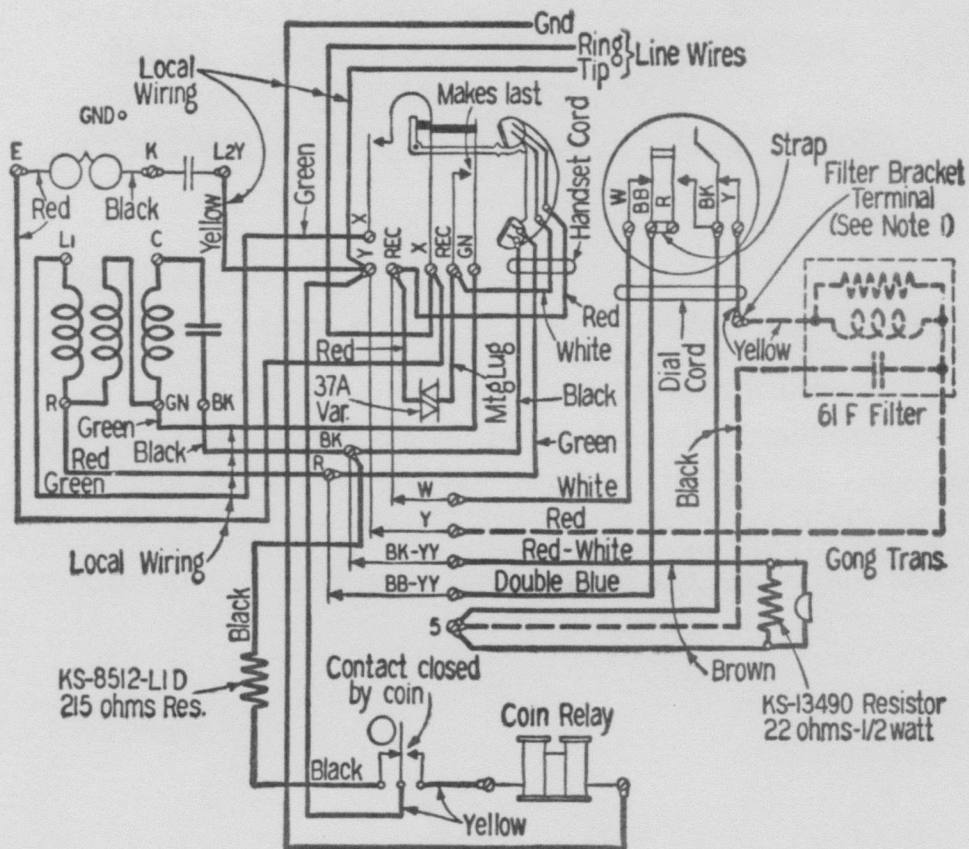

Notes.
 1. If filter is not provided connect yellow lead from Y of dial to Y housing contact spring instead of to Filter Bracket Terminal.

Fig. 2—D-178938 and D-178939 Coin Collectors